


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

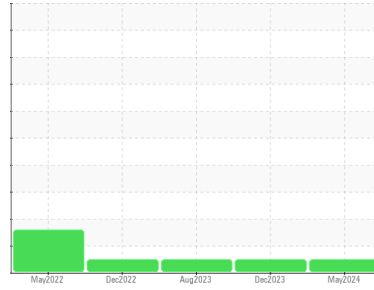

Machine Id  
**CAL016 (S/N 3626-1)**

Component  
**Refrigeration Compressor**

Fluid  
**PETRO CANADA REFLO 68A AMMONIA OIL (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: Warning ammonia )

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PC0080223</b>	PC0076337	PC0010701
Sample Date	Client Info		<b>17 May 2024</b>	29 Dec 2023	09 Aug 2023
Machine Age	hrs	Client Info	<b>12187</b>	11567	10608
Oil Age	hrs	Client Info	<b>11567</b>	11567	10608
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	---
Iron	ppm	ASTM D5185(m) >50	<b>8</b>	8	9
Chromium	ppm	ASTM D5185(m) >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185(m) >25	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	<1	<1
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185(m) 0	<b>1</b>	2	2
Phosphorus	ppm	ASTM D5185(m) 0	<b>2</b>	1	2
Zinc	ppm	ASTM D5185(m) 0	<b>3</b>	2	2
Sulfur	ppm	ASTM D5185(m) 0	<b>23</b>	8	26
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1






## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>4</b>	5	10
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304* >0.1	<b>0.00</b>	0.002	---
ppm Water	ppm	ASTM D6304* >1000	<b>0</b>	24	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.05	<b>0.02</b>	0.01	---

# OIL ANALYSIS REPORT

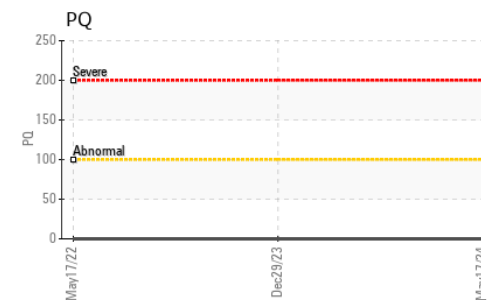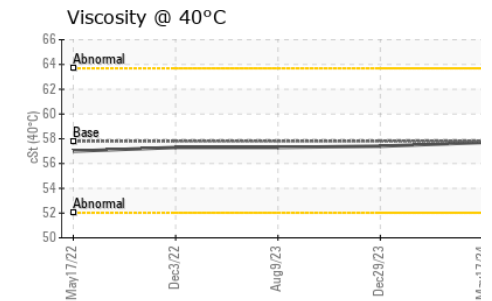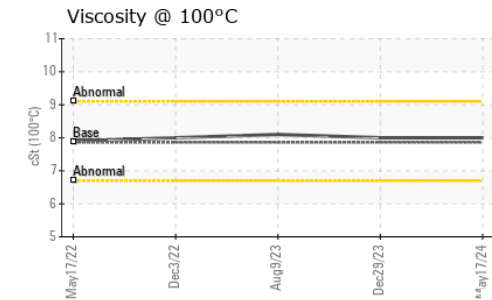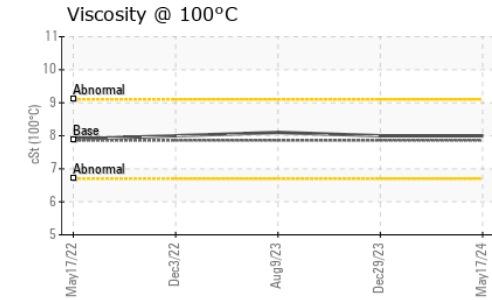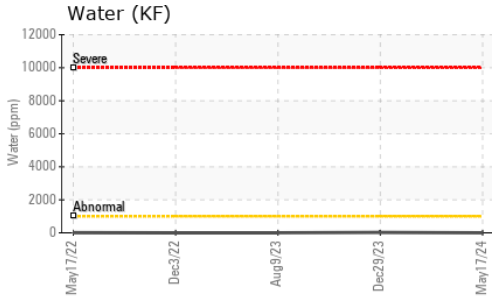

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	57.8	57.7	57.4
Visc @ 100°C	cSt	ASTM D7279(m)	7.86	8.0	8
Viscosity Index (VI)	Scale	ASTM D2270*	101	105	105

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS	



**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0080223  
**Lab Number** : 02638065  
**Unique Number** : 5787227  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, TAN Man, VI )

**Ocean Choice International - MV Calvert**  
 1315 Topsail Rd, P.O. Box 8190  
 St. John's, NL  
 CA A1B 3N4  
 Contact: Calvert Engine Control Room  
 calvertengine@oceanchoice.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.