




OIL ANALYSIS REPORT

Sample Rating Trend

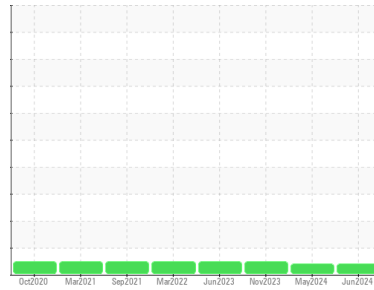

VISCOSITY



Machine Id
727007
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

Fluid Condition

Viscosity of sample indicates oil is within SAE 30 range, advise investigate. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GFL0113212	GFL0113232	GFL0102880
Sample Date	Client Info	03 Jun 2024	02 May 2024	21 Nov 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	11037	10920	10569
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	NEG	NEG
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >120	3	8	14
Chromium	ppm ASTM D5185(m) >20	0	0	0
Nickel	ppm ASTM D5185(m) >5	0	0	<1
Titanium	ppm ASTM D5185(m) >2	0	0	0
Silver	ppm ASTM D5185(m) >2	0	0	<1
Aluminum	ppm ASTM D5185(m) >20	1	3	3
Lead	ppm ASTM D5185(m) >40	0	0	<1
Copper	ppm ASTM D5185(m) >330	<1	1	2
Tin	ppm ASTM D5185(m) >15	0	0	<1
Antimony	ppm ASTM D5185(m)	0	0	0
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 250	50	42	47
Barium	ppm ASTM D5185(m) 10	0	0	<1
Molybdenum	ppm ASTM D5185(m) 100	37	41	6
Manganese	ppm ASTM D5185(m)	0	<1	0
Magnesium	ppm ASTM D5185(m) 450	473	447	100
Calcium	ppm ASTM D5185(m) 3000	1620	1729	1991
Phosphorus	ppm ASTM D5185(m) 1150	731	725	891
Zinc	ppm ASTM D5185(m) 1350	820	862	1123
Sulfur	ppm ASTM D5185(m) 4250	2037	2087	2552
Lithium	ppm ASTM D5185(m)	<1	<1	<1

CONTAMINANTS




method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	3	3	3
Sodium	ppm ASTM D5185(m) >216	2	2	7
Potassium	ppm ASTM D5185(m) >20	0	<1	4
Fuel	% ASTM D7593* >3.0	1.5	1.8	<1.0

INFRA-RED

method	limit/base	current	history1	history2
Soot %	% ASTM D7844* >4	0	0.2	0.5
Nitration	Abs/cm ASTM D7624* >20	5.8	8.2	9.1
Sulfation	Abs.1mm ASTM D7415* >30	22.1	23.1	24.5



OIL ANALYSIS REPORT






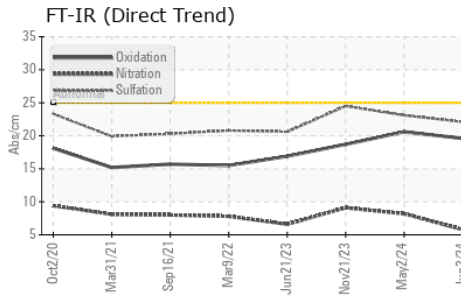
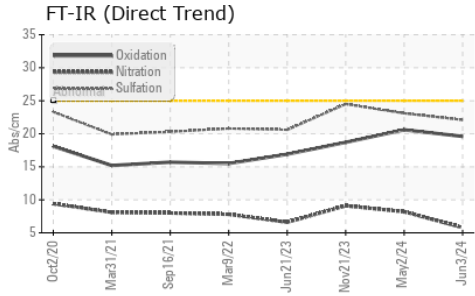
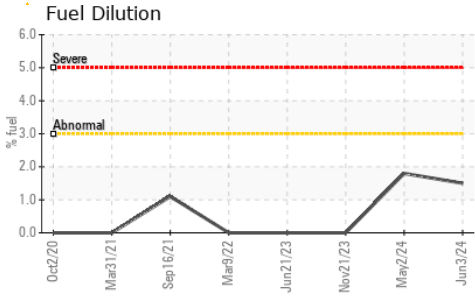


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	19.6	20.6	18.7

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	VLITE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	▲ 10.9	▲ 11.2	13.7

GRAPHS

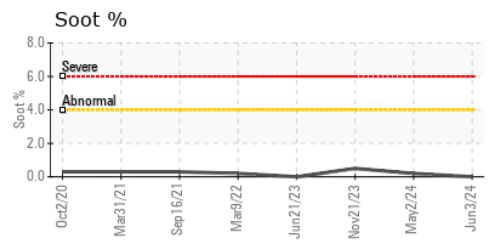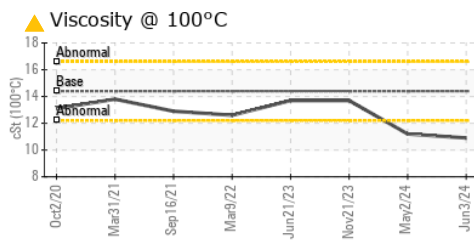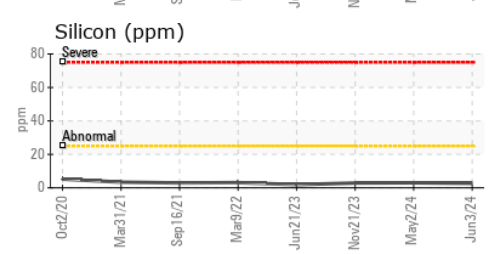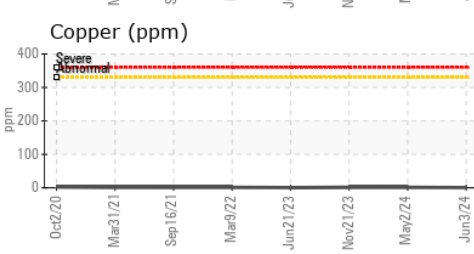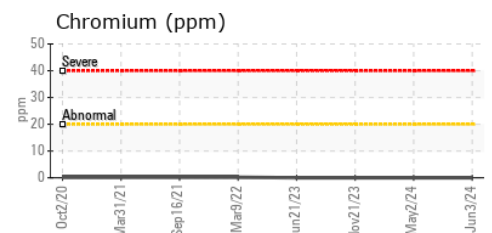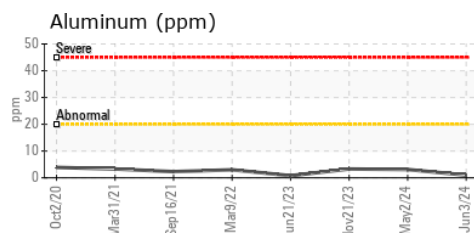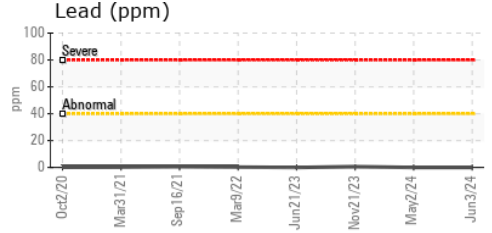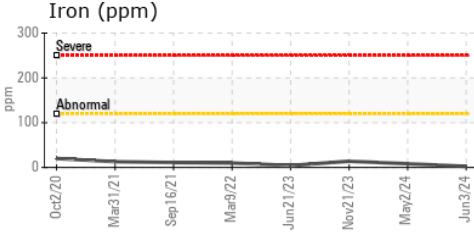

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0113212 **Received** : 05 Jun 2024
Lab Number : **02639796** **Tested** : 07 Jun 2024
Unique Number : 5788958 **Diagnosed** : 07 Jun 2024 - Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, Visual)

GFL Environmental - 246 - Windsor
 2700 Deziel Dr
 Windsor, ON
 CA N8W 5H8
 Contact: Dave Varga
 dvarga@gflenv.com
 T: (519)944-8009
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.