


# OIL ANALYSIS REPORT

Sample Rating Trend



**WEAR**

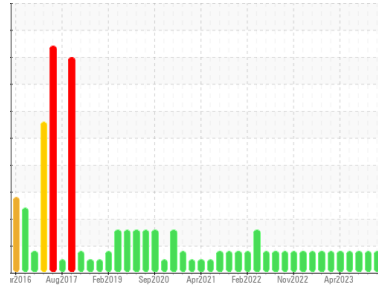

Area

**TEAM 1**

Machine Id

**122108 ID Fan Outboard (S/N 122109 Outboard Brg)**

Component

**Bearing**

Fluid

**PETRO CANADA TURBOFLO R&O 150 (1 GAL)**

## DIAGNOSIS

### Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

### Wear

Lead ppm levels are abnormal. Bearing wear is indicated.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PC0078790</b>	PC0078805	PC0074822
Sample Date	Client Info	<b>28 May 2024</b>	22 Jan 2024	05 Oct 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ATTENTION

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >20	<b>8</b>	4	3
Chromium	ppm ASTM D5185(m) >20	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m) >20	<b>0</b>	0	0
Titanium	ppm ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm ASTM D5185(m)	<b>0</b>	0	<1
Aluminum	ppm ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D5185(m) >20	<b>▲ 85</b>	▲ 76	● 61
Copper	ppm ASTM D5185(m) >20	<b>10</b>	8	7
Tin	ppm ASTM D5185(m) >20	<b>1</b>	1	<1
Antimony	ppm ASTM D5185(m)	<b>2</b>	2	<1
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Barium	ppm ASTM D5185(m)	<b>&lt;1</b>	0	<1
Molybdenum	ppm ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm ASTM D5185(m)	<b>&lt;1</b>	0	0
Magnesium	ppm ASTM D5185(m)	<b>2</b>	1	<1
Calcium	ppm ASTM D5185(m) 0	<b>10</b>	8	5
Phosphorus	ppm ASTM D5185(m) 4	<b>9</b>	8	7
Zinc	ppm ASTM D5185(m) 0	<b>8</b>	10	6
Sulfur	ppm ASTM D5185(m)	<b>1939</b>	2096	1346
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >15	<b>3</b>	2	1
Sodium	ppm ASTM D5185(m)	<b>1</b>	0	<1
Potassium	ppm ASTM D5185(m) >20	<b>2</b>	1	<1

## FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974* 0.18	<b>0.14</b>	0.16	---

# OIL ANALYSIS REPORT


**▲ Non-ferrous Metals**

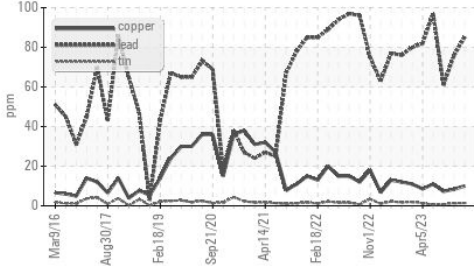


**Viscosity @ 100°C**

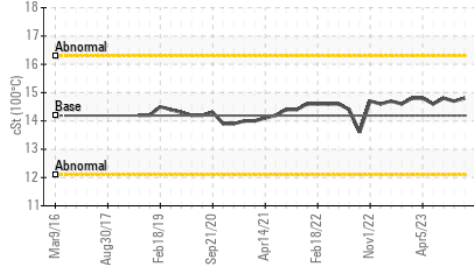

**Viscosity @ 100°C**

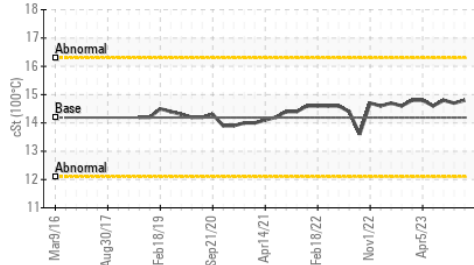


**Viscosity @ 40°C**

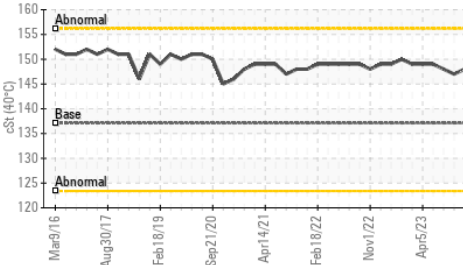


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	VLITE	VLITE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	LIGHT	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	137.1	148	148
Visc @ 100°C	cSt	ASTM D7279(m)	14.19	14.8	14.8
Viscosity Index (VI)	Scale	ASTM D2270*	101	99	99

**SAMPLE IMAGES**

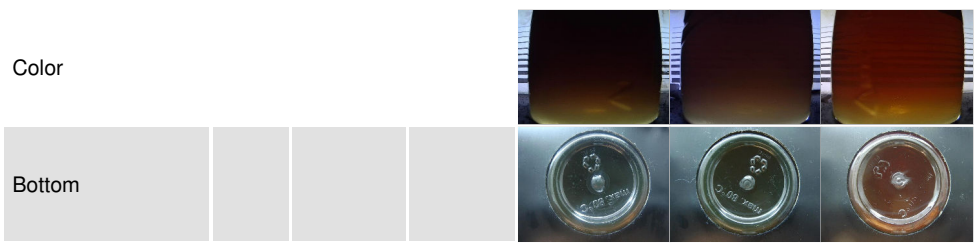

**GRAPHS**

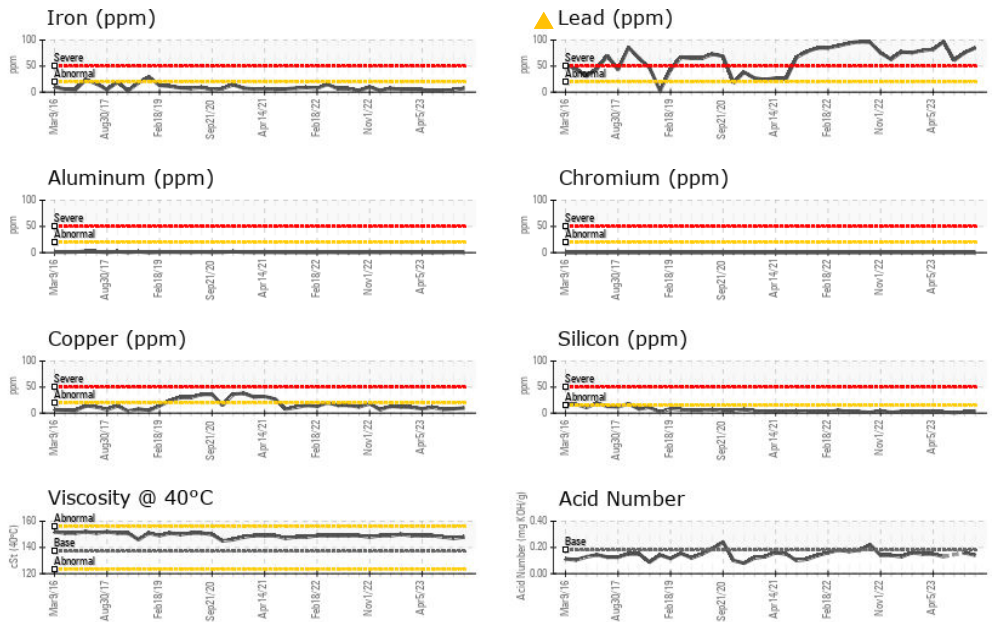

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0078790 **Received** : 13 Jun 2024  
**Lab Number** : **02641755** **Tested** : 13 Jun 2024  
**Unique Number** : 5799294 **Diagnosed** : 13 Jun 2024 - Kevin Marson  
**Test Package** : MOB 2 ( Additional Tests: KV100, TAN Man, VI )

**Dryden Fibre**  
 Box 3001, 1 Duke Street  
 Dryden, ON  
 CA P8N 2Z7  
 Contact: Adebukola Adekanye  
 aadekanye@drydenfibre.ca  
 T: (807)223-9950  
 F: (807)223-9176

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.