


OIL ANALYSIS REPORT

Area
TEAM 1
Machine Id
122156 ID Fan Inboard (S/N 122156 Inboard Brg)
Component
Bearing
Fluid
PETRO CANADA TURBOFLO R&O 150 (1 LTR)

Sample Rating Trend

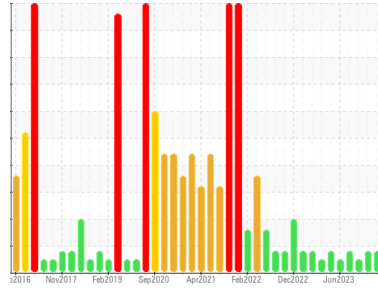

WEAR



DIAGNOSIS

Recommendation

We recommend an early resample to monitor this condition.

Wear

Lead ppm levels are marginal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PC0078791	PC0076997	PC0074803
Sample Date	Client Info			28 May 2024	20 Jan 2024	05 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				MARGINAL	ABNORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	8	8	3
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	<1	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	<1
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	0
Lead	ppm	ASTM D5185(m)	>20	▲ 28	▲ 30	5
Copper	ppm	ASTM D5185(m)	>20	3	4	<1
Tin	ppm	ASTM D5185(m)	>20	<1	<1	0
Antimony	ppm	ASTM D5185(m)		2	<1	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	0	<1
Barium	ppm	ASTM D5185(m)		<1	0	<1
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		<1	0	0
Magnesium	ppm	ASTM D5185(m)		1	<1	<1
Calcium	ppm	ASTM D5185(m)	0	4	3	2
Phosphorus	ppm	ASTM D5185(m)	4	6	3	7
Zinc	ppm	ASTM D5185(m)	0	10	10	5
Sulfur	ppm	ASTM D5185(m)		3572	4270	4173
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	3	6	2
Sodium	ppm	ASTM D5185(m)		2	3	<1
Potassium	ppm	ASTM D5185(m)	>20	1	1	0


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.18	0.10	0.08	---

OIL ANALYSIS REPORT


▲ Non-ferrous Metals

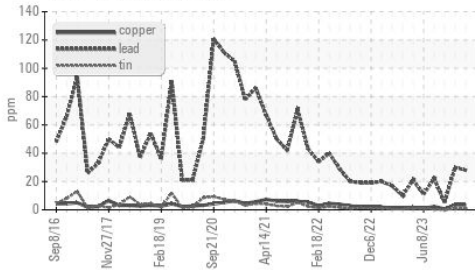


Viscosity @ 100°C

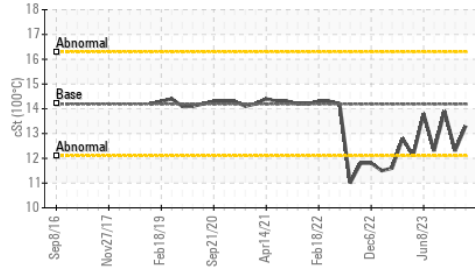

Viscosity @ 100°C

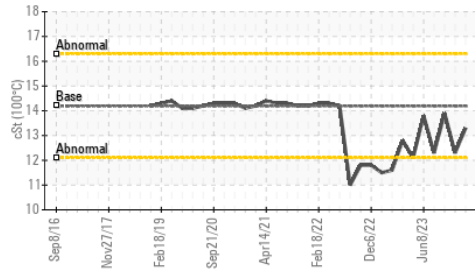


Viscosity @ 40°C

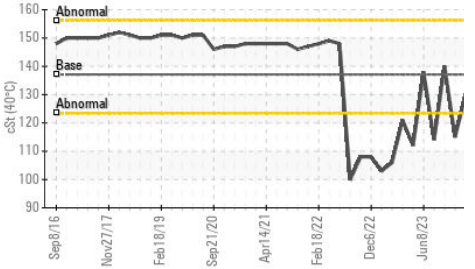


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	137.1	130	115
Visc @ 100°C	cSt	ASTM D7279(m)	14.19	13.3	12.3
Viscosity Index (VI)	Scale	ASTM D2270*	101	96	95

SAMPLE IMAGES

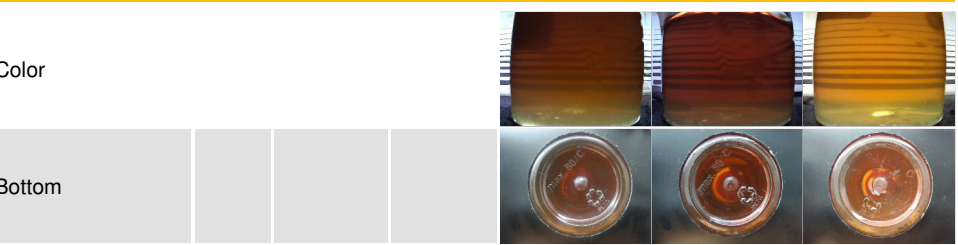

GRAPHS

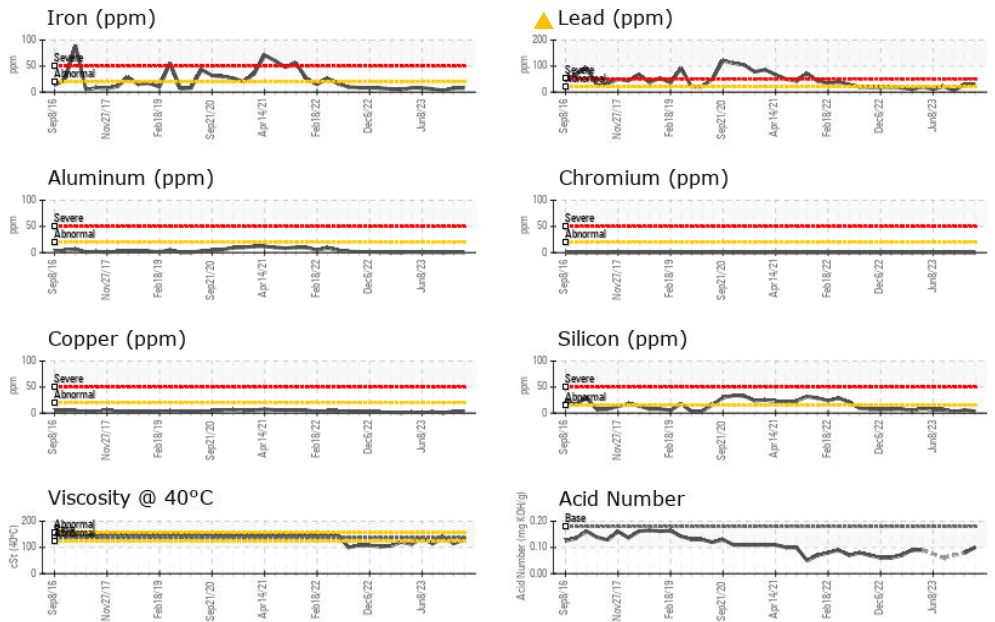

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0078791
Lab Number : 02641757
Unique Number : 5799296
Test Package : MOB 2 (Additional Tests: KV100, TAN Man, VI)

Received : 13 Jun 2024
Tested : 13 Jun 2024
Diagnosed : 13 Jun 2024 - Kevin Marson

Dryden Fibre
 Box 3001, 1 Duke Street
 Dryden, ON
 CA P8N 2Z7

Contact: Adebukola Adekanye
 aadekanye@drydenfibre.ca

T: (807)223-9950
 F: (807)223-9176

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.