



Area

Power Generation

Machine Id


V837200 STANDBY POWER GENERATION 600V PACKAGE

Component

Lube System

Fluid

MOBIL DTE OIL MEDIUM (113 LTR)

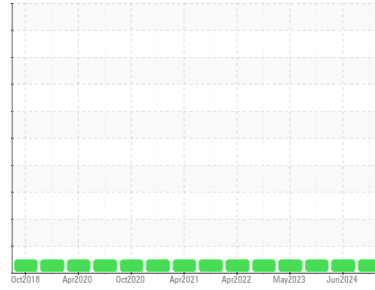

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION method limit/base current history1 history2

| | | | | |
|---------------|-----------------|--------------------|-------------|-------------|
| Sample Number | Client Info | PC14005838 | PC14006128 | PP13932690 |
| Sample Date | Client Info | 20 Jun 2024 | 19 Jun 2024 | 25 Nov 2023 |
| Machine Age | hrs Client Info | 0 | 0 | 0 |
| Oil Age | hrs Client Info | 0 | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | NORMAL | NORMAL | NORMAL |

WEAR METALS method limit/base current history1 history2

| | | | | | | |
|-----------|-----|---------------|-----|--------------|----|----|
| Iron | ppm | ASTM D5185(m) | >20 | <1 | <1 | <1 |
| Chromium | ppm | ASTM D5185(m) | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) | >10 | <1 | <1 | <1 |
| Titanium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Aluminum | ppm | ASTM D5185(m) | >10 | <1 | <1 | 0 |
| Lead | ppm | ASTM D5185(m) | >20 | <1 | <1 | <1 |
| Copper | ppm | ASTM D5185(m) | >20 | 39 | 39 | 39 |
| Tin | ppm | ASTM D5185(m) | >10 | 0 | 0 | <1 |
| Antimony | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |

ADDITIVES method limit/base current history1 history2

| | | | | | | |
|------------|-----|---------------|--|--------------|------|------|
| Boron | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Barium | ppm | ASTM D5185(m) | | 0 | 0 | <1 |
| Molybdenum | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185(m) | | 5 | <1 | <1 |
| Phosphorus | ppm | ASTM D5185(m) | | 93 | 92 | 95 |
| Zinc | ppm | ASTM D5185(m) | | 98 | 99 | 101 |
| Sulfur | ppm | ASTM D5185(m) | | 1203 | 1214 | 1190 |
| Lithium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |






CONTAMINANTS method limit/base current history1 history2

| | | | | | | |
|-----------|-----|---------------|-------|-------------|-----|-----|
| Silicon | ppm | ASTM D5185(m) | >15 | 4 | 4 | 5 |
| Sodium | ppm | ASTM D5185(m) | | 0 | 0 | <1 |
| Potassium | ppm | ASTM D5185(m) | >20 | 0 | 0 | 0 |
| Water | % | ASTM D6304* | >0.05 | 0.00 | --- | --- |
| ppm Water | ppm | ASTM D6304* | >500 | 0 | --- | --- |

FLUID CLEANLINESS method limit/base current history1 history2

| | | | | | |
|-----------------|--------------|-----------|-----------------|---------|----------|
| Particles >4µm | ASTM D7647 | >5000 | 942 | 103 | 1794 |
| Particles >6µm | ASTM D7647 | >1300 | 137 | 23 | 654 |
| Particles >14µm | ASTM D7647 | >160 | 15 | 4 | 97 |
| Particles >21µm | ASTM D7647 | >40 | 5 | 2 | 36 |
| Particles >38µm | ASTM D7647 | >10 | 1 | 1 | 6 |
| Particles >71µm | ASTM D7647 | >3 | 0 | 1 | 1 |
| Oil Cleanliness | ISO 4406 (c) | >19/17/14 | 17/14/11 | 14/12/9 | 18/17/14 |

OIL ANALYSIS REPORT

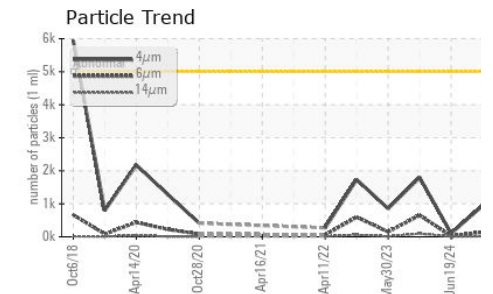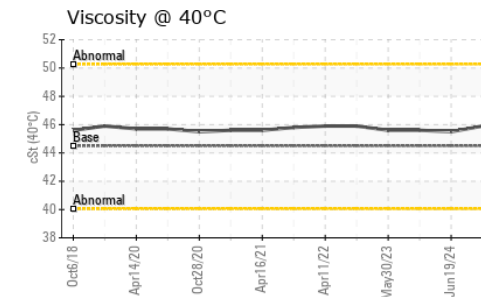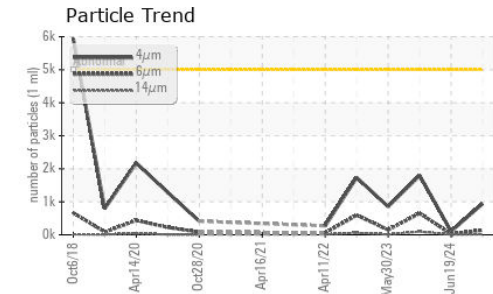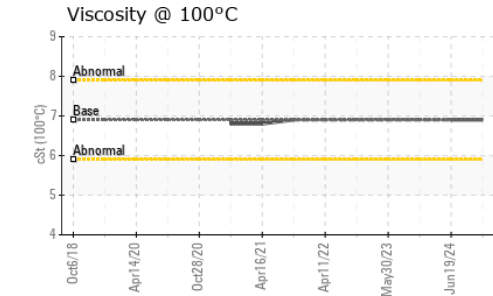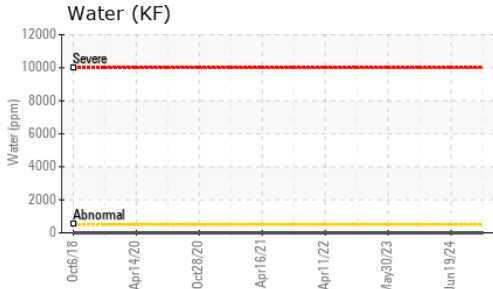

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | Visual* | NONE | VLITE | NONE |
| Yellow Metal | scalar | Visual* | NONE | NONE | NONE |
| Precipitate | scalar | Visual* | NONE | NONE | NONE |
| Silt | scalar | Visual* | NONE | NONE | NONE |
| Debris | scalar | Visual* | NONE | NONE | NONE |
| Sand/Dirt | scalar | Visual* | NONE | NONE | NONE |
| Appearance | scalar | Visual* | NORML | NORML | NORML |
| Odor | scalar | Visual* | NORML | NORML | NORML |
| Emulsified Water | scalar | Visual* | >0.05 | .2% | NEG |
| Free Water | scalar | Visual* | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|----------------------|--------|---------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 44.5 | 45.9 | 45.5 |
| Visc @ 100°C | cSt | ASTM D7279(m) | 6.9 | 6.9 | --- |
| Viscosity Index (VI) | Scale | ASTM D2270* | 98 | 105 | 107 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color | | | | | |
| Bottom | | | | | |

| GRAPHS | |
|--------|--|
| | |
| | |



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC14005838
Lab Number : 02647921
Unique Number : 5813473
Test Package : MOB 2 (Additional Tests: Bottom, KF, KV100, VI)

ExxonMobil Canada East Ltd.
 Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow
 St. John`s, NL
 CA A1C 6K3
 Contact: Liam Maher
 liam.m.maher@exxonmobil.com
 T: (709)273-3729
 F:

*To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.*