

Machine Id
V411201C FWP C GEN LUBE OIL
Component
Tank Lube System
Fluid
MOBIL DTE OIL MEDIUM (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear
All component wear rates are normal.

Contamination
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info		PC14005838	PP14000799	PP13932690
Sample Date	Client Info		20 Jun 2024	13 Jun 2024	25 Nov 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed		Client Info	N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION method limit/base current history1 history2

Water	WC Method	>0.05	NEG	NEG	NEG
-------	-----------	-------	------------	-----	-----

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185(m)	>20	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)	>10	<1	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	<1	<1
Aluminum	ppm	ASTM D5185(m)	>10	<1	<1	0
Lead	ppm	ASTM D5185(m)	>20	<1	<1	<1
Copper	ppm	ASTM D5185(m)	>20	32	31	33
Tin	ppm	ASTM D5185(m)	>10	0	<1	<1
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	<1	0
Calcium	ppm	ASTM D5185(m)		1	<1	<1
Phosphorus	ppm	ASTM D5185(m)		90	91	91
Zinc	ppm	ASTM D5185(m)		95	96	97
Sulfur	ppm	ASTM D5185(m)		1190	1182	1168
Lithium	ppm	ASTM D5185(m)		<1	<1	<1






CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185(m)	>15	6	6	6
Sodium	ppm	ASTM D5185(m)		0	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	0	<1	0

FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm	ASTM D7647	>5000	738	1186	1195
Particles >6µm	ASTM D7647	>1300	155	361	292
Particles >14µm	ASTM D7647	>160	19	44	21
Particles >21µm	ASTM D7647	>40	6	15	5
Particles >38µm	ASTM D7647	>10	1	2	1
Particles >71µm	ASTM D7647	>3	1	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	17/14/11	17/16/13	17/15/12

OIL ANALYSIS REPORT

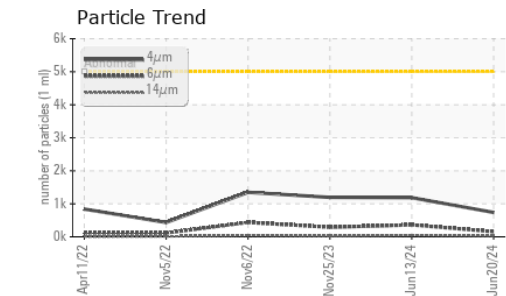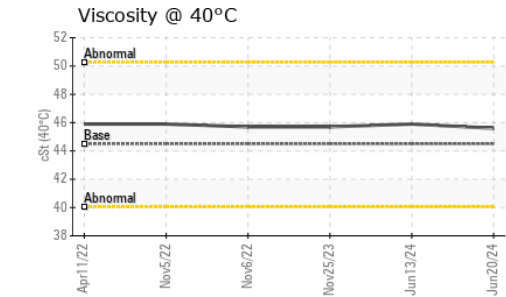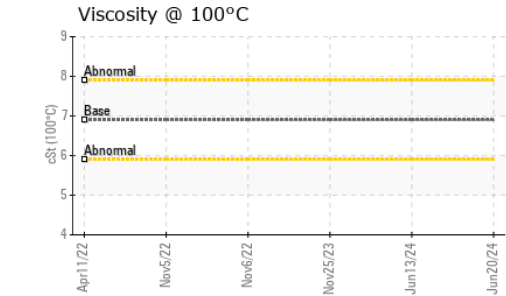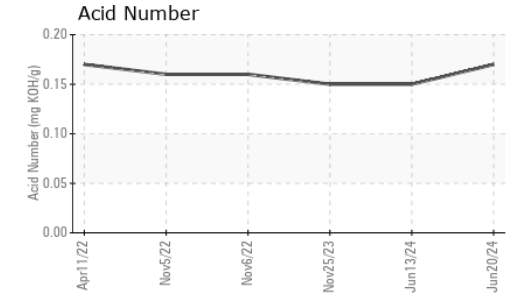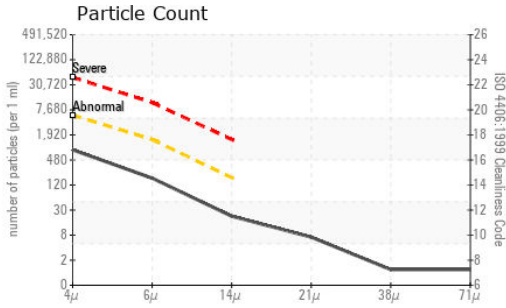


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.17	0.15	0.15

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	44.5	45.6	45.9	45.7
Visc @ 100°C	cSt	ASTM D7279(m)	6.9	6.9	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	98	106	---	---

SAMPLE IMAGES

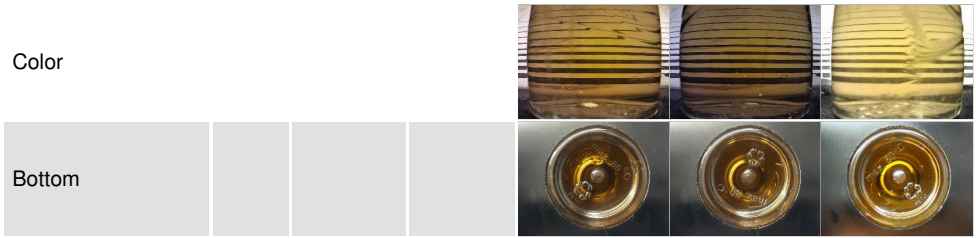

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC14005838
Lab Number : **02647922**
Unique Number : 5813474
Test Package : MAR 2 (Additional Tests: Bottom, KV100, TAN Man, VI)

ExxonMobil Canada East Ltd.
 Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow
 St. John`s, NL
 CA A1C 6K3
 Contact: Liam Maher
 liam.m.maher@exxonmobil.com
 T: (709)273-3729
 F:

*To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.*