


# OIL ANALYSIS REPORT

Area  
**1851**  
Machine Id  
**1851-5419-8002 - FIRE WATER DIESEL DRIVEN PUMP**  
Component  
**Diesel Engine**  
Fluid  
**PETRO CANADA DURON HP 15W40 (15 LTR)**

Sample Rating Trend

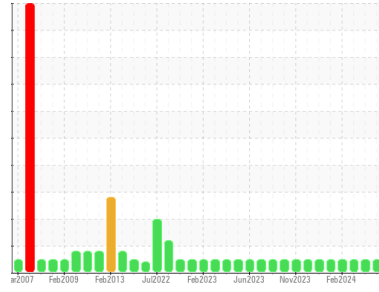

## DIAGNOSIS

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
There is no indication of any contamination in the oil.

**Fluid Condition**  
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PC0057836</b>	PC0057839	PC0077233
Sample Date	Client Info			<b>09 Jul 2024</b>	11 Jun 2024	16 Apr 2024
Machine Age	hrs Client Info			<b>0</b>	0	0
Oil Age	hrs Client Info			<b>0</b>	0	0
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG





WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	<b>1</b>	1	<1
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	0	0
Copper	ppm	ASTM D5185(m)	>330	<b>2</b>	1	<1
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<b>2</b>	2	2
Barium	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	60	<b>58</b>	56	55
Manganese	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	1010	<b>951</b>	948	941
Calcium	ppm	ASTM D5185(m)	1070	<b>1004</b>	999	1010
Phosphorus	ppm	ASTM D5185(m)	1150	<b>1017</b>	971	942
Zinc	ppm	ASTM D5185(m)	1270	<b>1142</b>	1136	1138
Sulfur	ppm	ASTM D5185(m)	2060	<b>2575</b>	2564	2503
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>4</b>	3	3
Sodium	ppm	ASTM D5185(m)		<b>2</b>	1	1
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>4.4</b>	4.3	4.1
Sulfation	Abs./1mm	ASTM D7415*	>30	<b>17.4</b>	17.2	17.5

# OIL ANALYSIS REPORT

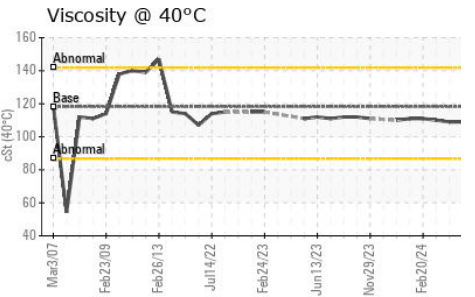
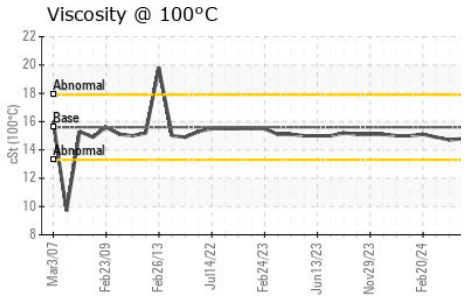
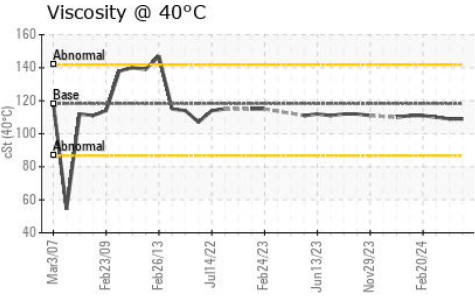
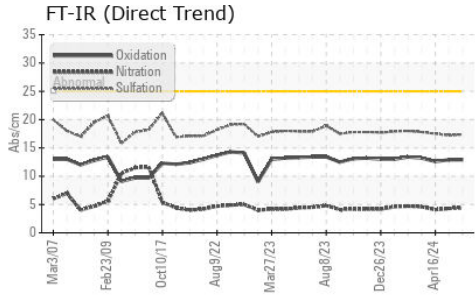


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>12.9</b>	12.9	12.6
Base Number (BN)	mg KOH/g	ASTM D2896*	9.8	<b>9.91</b>	9.67	9.87

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	118.2	<b>109</b>	109	110
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	<b>14.8</b>	14.7	14.9
Viscosity Index (VI)	Scale	ASTM D2270*	139	<b>140</b>	139	140

## GRAPHS

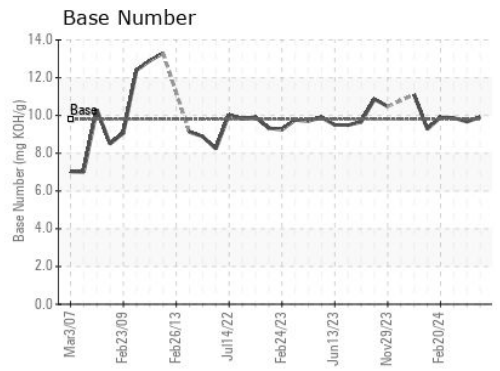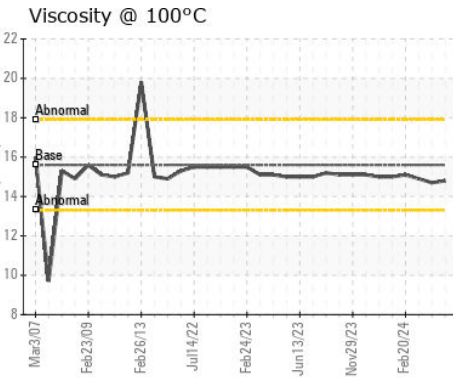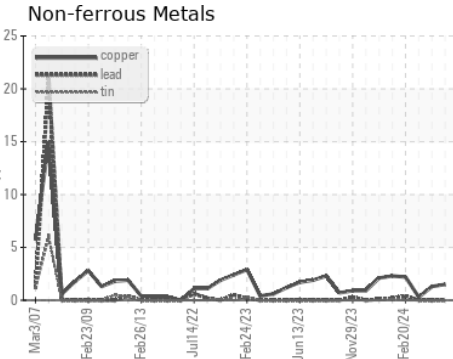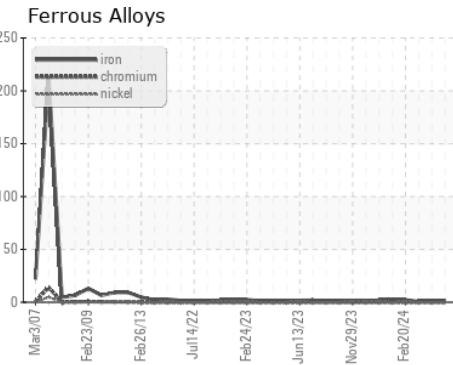

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0057836  
**Lab Number** : **02648618**  
**Unique Number** : 5814170  
**Test Package** : IND 2 ( Additional Tests: KV40, PrtCount, VI )  
**Received** : 18 Jul 2024  
**Tested** : 19 Jul 2024  
**Diagnosed** : 21 Jul 2024 - Kevin Marson

**Vale - Voisey's Bay**  
 Voisey's Bay Mine Site, P.O. Box 7001, Str. C Happy Valley  
 Goose Bay, NL  
 CA A0P 1C0  
 Contact: Robert Feltham  
 robert.feltham@vale.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.