

## **OIL ANALYSIS REPORT**


### Sample Rating Trend

# **NORMAL**

FRICK FRICK 701 (S/N 200636)

Compressor

PETRO CANADA REFLO SYNTHETIC 68A LOW TEMP FLUID (--- GAL)





## DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

·	•	Sep 2020	Feb 2021 Oct2021	Feb2022 Aug2022	Mar2023	
SAMPLE INFOR	MATION	method	limit/base	current	history 1	history 2
Sample Number		Client Info		PCA0092591	PCA0067426	PCA0059750
Sample Date		Client Info		09 Mar 2023	10 Aug 2022	09 Feb 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1	0	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	2
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	0	0	0
Tin	ppm	ASTM D5185m	>15	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	<1	<1
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	4	4
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	23	18	41
CONTAMINAN	TS	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	3	3	4
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.1	0.003		
ppm Water	ppm	ASTM D6304	>1000	31.2		
FLUID DEGRAI	OATION	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.1	0.016		



## **OIL ANALYSIS REPORT**

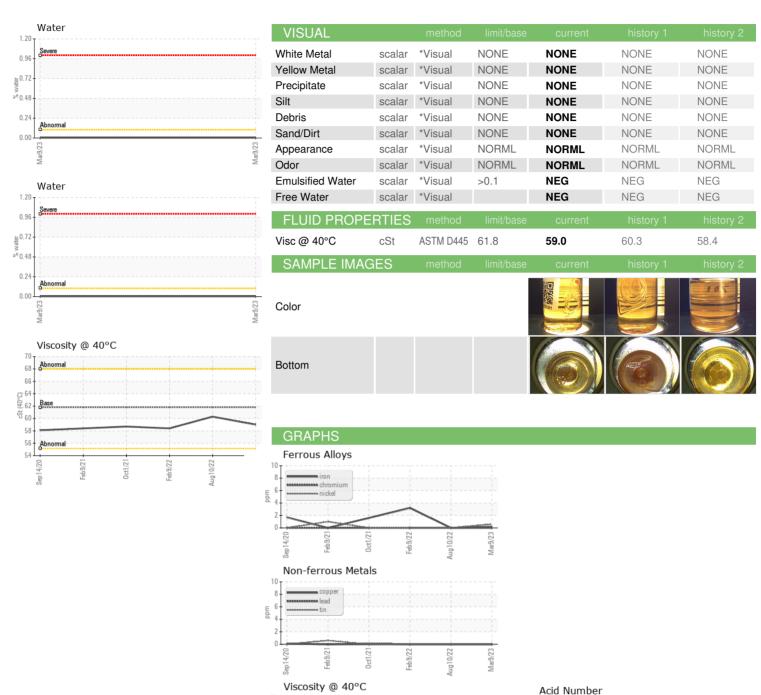





Certificate L2367

Laboratory Sample No.

Lab Number **Unique Number** 

: 05788572 : 10373243

: PCA0092591

Abnormal

65

샹

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 10 Mar 2023

Feb9/22 -

Diagnosed : 13 Mar 2023 Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF)

0ct1/21-

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

(B) 0.15 KOH/Q)

₽0.1

0.09 P 0.00

**SMITHFIELD FOODS** 

ONE SWEET APPLEWOOD LANE CUDAHY, WI

> US 53110 Contact: PETE LERAY

pleray@smithfield.com T: (414)918-3258

Contact/Location: PETE LERAY - SMICUD

F: