

# **OIL ANALYSIS REPORT**

### Sample Rating Trend

# **NORMAL**



# FRICK FRICK 703 (S/N 200638)

Compressor

PETRO CANADA REFLO SYNTHETIC 68A LOW TEMP FLUID (--- GAL)

## DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the


#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

N TEMP FLUID (-	GAL)	Sep2020	Feb2021 Oct202	Feb2022 Aug2022	Mar2023	
SAMPLE INFOR	MATION	method	limit/base	current	history 1	history 2
Sample Number		Client Info		PCA0092592	PCA0067430	PCA0059748
Sample Date		Client Info		09 Mar 2023	10 Aug 2022	08 Feb 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1	0	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	2
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	0	0
Tin	ppm	ASTM D5185m	>15	0	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	<1	<1
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	2	5	4
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	10	0	7
CONTAMINAN	TS	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1	<1	1
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.1	0.002		
ppm Water	ppm	ASTM D6304	>1000	19.2		
FLUID DEGRA	DATION	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.1	0.015		



# **OIL ANALYSIS REPORT**

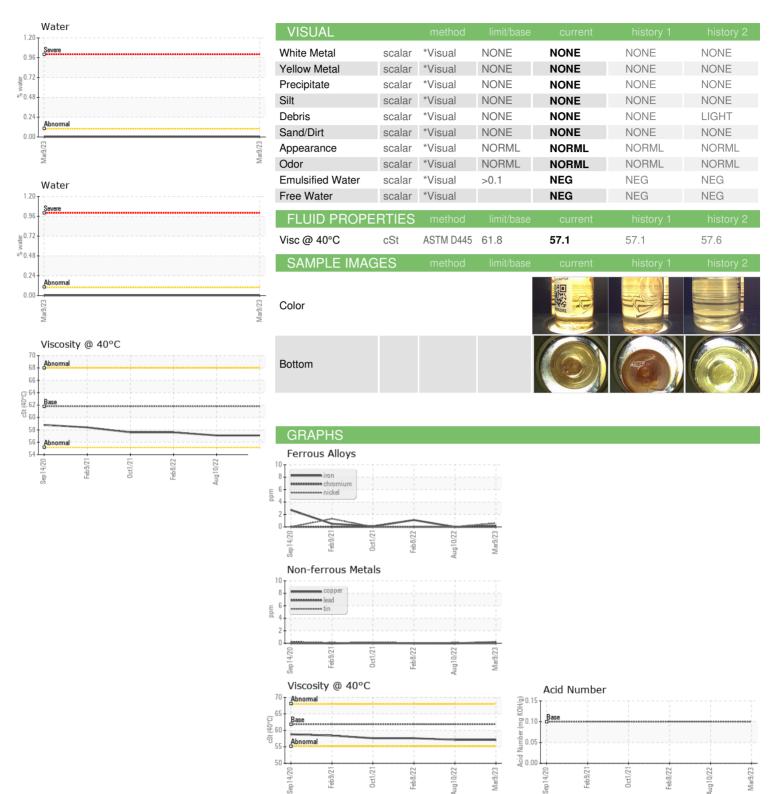





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: PCA0092592 : 05788573

: 10373244

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

Diagnosed Diagnostician Test Package : IND 2 (Additional Tests: KF)

: 13 Mar 2023 : Jonathan Hester

: 10 Mar 2023

ONE SWEET APPLEWOOD LANE

CUDAHY, WI US 53110 Contact: PETE LERAY

pleray@smithfield.com T: (414)918-3258

**SMITHFIELD FOODS** 

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: