


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

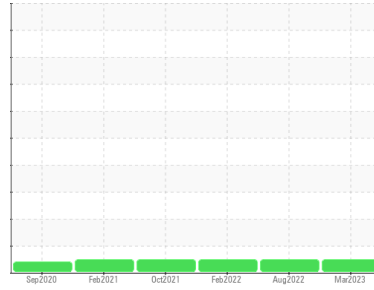

Machine Id  
**VILTER VILTER 6 (S/N 201374)**  
 Component  
**Compressor**  
 Fluid  
**PETRO CANADA REFLO SYNTHETIC 68A LOW TEMP FLUID (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number	Client Info		<b>PCA0092580</b>	PCA0067419	PCA0059746
Sample Date	Client Info		<b>09 Mar 2023</b>	10 Aug 2022	08 Feb 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<b>9</b>	7	6
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	<1	2
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m 0	<b>0</b>	1	<1
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	3	4
Zinc	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>405</b>	47	20




## CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	1	1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.1	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>34.9</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.1	<b>0.028</b>	---	---


# OIL ANALYSIS REPORT

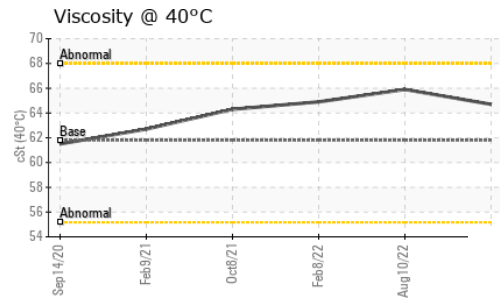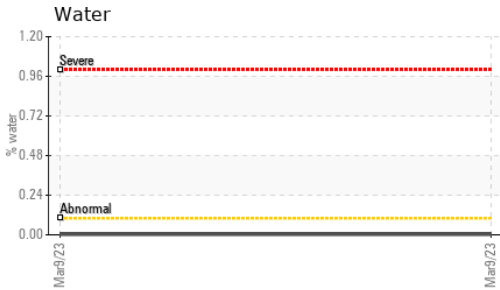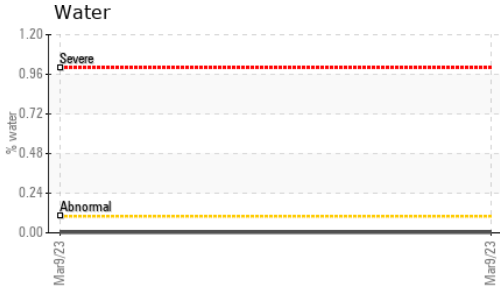





VISUAL	method	limit/base	current	history 1	history 2	
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2	
Visc @ 40°C	cSt	ASTM D445	61.8	<b>64.7</b>	65.9	64.9

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

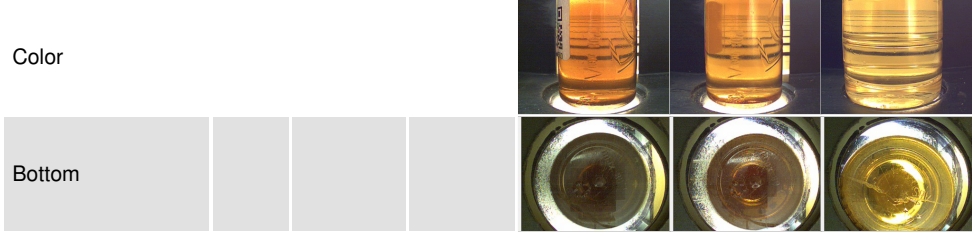

## GRAPHS

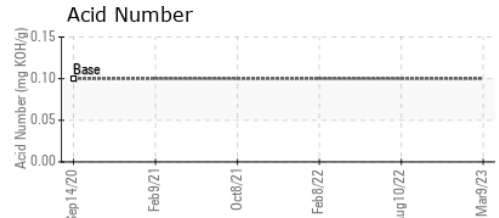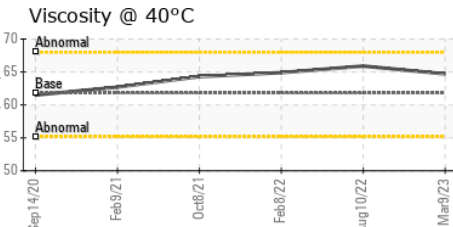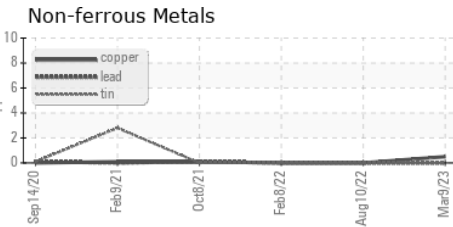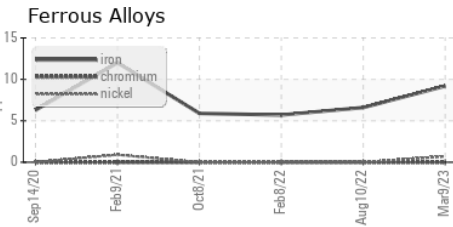

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0092580 **Received** : 10 Mar 2023  
**Lab Number** : **05788577** **Diagnosed** : 13 Mar 2023  
**Unique Number** : 10373248 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF )

**SMITHFIELD FOODS**  
 ONE SWEET APPLEWOOD LANE  
 CUDAHY, WI  
 US 53110  
 Contact: PETE LERAY  
 pleray@smithfield.com  
 T: (414)918-3258

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: