


OIL ANALYSIS REPORT

SAMPLE INFORMATION method

Sample Rating Trend



 \checkmark

NORMAL

Machine Id 810013

Component Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (30 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

		methou	inniv base	Guirent	matory i	TIStoryz
Sample Number		Client Info		GFL0070784	GFL0070781	GFL0049147
Sample Date		Client Info		27 Apr 2023	07 Apr 2023	26 Jan 2023
Machine Age	hrs	Client Info		7234	7110	6466
Oil Age	hrs	Client Info		600	600	600
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5	9	8
Chromium	ppm	ASTM D5185m	>4	0	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	<1	2	1
Lead	ppm	ASTM D5185m	>30	0	0	<1
Copper	ppm	ASTM D5185m	>35	<1	2	2
Tin	ppm	ASTM D5185m	>4	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	34	6	6
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	50	52	45	51
Manganese	ppm	ASTM D5185m	0	<1	<1	<1
Magnesium	ppm	ASTM D5185m	560	618	452	509
Calcium	ppm	ASTM D5185m	1510	1688	1449	1596
Phosphorus	ppm	ASTM D5185m	780	800	565	620
Zinc	ppm	ASTM D5185m	870	1003	781	906
Sulfur	ppm	ASTM D5185m	2040	2753	1904	2434
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	5	4	4
Sodium	ppm	ASTM D5185m		6	8	8
Potassium	ppm	ASTM D5185m	>20	0	0	0
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	7.6	10.9	11.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.4	22.1	22.0
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.7	18.2	18.4
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	7.3	4.2	4.4



OIL ANALYSIS REPORT






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.7	14.8	15.1
GRAPHS						

Ferrous Alloys

3!

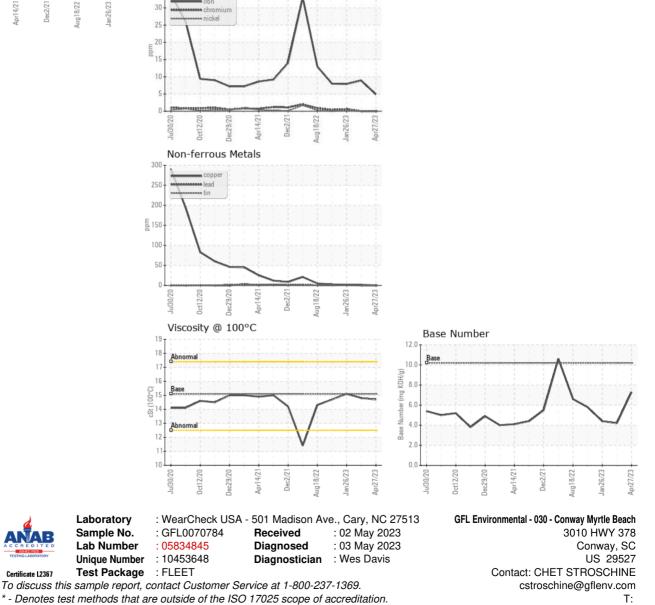

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Ĕ

Submitted By: CHET STROSCHINE

F: