




PROBLEM SUMMARY

Sample Rating Trend

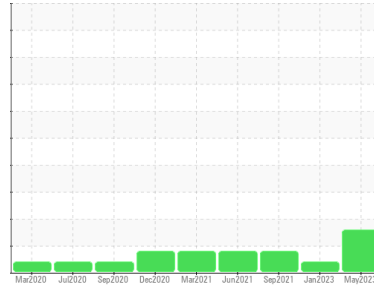

VISCOSITY




Machine Id
RC-3 (S/N 32186)

Component
Reciprocating Compressor


Fluid
CHEVRON REFRIGERATION OIL WF 68 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C

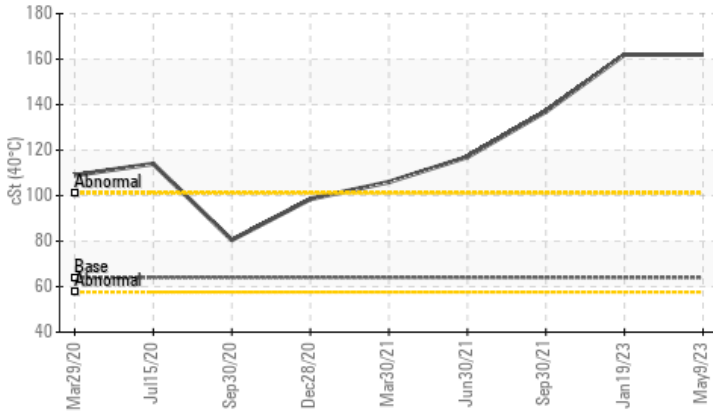

▲ Particle Trend

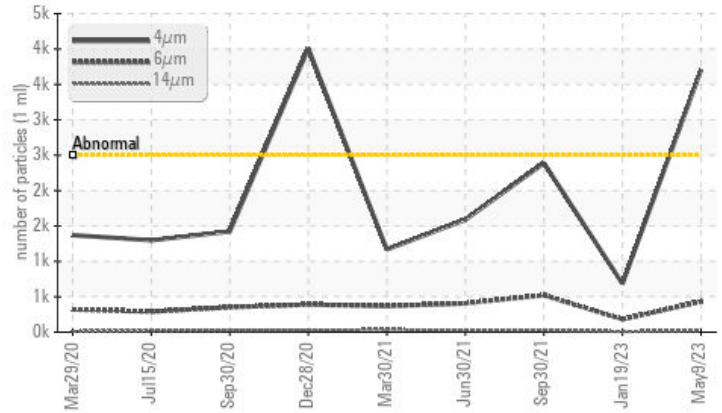

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ATTENTION | ATTENTION | ATTENTION |
|-----------------|--------------|-----------|------------|-----------|------------|
| Particles >4µm | ASTM D7647 | >2500 | ▲ 3703 | 686 | 2387 |
| Particles >6µm | ASTM D7647 | >320 | ▲ 433 | 181 | ▲ 521 |
| Oil Cleanliness | ISO 4406 (c) | >18/15/12 | ▲ 19/16/11 | 17/15/10 | ▲ 18/16/12 |
| Visc @ 40°C | cSt | ASTM D445 | 64.0 | ▲ 162 | ▲ 162 |

Customer Id: KRAWAL
 Sample No.: PCA0095712
 Lab Number: 05853249
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

19 Jan 2023 Diag: Jonathan Hester

VISCOSITY



Resample at the next service interval to monitor. All component wear rates are normal. The water content is negligible. The amount and size of particulates present in the system are acceptable. The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

view report



30 Sep 2021 Diag: Don Baldrige

VISCOSITY



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

view report



30 Jun 2021 Diag: Don Baldrige

VISCOSITY




Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

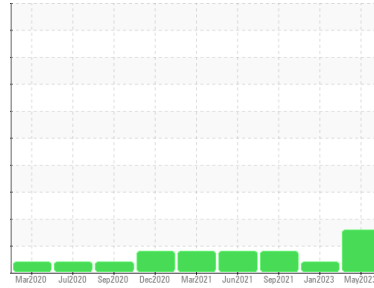

VISCOSITY



Machine Id
RC-3 (S/N 32186)

Component
Reciprocating Compressor

Fluid
CHEVRON REFRIGERATION OIL WF 68 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | PCA0095712 | PCA0088354 | PCA05368546 |
| Sample Date | Client Info | 09 May 2023 | 19 Jan 2023 | 30 Sep 2021 |
| Machine Age | hrs | 43854 | 42569 | 33554 |
| Oil Age | hrs | 11463 | 10179 | 1132 |
| Oil Changed | Client Info | Not Chngd | Not Chngd | N/A |
| Sample Status | | ATTENTION | ATTENTION | ATTENTION |

WEAR METALS

| method | limit/base | current | history1 | history2 | |
|----------|------------|-----------------|------------|----------|----|
| Iron | ppm | ASTM D5185m >50 | 2 | 2 | <1 |
| Chromium | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m >25 | 0 | 0 | 5 |
| Lead | ppm | ASTM D5185m >25 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m >50 | 0 | 0 | <1 |
| Tin | ppm | ASTM D5185m >15 | 0 | 0 | <1 |
| Antimony | ppm | ASTM D5185m | --- | --- | 0 |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 | |
|------------|------------|-------------|------------|----------|-----|
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 11 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 13 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | 13 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | 13 | 4 | 4 |
| Zinc | ppm | ASTM D5185m | 71 | 0 | 0 |
| Sulfur | ppm | ASTM D5185m | 226 | 12 | 264 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 | |
|-----------|------------|------------------|--------------|----------|-------|
| Silicon | ppm | ASTM D5185m >25 | 0 | 0 | 0 |
| Sodium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Potassium | ppm | ASTM D5185m >20 | 0 | 0 | 0 |
| Water | % | ASTM D6304 >0.1 | 0.006 | 0.006 | 0.003 |
| ppm Water | ppm | ASTM D6304 >1000 | 67.0 | 61.3 | 39.9 |

FLUID CLEANLINESS


| method | limit/base | current | history1 | history2 |
|-----------------|------------------------|-------------------|----------|------------|
| Particles >4µm | ASTM D7647 >2500 | ▲ 3703 | 686 | 2387 |
| Particles >6µm | ASTM D7647 >320 | ▲ 433 | 181 | ▲ 521 |
| Particles >14µm | ASTM D7647 >40 | 20 | 8 | 27 |
| Particles >21µm | ASTM D7647 >10 | 3 | 3 | 6 |
| Particles >38µm | ASTM D7647 >3 | 0 | 0 | 0 |
| Particles >71µm | ASTM D7647 >3 | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) >18/15/12 | ▲ 19/16/11 | 17/15/10 | ▲ 18/16/12 |

FLUID DEGRADATION


| method | limit/base | current | history1 | history2 | |
|------------------|------------|------------|--------------|----------|-------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.014 | 0.015 | 0.015 |

OIL ANALYSIS REPORT


▲ Particle Trend

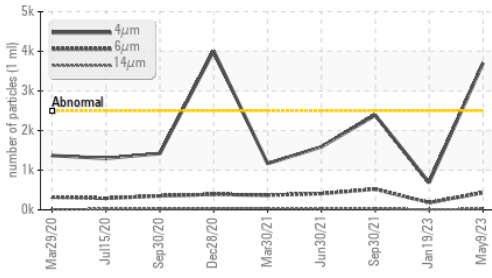


Water

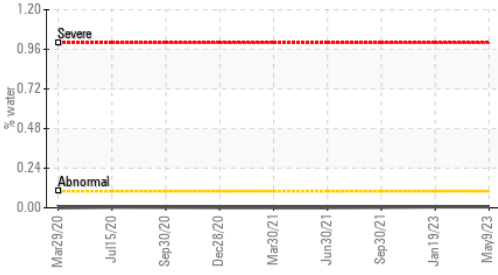


▲ Particle Trend

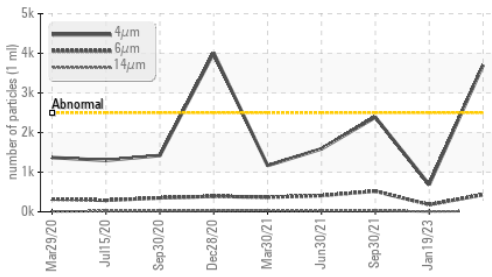

Acid Number

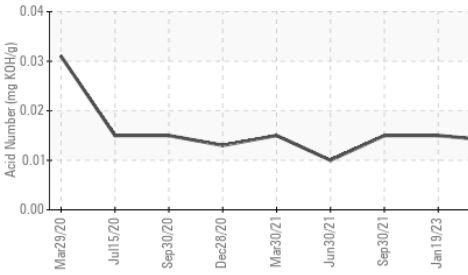

Water

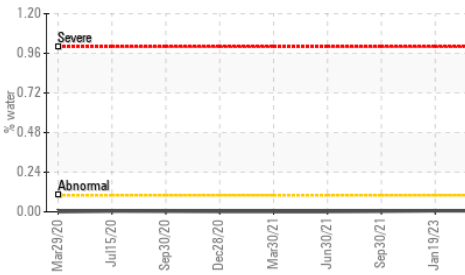


| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 64.0 ▲ 162 | ▲ 162 | ▲ 137 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

Color

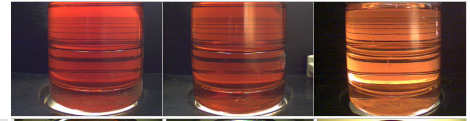


Bottom




GRAPHS


Ferrous Alloys

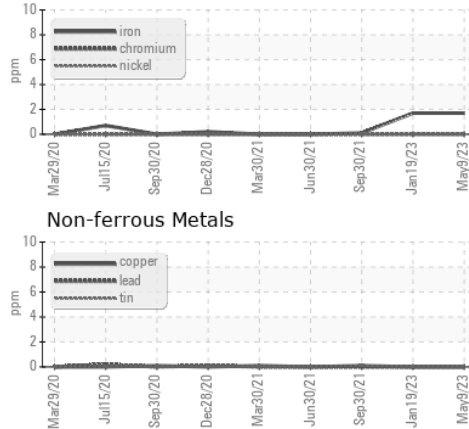


Non-ferrous Metals

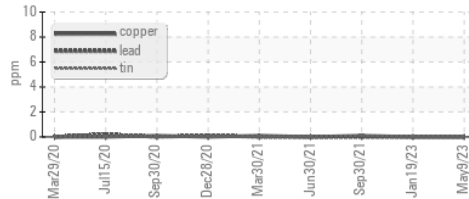


▲ Viscosity @ 40°C

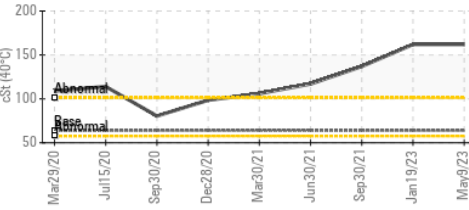

▲ Particle Count

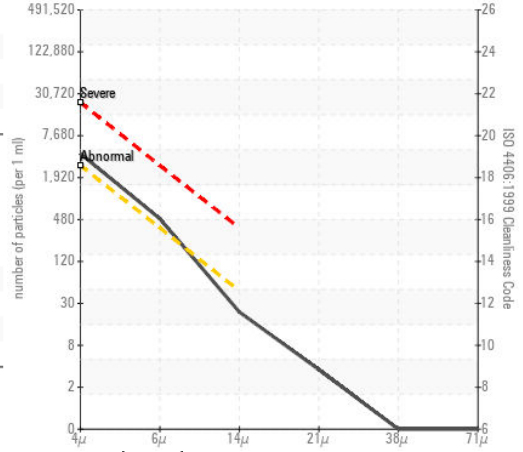

Acid Number

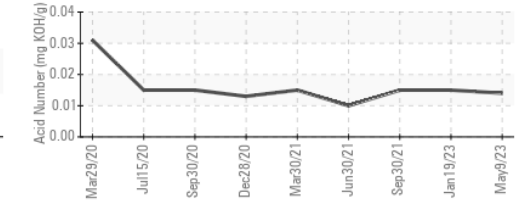

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0095712 **Received** : 22 May 2023
Lab Number : 05853249 **Diagnosed** : 24 May 2023
Unique Number : 10482604 **Diagnostician** : Jonathan Hester

KraftHeinz - Walton - Plant UNK
 261 Delaware St.
 Walton, NY
 US 13856

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Contact: Cindy Scofield
 cindy.scofield@kraft.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

T: (607)865-2330

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

F: (607)865-8863

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)