


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

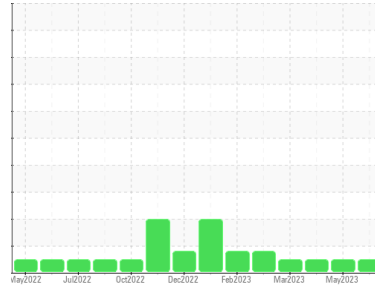

Machine Id  
**M3 (S/N 1457409)**

Component  
**Biogas Engine**

Fluid  
**PETRO CANADA SENTRON LD 8000 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history 1	history 2	
Sample Number	Client Info	<b>PCA0096492</b>	PCA0096482	PCA0096486	
Sample Date	Client Info	<b>08 Jun 2023</b>	13 May 2023	10 May 2023	
Machine Age	hrs	Client Info	<b>6329</b>	5826	5325
Oil Age	hrs	Client Info	<b>1903</b>	1400	899
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

## CONTAMINATION

method	limit/base	current	history 1	history 2
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history 1	history 2	
Iron	ppm	ASTM D5185m >45	<b>2</b>	2	2
Chromium	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>3</b>	1	6
Lead	ppm	ASTM D5185m >5	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >14	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m >13	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history 1	history 2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	1	1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>12</b>	12	12
Calcium	ppm	ASTM D5185m 1351	<b>1637</b>	1548	1489
Phosphorus	ppm	ASTM D5185m 302	<b>299</b>	286	283
Zinc	ppm	ASTM D5185m 358	<b>377</b>	376	360
Sulfur	ppm	ASTM D5185m 2758	<b>3442</b>	3422	3519

## CONTAMINANTS

method	limit/base	current	history 1	history 2	
Silicon	ppm	ASTM D5185m >200	<b>1</b>	2	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	2	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	1
Fuel	%	ASTM D3524 >4.0	<b>0.3</b>	0.3	0.3





## INFRA-RED

method	limit/base	current	history 1	history 2	
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>5.8</b>	6.3	5.1
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>19.7</b>	18.4	18.1

## FLUID DEGRADATION

method	limit/base	current	history 1	history 2	
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>14.9</b>	12.4	12.0
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	<b>1.20</b>	0.83	0.68
Base Number (BN)	mg KOH/g	ASTM D2896 4.64	<b>3.66</b>	5.06	4.06









# OIL ANALYSIS REPORT

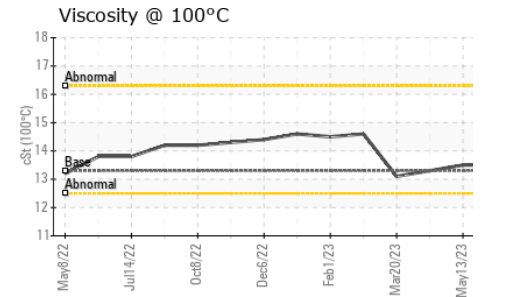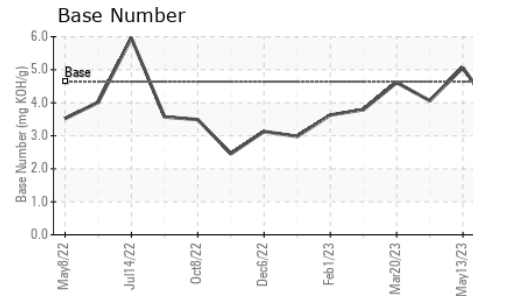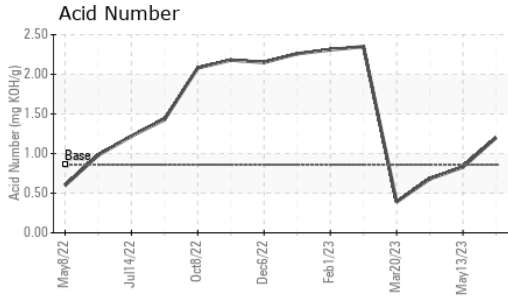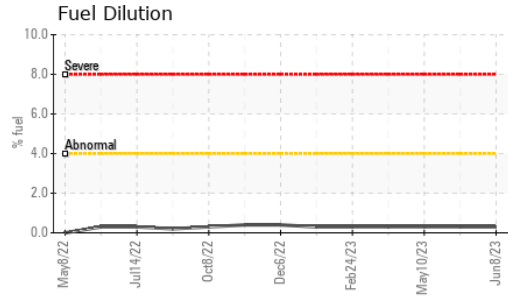

PARAMETER	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 100°C	cSt	ASTM D445	13.3	13.5	13.3

## GRAPHS

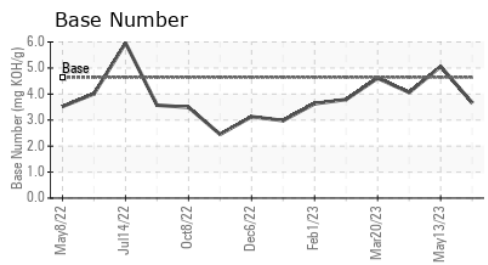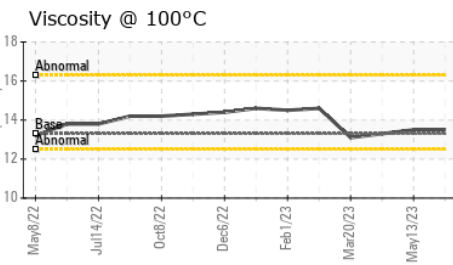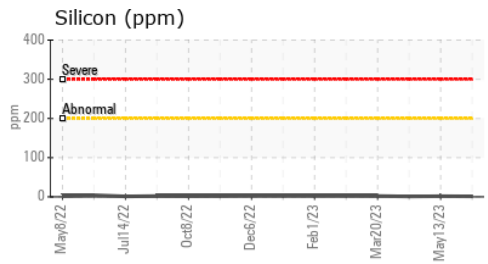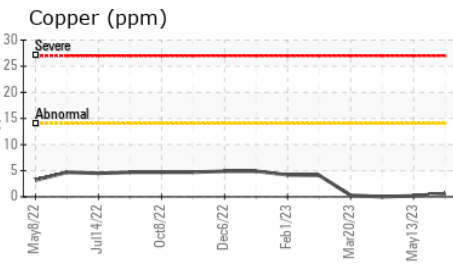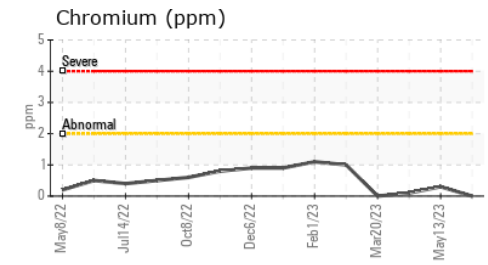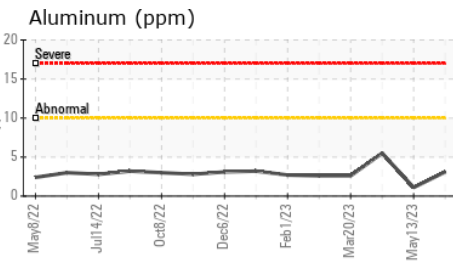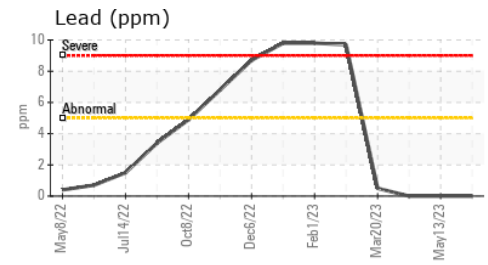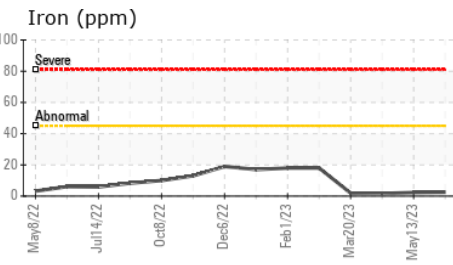

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0096492 **Received** : 21 Jun 2023  
**Lab Number** : 05880295 **Diagnosed** : 24 Jun 2023  
**Unique Number** : 10525398 **Diagnostician** : Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**AMERICAN PETROLEUM**  
 CARR 865 KM 0.2 CAMPANILA  
 TOA BAJA, PR  
 US 00949  
 Contact: NEFTALI ORTIZ  
 nortiz@americanpetroleumpr.com  
 T: (787)794-1985

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: