



COOLANT REPORT

Sample Rating Trend

NORMAL



Machine Id
827079
 Component
Coolant
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.



SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number	Client Info		GFL0084848	---	---
Sample Date	Client Info		19 Jun 2023	---	---
Machine Age	hrs	Client Info	14833	---	---
Oil Age	hrs	Client Info	14833	---	---
Oil Changed		Client Info	Not Chngd	---	---
Sample Status			NORMAL	---	---

PHYSICAL TEST RESULTS









	method	limit/base	current	history 1	history 2
Specific Gravity	*ASTM D1298		1.065	---	---
pH	Scale 0-14 ASTM D1287		7.78	---	---
Nitrites	ppm AP-053:2009		1500	---	---
Reserve Alkalinity	Scale 0-20 *ASTM D1121		---	---	---
Percentage Glycol	% ASTM D3321		48.2	---	---
Freezing Point	°F ASTM D3321		-31	---	---
Total Dissolved Solids			379.0	---	---
Carboxylate			pass	---	---

VISUAL

	method	limit/base	current	history 1	history 2
Coolant Color	*Visual		LtRed	---	---
Coolant Appearance	*Visual	Clear	normal	---	---
Color				no image	no image
Bottom				no image	no image



COOLANT REPORT

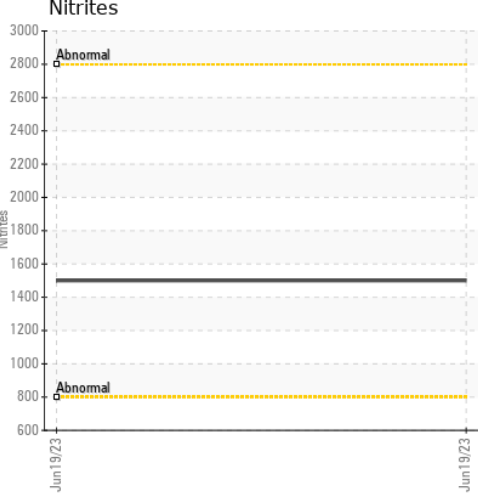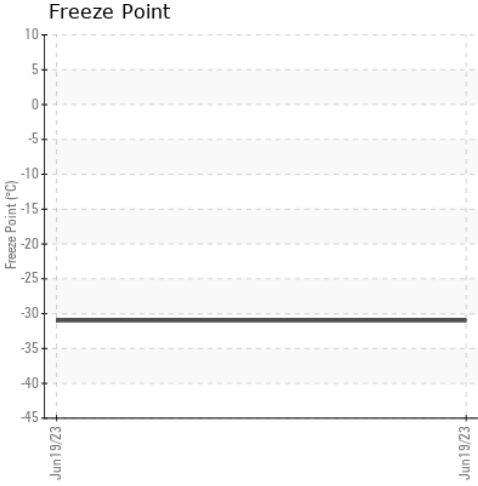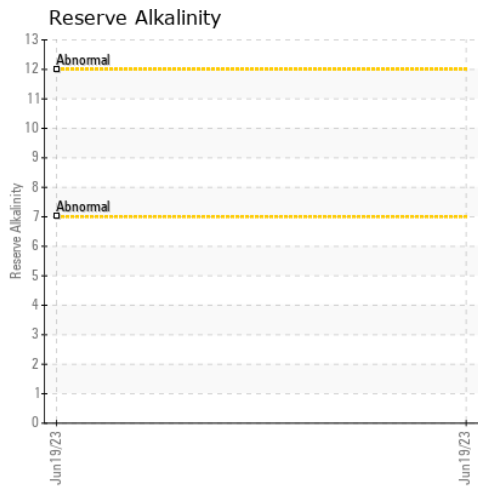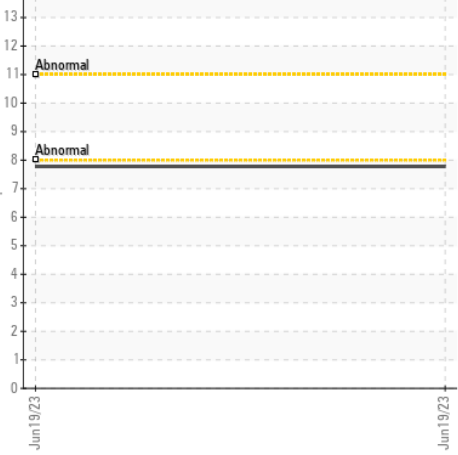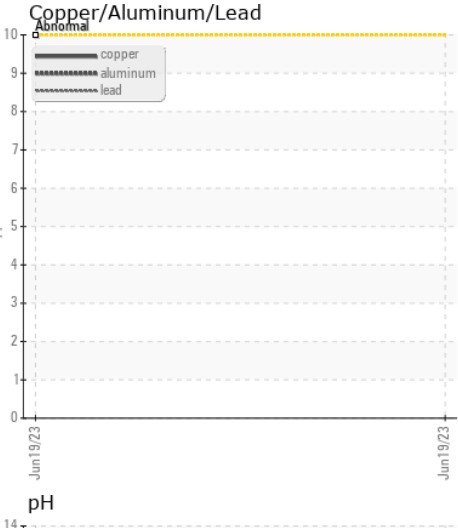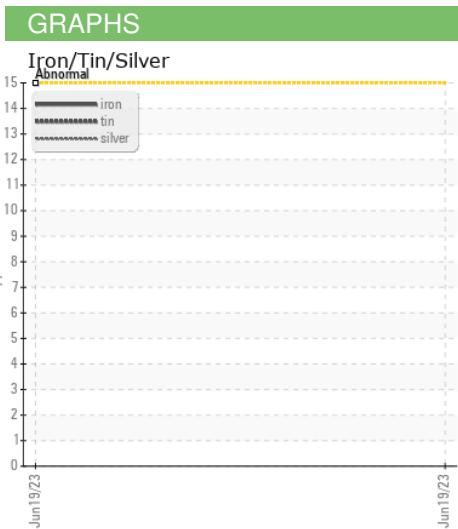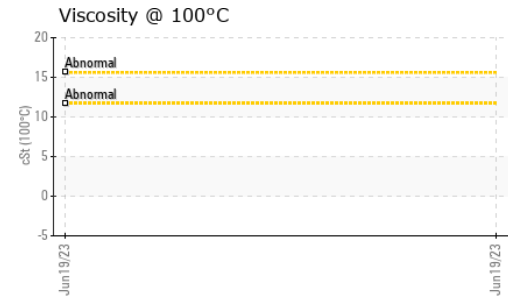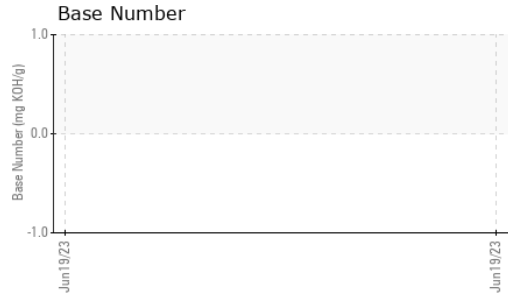

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0084848 **Received** : 23 Jun 2023
Lab Number : 05882838 **Diagnosed** : 05 Jul 2023
Unique Number : 10533321 **Diagnostician** : Doug Bogart
Test Package : COOL- (Additional Tests: COOL, FT-IR, ICP, KF, KV100, SCREEN, TBN)

4808 cunningham Rd
 Urbana, IL
 UM 61802
 Contact: Kristine Tyrone
 ktyrone@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: