


## **OIL ANALYSIS REPORT**

#### Sample Rating Trend





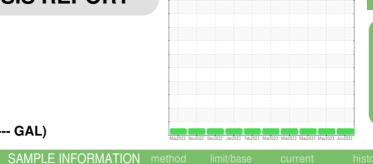

Machine Id 731118 Component

Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (--- GAL)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.


### Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

		methou	iiiiii/base	current	TIIStOLA	Thistory Z
Sample Number		Client Info		GFL0083758	GFL0083782	GFL0070385
Sample Date		Client Info		27 Jun 2023	29 May 2023	01 May 2023
Machine Age	hrs	Client Info		4993	4812	4652
Oil Age	hrs	Client Info		0	0	1200
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	6	6	11
Chromium	ppm	ASTM D5185m	>4	0	<1	1
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m	>3	0	<1	0
Aluminum	ppm	ASTM D5185m	>9	<1	2	0
Lead	ppm	ASTM D5185m	>30	<1	2	2
Copper	ppm	ASTM D5185m	>35	<1	0	1
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	50	27	31	9
Barium	ppm	ASTM D5185m	5	14	0	0
Molybdenum	ppm	ASTM D5185m	50	52	54	54
Manganese	ppm	ASTM D5185m	0	<1	<1	<1
Magnesium	ppm	ASTM D5185m	560	574	611	510
Calcium	ppm	ASTM D5185m	1510	1562	1633	1538
Phosphorus	ppm	ASTM D5185m	780	765	809	648
Zinc	ppm	ASTM D5185m	870	962	997	921
Sulfur	ppm	ASTM D5185m	2040	2928	2852	2391
CONTAMINAN	TS	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>+100	4	5	4
Sodium	ppm	ASTM D5185m		4	6	5
Potassium	ppm	ASTM D5185m	>20	<1	2	2
INFRA-RED		method	limit/base	current	history 1	history 2
Soot %	%	*ASTM D7844		0.1	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	8.7	8.0	10.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.3	19.4	19.7
FLUID DEGRA		method	limit/base	current	history 1	history 2
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.6	16.0	16.9
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	7.3	7.9	4.0
		22000				




# **OIL ANALYSIS REPORT**





VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history 1	history 2
Visc @ 100°C	cSt	ASTM D445	15.1	14.3	14.6	14.6
GRAPHS						

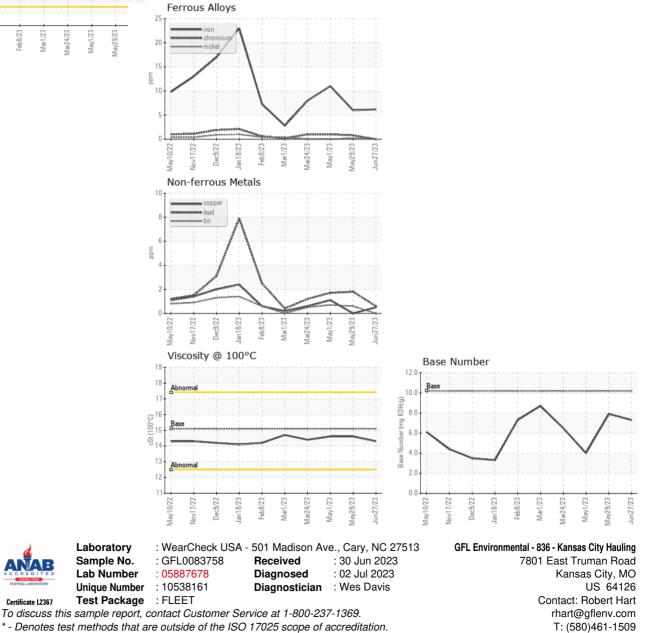

## \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: See also GFL823, 834, 837, 840 - Robert Hart - GFL836

F: