

# **OIL ANALYSIS REPORT**

Sample Rating Trend

NORMAL

Machine Id 21008-TM-15 Component

Gearbox

PETRO CANADA ENDURATEX EP 220 (---

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

#### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


GAL)				May2023		
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0095460		
Sample Date		Client Info		23 May 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METAL	.S	method	limit/base	current	history1	history2
PQ		ASTM D8184		18		
ron	ppm	ASTM D5185m	>200	10		
Chromium	ppm	ASTM D5185m	>15	0		
Nickel	ppm	ASTM D5185m	>15	0		
Гitanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
_ead	ppm	ASTM D5185m	>100	<1		
Copper	ppm	ASTM D5185m	>200	<1		
Fin	ppm	ASTM D5185m	>25	0		
/anadium	ppm	ASTM D5185m	,	<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	60	2		
Barium	ppm	ASTM D5185m	0	0		
Molybdenum		ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0	<1		
Magnesium	ppm	ASTM D5185m	0	2		
Calcium	ppm	ASTM D5185m	0	4		
	ppm		270	373		
Phosphorus Zinc	ppm	ASTM D5185m	0			
zinc Sulfur	ppm	ASTM D5185m		17 19300		
	ppm	ASTM D5185m	11200			
CONTAMINAN	IIS	method	limit/base		history1	history2
Silicon	ppm	ASTM D5185m		13		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.40	1.02		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
ellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.2	NEG		
Troc Motor	ooole:	*\/iool	-	NEC	contion: PDAD	ELLIC COITE

ocation: BRAD ELLIS - SDITER

NEG



## **OIL ANALYSIS REPORT**

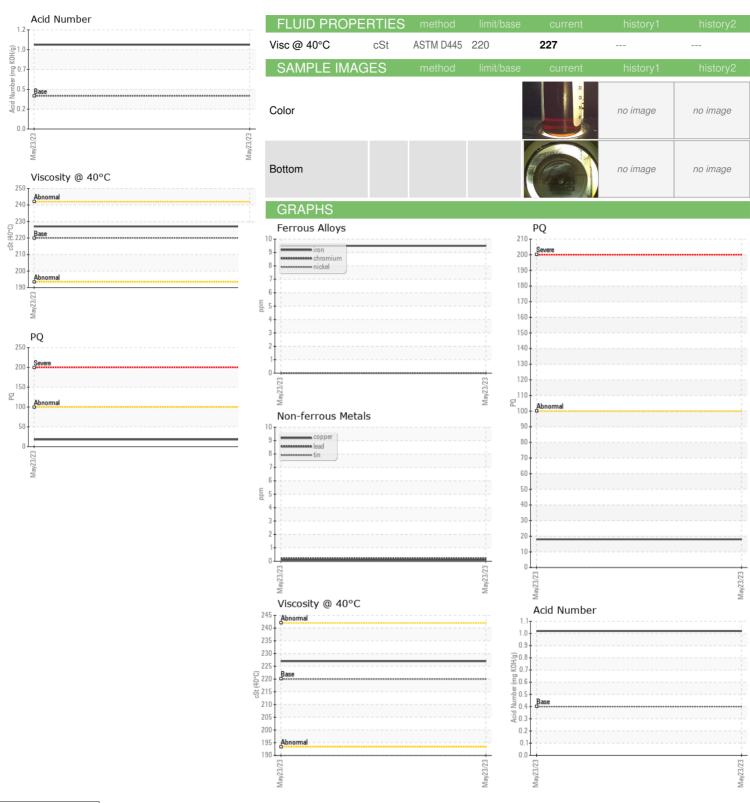



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: PCA0095460 : 05894564 : 10550374 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 10 Jul 2023 Diagnosed : 13 Jul 2023

Diagnostician : Wes Davis

SDI - Steel DynamicsInc. - Heartland 455 West Industrial Drive Terre Haute, IN

US 47802 Contact: BRAD ELLIS brad.ellis@steeldynamics.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: