


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

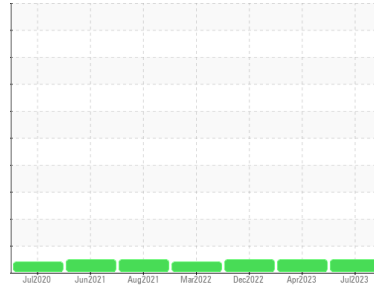

Area  
**Process Cheese [98316341]**  
 Machine Id  
**NORTH GRINDER MOTOR**  
 Component  
**Top Thrust Bearing**  
 Fluid  
**ISO 100 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0100124</b>	PCA0088302	PCA0076151
Sample Date	Client Info	<b>08 Jul 2023</b>	02 Apr 2023	10 Dec 2022
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>Changed</b>	Changed	Changed
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >85	<b>1</b>	<1	<1
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >40	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >60	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >7	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >40	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>3</b>	1	2
Calcium	ppm	ASTM D5185m	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m	<b>670</b>	548	395
Zinc	ppm	ASTM D5185m	<b>0</b>	3	0
Sulfur	ppm	ASTM D5185m	<b>2014</b>	1416	924

### CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >20	<b>5</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	<1

### FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	<b>675</b>	808	333
Particles >6µm	ASTM D7647 >320	<b>90</b>	113	44
Particles >14µm	ASTM D7647 >80	<b>8</b>	11	4
Particles >21µm	ASTM D7647 >20	<b>3</b>	2	1
Particles >38µm	ASTM D7647 >4	<b>0</b>	0	0
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >17/15/13	<b>17/14/10</b>	17/14/11	16/13/9

### FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.31</b>	0.32	0.39

# OIL ANALYSIS REPORT


Particle Trend

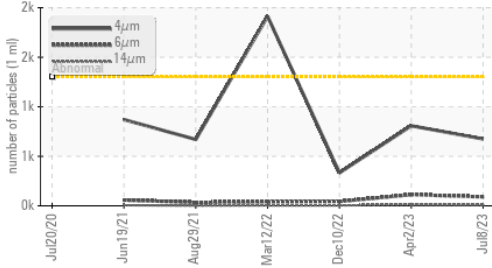


Acid Number

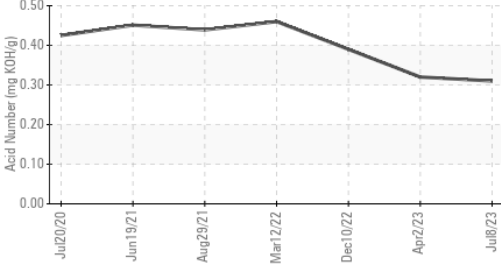

Viscosity @ 40°C

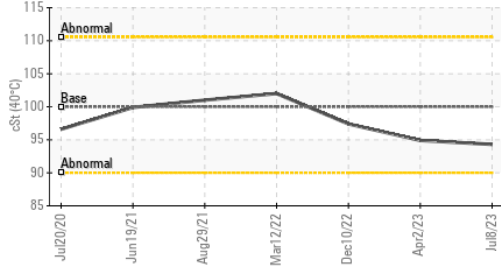

Particle Trend

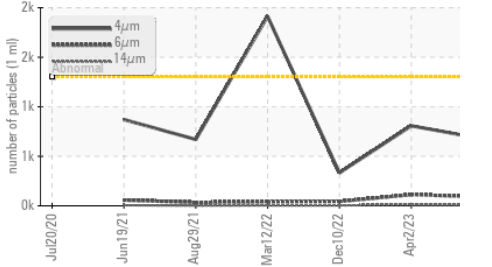


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 100	94.3	94.9	97.4

PARAMETER	method	limit/base	current	history1	history2
-----------	--------	------------	---------	----------	----------

Color

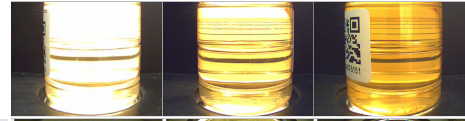

Bottom




PrtFilter




## GRAPHS


Ferrous Alloys

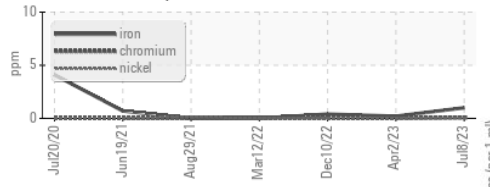


Non-ferrous Metals

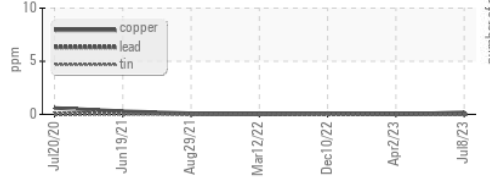


Viscosity @ 40°C

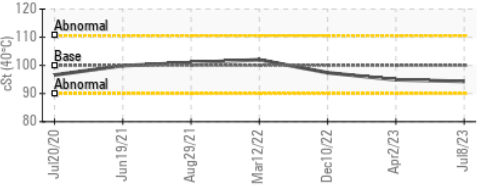

Particle Count

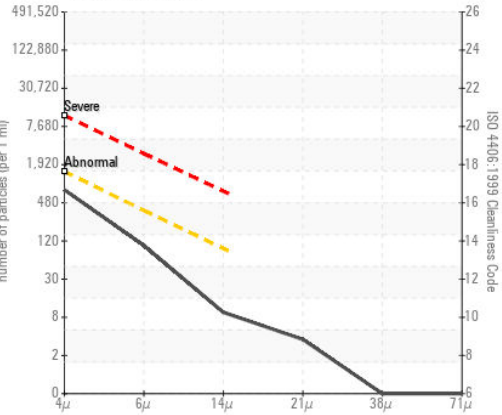

Acid Number

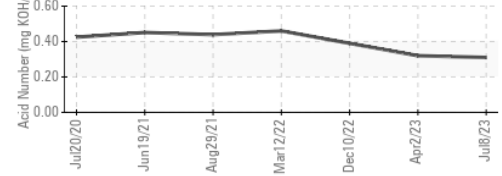

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0100124 **Received** : 14 Jul 2023  
**Lab Number** : 05898560 **Diagnosed** : 17 Jul 2023  
**Unique Number** : 10559916 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: FilterPatch, PrtCount )

**KraftHeinz - Springfield - Plant 8311 PCA**  
 2035 E BENNETT  
 SPRINGFIELD, MO  
 US 65804  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: