

### **OIL ANALYSIS REPORT**

Sample Rating Trend

NORMAL

# Machine Id 911020-1379

#### Component Diesel Engine

Fluid PETRO CANADA DURON SHP 15W40 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.


#### Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0083968	GFL0078713	GFL0071413
Sample Date		Client Info		11 Jul 2023	20 Apr 2023	02 Feb 2023
Machine Age	hrs	Client Info		8002	7342	6765
Oil Age	hrs	Client Info		660	577	970
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Glycol		WC Method		NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	16	15	13
Chromium	ppm	ASTM D5185m	>20	<1	<1	<1
Nickel	ppm	ASTM D5185m	>4	<1	0	<1
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	<1	4
Lead	ppm	ASTM D5185m	>40	0	0	<1
Copper	ppm	ASTM D5185m	>330	0	0	<1
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES			12 . 14 /1			biotom (O
		method				history2
Boron	ppm	ASTM D5185m	limit/base	4	history1 5	2
	ppm ppm					
Boron		ASTM D5185m	0	4	5	2
Boron Barium	ppm	ASTM D5185m ASTM D5185m	0 0 60	4 0	5 0	2 0
Boron Barium Molybdenum	ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60	4 0 70	5 0 59	2 0 59
Boron Barium Molybdenum Manganese	ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0	4 0 70 <1	5 0 59 <1	2 0 59 <1
Boron Barium Molybdenum Manganese Magnesium	ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010	4 0 70 <1 1035	5 0 59 <1 913	2 0 59 <1 880
Boron Barium Molybdenum Manganese Magnesium Calcium	ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070	4 0 70 <1 1035 1188	5 0 59 <1 913 1045	2 0 59 <1 880 997
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus	ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070 1150	4 0 70 <1 1035 1188 1111	5 0 59 <1 913 1045 943	2 0 59 <1 880 997 930
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc	ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070 1150 1270	4 0 70 <1 1035 1188 1111 1378	5 0 59 <1 913 1045 943 1196	2 0 59 <1 880 997 930 1160
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur	ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070 1150 1270 2060	4 0 70 <1 1035 1188 1111 1378 3792	5 0 59 <1 913 1045 943 1196 3014	2 0 59 <1 880 997 930 1160 3158
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN	ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 1010 1070 1150 1270 2060	4 0 70 <1 1035 1188 1111 1378 3792 current	5 0 59 <1 913 1045 943 1196 3014 history1	2 0 59 <1 880 997 930 1160 3158 history2
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon	ppm ppm ppm ppm ppm ppm ppm ppm TS	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 1010 1070 1150 1270 2060	4 0 70 <1 1035 1188 1111 1378 3792 current 3	5 0 59 <1 913 1045 943 1196 3014 history1 2	2 0 59 <1 880 997 930 1160 3158 history2 4
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium	ppm ppm ppm ppm ppm ppm ppm ppm TS	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m <b>method</b> ASTM D5185m	0 0 60 0 1010 1070 1150 1270 2060 Limit/base >25	4 0 70 <1 1035 1188 1111 1378 3792 current 3 4 6	5 0 59 <1 913 1045 943 1196 3014 history1 2 4	2 0 59 <1 880 997 930 1160 3158 history2 4 4
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium	ppm ppm ppm ppm ppm ppm ppm ppm TS	ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070 1150 1270 2060 <b>limit/base</b> >25 >20	4 0 70 <1 1035 1188 1111 1378 3792 current 3 4 6 Current	5 0 59 <1 913 1045 943 1196 3014 <b>history1</b> 2 4 0	2 0 59 <1 880 997 930 1160 3158 history2 4 4 4 2 history2
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot %	ppm ppm ppm ppm ppm ppm ppm ppm TS ppm ppm	ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070 1150 1270 2060 limit/base >25 >20 limit/base >20	4 0 70 <1 1035 1188 1111 1378 3792 <u>current</u> 3 4 6 <u>current</u> 1.4	5 0 59 <1 913 1045 943 1196 3014 history1 2 4 0 history1 1.4	2 0 59 <1 880 997 930 1160 3158 history2 4 4 4 2 <u>history2</u> 1.1
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 <b>limit/base</b> >25	4 0 70 <1 1035 1188 1111 1378 3792 current 3 4 6 Current	5 0 59 <1 913 1045 943 1196 3014 <u>history1</u> 2 4 0 0 <u>history1</u>	2 0 59 <1 880 997 930 1160 3158 history2 4 4 4 2 history2
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 <i>limit/base</i> >25 >20 <i>limit/base</i> >3 >20	4 0 70 <1 1035 1188 1111 1378 3792 current 3 4 6 current 1.4 9.7	5 0 59 <1 913 1045 943 1196 3014 history1 2 4 0 history1 1.4 8.8	2 0 59 <1 880 997 930 1160 3158 history2 4 4 2 history2 1.1 8.1
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 2060 225 20 225 20 20 3 20 3 20 3 20 20 20 20 20 20 20 20 20 20 20 20 20	4 0 70 <1 1035 1188 1111 1378 3792 current 3 4 6 current 1.4 9.7 21.9	5 0 59 <1 913 1045 943 1196 3014 history1 2 4 0 <u>history1</u> 1.4 8.8 20.9	2 0 59 <1 880 997 930 1160 3158 history2 4 4 2 <u>history2</u> 1.1 8.1 20.3
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation	ppm ppm ppm ppm ppm ppm ppm ppm TS ppm ppm ppm ppm	ASTM D5185m ASTM D7844 *ASTM D7844	0 0 0 1010 1070 1150 1270 2060 2060 225 20 220 220 20 3 20 20 20 3 3 20 20 20 20 20 20 20 20 20 20 20 20 20	4 0 70 <1 1035 1188 1111 1378 3792 <i>current</i> 3 4 6 <i>current</i> 1.4 9.7 21.9 <i>current</i>	5 0 59 <1 913 1045 943 1196 3014 <b>history1</b> 2 4 0 <b>history1</b> 1.4 8.8 20.9 <b>history1</b>	2 0 59 <1 880 997 930 1160 3158 history2 4 4 2 history2 1.1 8.1 20.3 history2




## **OIL ANALYSIS REPORT**





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.4	13.7	13.0	13.1
GRAPHS						

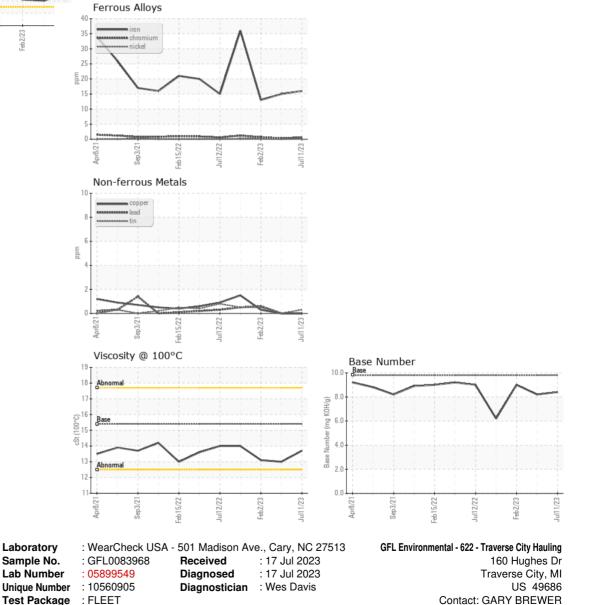

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Submitted By: TECHNICIAN ACCOUNT