

OIL ANALYSIS REPORT

SAMPLE INFO Sample Number

Sample Date

Machine Age

Sample Status

CONTAMINA

WEAR META

ADDITIVES

Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc

Oil Age Oil Changed

Fuel

Iron Chromium Nickel Titanium Silver Aluminum Lead Copper Tin Vanadium Cadmium

Glycol

Sample Rating Trend

NORMAL

Machine Id 10588

Component

Diesel Engine

PETRO CANADA DURON SHP 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| | c2015 Feb20 | 17 Feb2018 Oct2018 | May2019 Jan2020 Sep2020 N | Tar2023 | |
|---------|-------------|--------------------|---------------------------|-------------|-------------|
| RMATION | method | limit/base | current | history1 | history2 |
| | Client Info | | GFL0086303 | GFL0081487 | GFL0081503 |
| | Client Info | | 07 Jul 2023 | 03 Jun 2023 | 25 Apr 2023 |
| hrs | Client Info | | 16413 | 16124 | 15914 |
| hrs | Client Info | | 0 | 0 | 15914 |
| | Client Info | | Not Changd | Not Changd | Not Changd |
| | | | NORMAL | NORMAL | NORMAL |
| TION | method | limit/base | current | history1 | history2 |
| | WC Method | >5 | <1.0 | <1.0 | <1.0 |
| | WC Method | | NEG | NEG | NEG |
| ALS | method | limit/base | current | history1 | history2 |
| ppm | ASTM D5185m | >100 | 10 | 26 | 14 |
| ppm | ASTM D5185m | >20 | <1 | 2 | 1 |
| ppm | ASTM D5185m | >4 | <1 | <1 | <1 |
| ppm | ASTM D5185m | | 0 | 0 | 0 |
| ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| ppm | ASTM D5185m | >20 | 3 | 5 | 0 |
| ppm | ASTM D5185m | >40 | 0 | 0 | 0 |
| ppm | ASTM D5185m | >330 | <1 | 2 | <1 |
| ppm | ASTM D5185m | >15 | 0 | <1 | 0 |
| ppm | ASTM D5185m | | 0 | 0 | 0 |
| ppm | ASTM D5185m | | 0 | 0 | 0 |
| | method | limit/base | current | history1 | history2 |
| ppm | ASTM D5185m | 0 | 2 | 5 | 7 |
| ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| ppm | ASTM D5185m | 60 | 58 | 64 | 61 |
| ppm | ASTM D5185m | 0 | <1 | <1 | <1 |
| ppm | ASTM D5185m | 1010 | 857 | 1030 | 915 |
| ppm | ASTM D5185m | 1070 | 1004 | 1138 | 1037 |
| ppm | ASTM D5185m | 1150 | 953 | 1052 | 997 |

| Sulfur | ppm | ASTM D5185m | 2060 | 3030 | 3646 | 3070 |
|--------------|-----|-------------|------------|---------|----------|----------|
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 4 | 8 | 5 |
| Sodium | ppm | ASTM D5185m | | 2 | 5 | 14 |
| Potassium | ppm | ASTM D5185m | >20 | 1 | 1 | 2 |

1154

ppm ASTM D5185m 1270


| INFRA-RED | | method | limit/base | current | history1 | history2 |
|------------------|----------|-------------|------------|---------|----------|----------|
| Soot % | % | *ASTM D7844 | >3 | 0.3 | 0.5 | 0.2 |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 6.7 | 8.3 | 5.7 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 18.0 | 19.9 | 16.3 |
| FLUID DEGRAD | ATION | method | limit/base | current | history1 | history2 |
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 14.0 | 17.0 | 12.9 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | 9.8 | 8.9 | 8.1 | 8.0 |


1359

1234




OIL ANALYSIS REPORT





| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|-----------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |
| FLUID PROPE | RTIES | method | limit/base | current | history1 | history2 |
| Visc @ 100°C | cSt | ASTM D445 | 15.4 | 13.6 | 14.2 | 14.1 |
| GRAPHS | | | | | | |
| Ferrous Alloys | | | | | | |

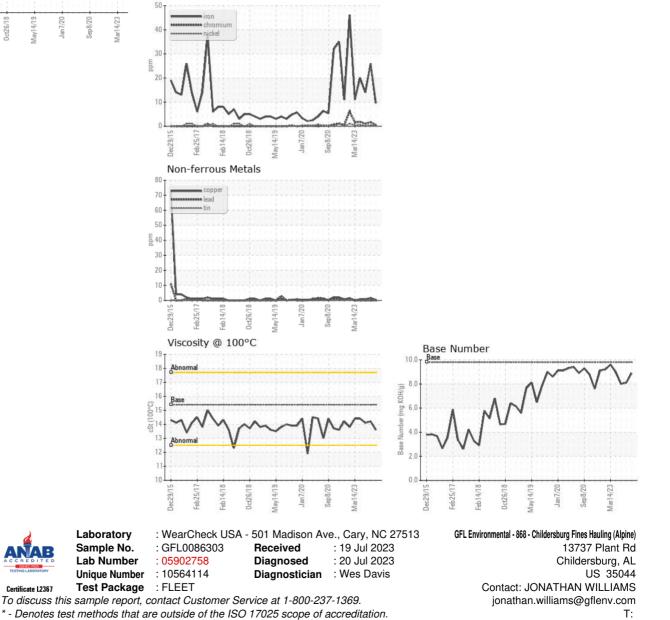

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Submitted By: see also GFL868 - Chelsea Bryan

F: