


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

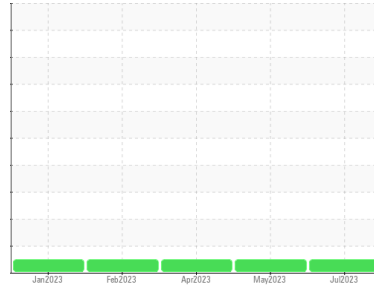

Area  
**(33694Z) Walgreens**  
 Machine Id  
**[Walgreens] 136A62594**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON SHP 10W30 (11 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>PCA0100260</b>	PCA0094707	PCA0094649	
Sample Date	Client Info	<b>17 Jul 2023</b>	24 May 2023	06 Apr 2023	
Machine Age	mls	Client Info	<b>380631</b>	350791	321117
Oil Age	mls	Client Info	<b>29840</b>	56709	27038
Oil Changed	Client Info	<b>Not Changed</b>	Changed	Not Changed	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

### CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method	<b>NEG</b>	NEG	NEG

### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >80	<b>8</b>	16	10
Chromium	ppm ASTM D5185m >5	<b>&lt;1</b>	1	1
Nickel	ppm ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	0	0
Silver	ppm ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >30	<b>3</b>	6	3
Lead	ppm ASTM D5185m >30	<b>0</b>	0	0
Copper	ppm ASTM D5185m >150	<b>2</b>	3	3
Tin	ppm ASTM D5185m >5	<b>0</b>	0	<1
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 2	<b>1</b>	2	2
Barium	ppm ASTM D5185m 0	<b>0</b>	0	2
Molybdenum	ppm ASTM D5185m 50	<b>63</b>	62	62
Manganese	ppm ASTM D5185m 0	<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D5185m 950	<b>1001</b>	1032	920
Calcium	ppm ASTM D5185m 1050	<b>1135</b>	1115	1075
Phosphorus	ppm ASTM D5185m 995	<b>1064</b>	1032	1003
Zinc	ppm ASTM D5185m 1180	<b>1342</b>	1327	1208
Sulfur	ppm ASTM D5185m 2600	<b>3649</b>	3286	2837

### CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >20	<b>3</b>	4	3
Sodium	ppm ASTM D5185m	<b>1</b>	2	0
Potassium	ppm ASTM D5185m >20	<b>2</b>	5	6



### INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	<b>0.6</b>	0.9	0.5
Nitration	Abs/cm *ASTM D7624 >20	<b>8.5</b>	9.5	7.6
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>19.6</b>	22.5	17.5

### FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>15.5</b>	18.4	14.4
Base Number (BN)	mg KOH/g ASTM D2896	<b>8.0</b>	6.0	7.1





# OIL ANALYSIS REPORT

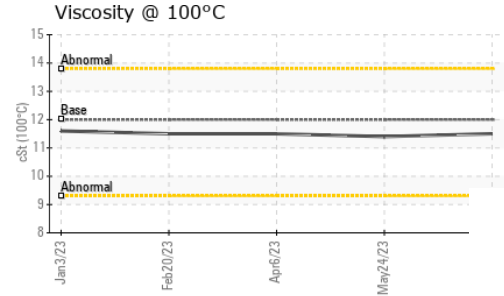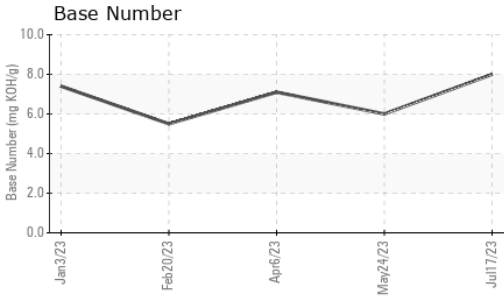

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.00	<b>11.5</b>	11.4

## GRAPHS

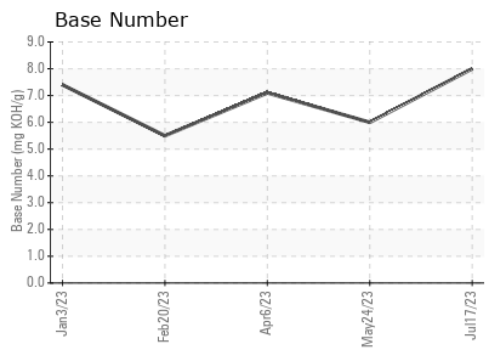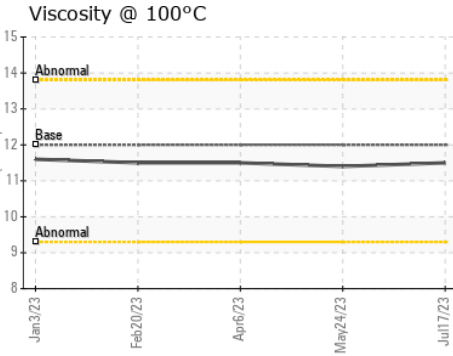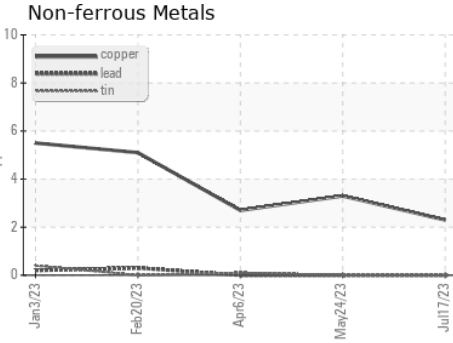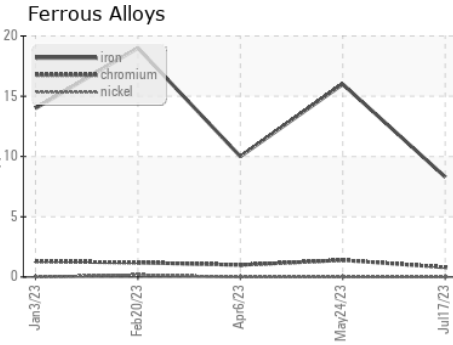

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0100260  
**Lab Number** : 05903659  
**Unique Number** : 10565015  
**Test Package** : FLEET

**Transervice - Shop 1364 - Berkeley-Mt. Vernon**  
 5100 Lake Terrace NE  
 Mt. Vernon, IL  
 US 62864  
 Contact: Erien White  
 ewhite@transervice.com  
 T: (618)244-8726  
 F: (618)244-8791

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)