

## **OIL ANALYSIS REPORT**

#### Sample Rating Trend

## NORMAL



Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (48 QTS)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.


		r2016 Mar20	17 Feb2018 Jan2019	Feb2020 Sep2020 Sep2021 N	Tar2022	
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0101739	PCA0074690	PCA0074718
Sample Date		Client Info		07 Aug 2023	26 Jan 2023	31 May 2022
Machine Age	hrs	Client Info		4535	3464	17380
Oil Age	hrs	Client Info		800	800	310
Oil Changed		Client Info		Changed	Changed	Not Changd
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	20	37	9
Chromium	ppm	ASTM D5185m	>4	3	4	2
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m		<1	<1	<1
Silver	ppm	ASTM D5185m	>3	<1	<1	0
Aluminum	ppm	ASTM D5185m	>9	2	5	2
Lead	ppm	ASTM D5185m	>30	5	19	2
Copper	ppm	ASTM D5185m	>35	3	8	2
Tin	ppm	ASTM D5185m	>4	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	8	7	4
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	50	51	44	28
Manganese	ppm	ASTM D5185m	0	<1	1	<1
Magnesium	ppm	ASTM D5185m	560	603	468	341
Calcium	ppm	ASTM D5185m	1510	1683	1459	1015
Phosphorus	ppm	ASTM D5185m	780	763	619	446
Zinc	ppm	ASTM D5185m	870	1001	831	508
Sulfur	ppm	ASTM D5185m	2040	3238	3530	4701
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	10	18	9
Sodium	ppm	ASTM D5185m		8	12	7
Potassium	ppm	ASTM D5185m	>20	2	2	<1
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	11.7	10.9	7.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	25.8	26.8	20.6
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	22.4	22.3	13.9
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	3.0	▲ 1.8	▲ 1.9
	0 0					

## 2016 Mar2017 Feb2018 Jan2019 Feb2020 Sep2020 Sep2021 Mar2022




# **OIL ANALYSIS REPORT**





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.0	13.5	13.0
GRAPHS						
Ferrous Alloys						
iron chromium			A			

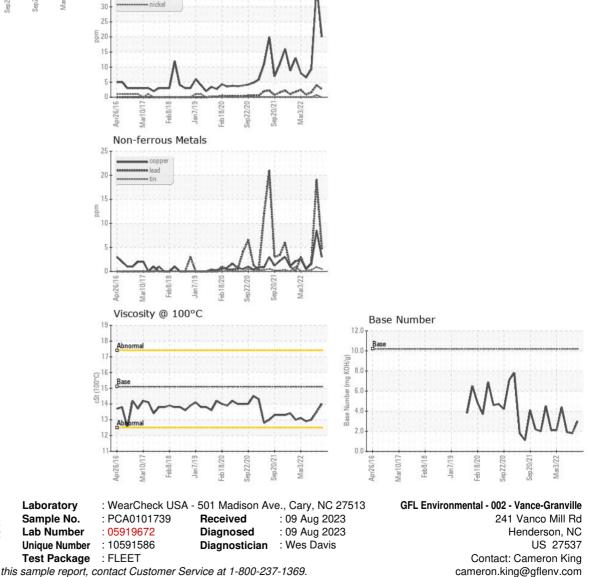

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Submitted By: Cameron King

Page 2 of 2

T: (252)438-5333

F: (252)431-1635