




PROBLEM SUMMARY

Area
PASTA [98299751]
Machine Id
WEST UNLOAD MAC
Component
Blower
Fluid
GEAR OIL ISO 320 (--- GAL)

Sample Rating Trend

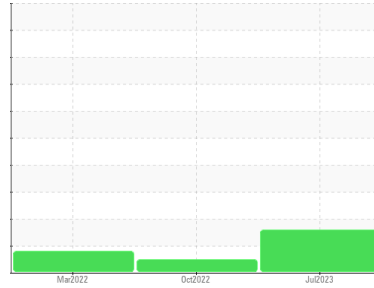


WEAR




COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

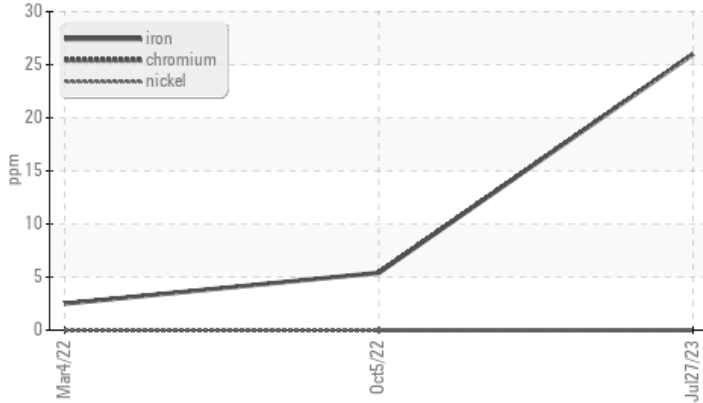

▲ Particle Trend

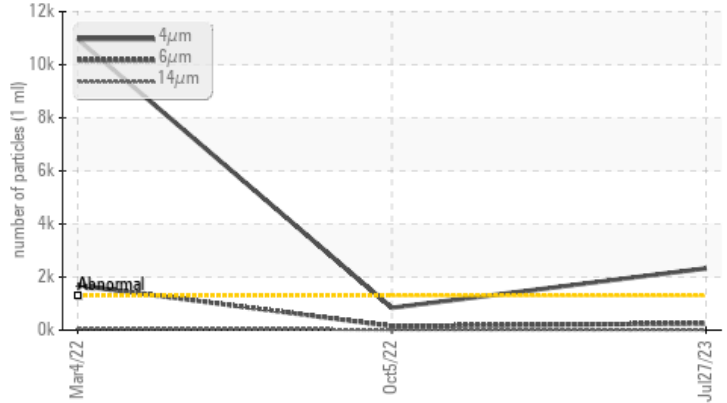

RECOMMENDATION

The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	ABNORMAL
Iron	ppm	ASTM D5185m >20	▲ 26	5	2
Particles >4µm		ASTM D7647 >1300	▲ 2327	841	▲ 10959
Oil Cleanliness		ISO 4406 (c) >17/15/13	▲ 18/15/11	17/14/11	▲ 21/18/13

Customer Id: KRASPRMO
Sample No.: PCA0099595
Lab Number: 05923366
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

05 Oct 2022 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



04 Mar 2022 Diag: Jonathan Hester

ISO




We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area
PASTA [98299751]
 Machine Id
WEST UNLOAD MAC
 Component
Blower
 Fluid
GEAR OIL ISO 320 (--- GAL)

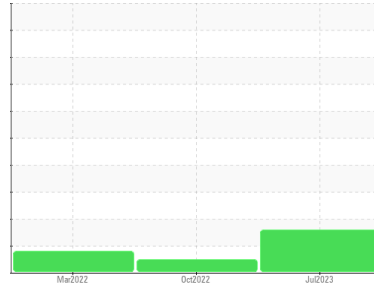

DIAGNOSIS

- Recommendation**
 The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
 The iron level is abnormal. All other component wear rates are normal.
- Contamination**
 There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.
- Fluid Condition**
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0099595	PCA0067381	PCA0067387
Sample Date	Client Info	27 Jul 2023	05 Oct 2022	04 Mar 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	Changed	Changed	N/A
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	▲ 26	5	2
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	<1	0	0
Lead	ppm	ASTM D5185m >20	0	0	<1
Copper	ppm	ASTM D5185m >20	<1	0	0
Tin	ppm	ASTM D5185m >20	0	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 50	0	0	<1
Barium	ppm	ASTM D5185m 15	<1	0	0
Molybdenum	ppm	ASTM D5185m 15	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 50	7	0	0
Calcium	ppm	ASTM D5185m 50	0	0	0
Phosphorus	ppm	ASTM D5185m 350	484	375	226
Zinc	ppm	ASTM D5185m 100	15	0	0
Sulfur	ppm	ASTM D5185m 12500	1967	505	10

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	3	3	7
Sodium	ppm	ASTM D5185m	<1	0	0
Potassium	ppm	ASTM D5185m >20	<1	0	<1

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	▲ 2327	841	▲ 10959
Particles >6µm	ASTM D7647 >320	253	151	▲ 1688
Particles >14µm	ASTM D7647 >80	12	19	70
Particles >21µm	ASTM D7647 >20	4	5	10
Particles >38µm	ASTM D7647 >4	0	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >17/15/13	▲ 18/15/11	17/14/11	▲ 21/18/13

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.85	0.51	0.52	0.81

OIL ANALYSIS REPORT


▲ Particle Trend

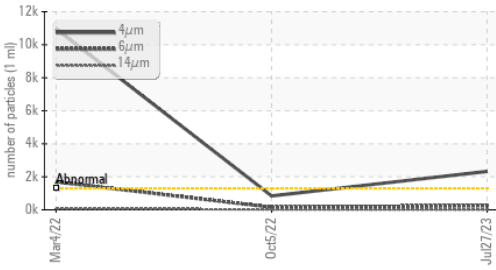


▲ Particle Count

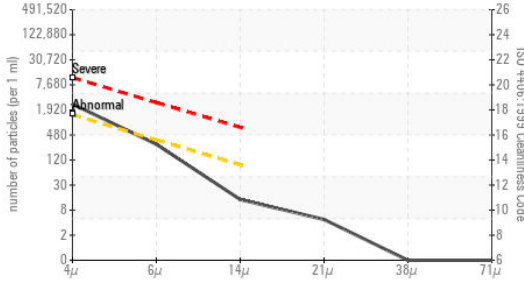


▲ Particle Trend

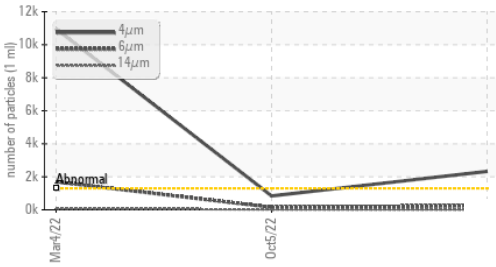

Acid Number

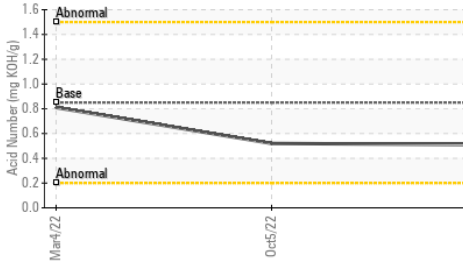

Viscosity @ 40°C

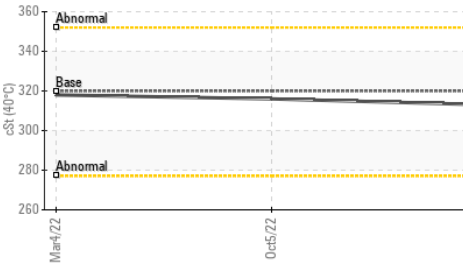


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	313	316	318

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

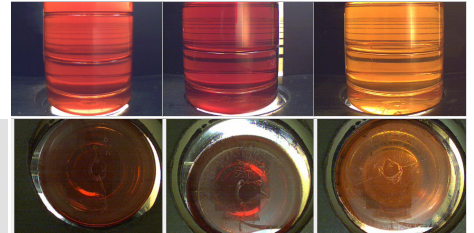


Bottom

GRAPHS


▲ Ferrous Alloys

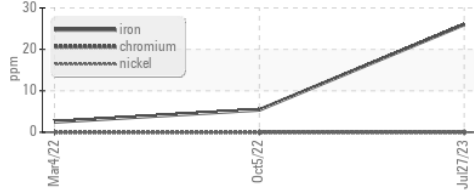


Non-ferrous Metals

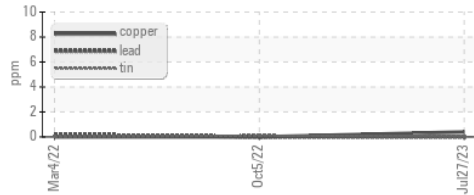


Viscosity @ 40°C

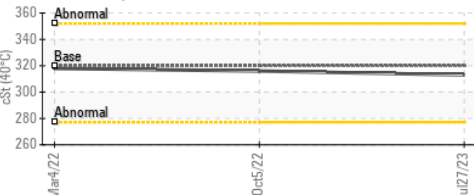

▲ Particle Count

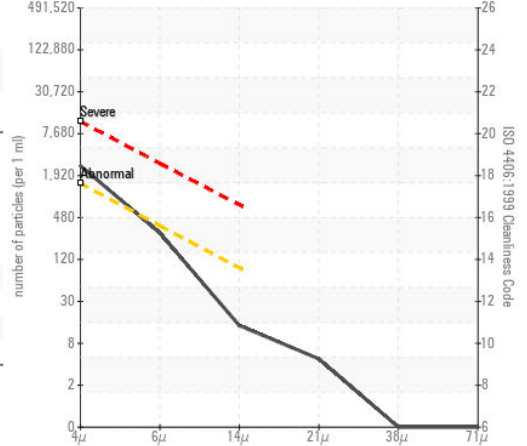

Acid Number

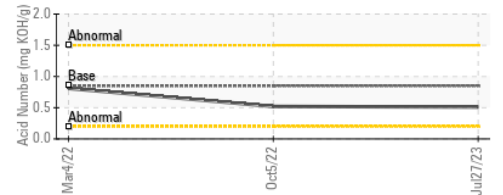

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0099595 **Received** : 14 Aug 2023
Lab Number : 05923366 **Diagnosed** : 15 Aug 2023
Unique Number : 10603313 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Springfield - Plant 8311 PCA
 2035 E BENNETT
 SPRINGFIELD, MO
 US 65804
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: