

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Temper Mill

[Temper Mill] 230085-DELIVERY BRIDLE ROLL 1

Gearbox

PETRO CANADA ENDURATEX EP 220 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

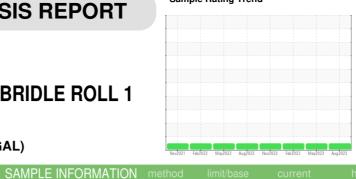

| Sample Number | | Client Info | | PCA0101480 | PCA0095451 | PCA0089530 |
|------------------|----------|-------------|------------|-------------|-------------|-------------|
| Sample Date | | Client Info | | 01 Aug 2023 | 23 May 2023 | 23 Feb 2023 |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | | Client Info | | N/A | N/A | Not Changd |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| WEAR METAL | S | method | limit/base | current | history1 | history2 |
| PQ | | ASTM D8184 | | 19 | 16 | 10 |
| Iron | ppm | ASTM D5185m | >200 | 19 | 17 | 9 |
| Chromium | ppm | ASTM D5185m | >15 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >15 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | <1 | <1 | <1 |
| Lead | ppm | ASTM D5185m | >100 | <1 | <1 | 0 |
| Copper | ppm | ASTM D5185m | >200 | <1 | <1 | <1 |
| Tin | ppm | ASTM D5185m | >25 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Cadmium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 60 | 4 | 4 | 0 |
| Barium | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0 | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | 0 | <1 | 2 | 0 |
| Calcium | ppm | ASTM D5185m | 0 | 6 | 7 | 0 |
| Phosphorus | ppm | ASTM D5185m | 270 | 344 | 320 | 321 |
| Zinc | ppm | ASTM D5185m | 0 | 37 | 35 | 28 |
| Sulfur | ppm | ASTM D5185m | 11200 | 16178 | 16247 | 17332 |
| CONTAMINAN | TS | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >50 | 29 | 24 | 22 |
| Sodium | ppm | ASTM D5185m | | 2 | 2 | 1 |
| Potassium | ppm | ASTM D5185m | >20 | 2 | 4 | 0 |
| FLUID DEGRA | OITAC | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.40 | 0.79 | 0.79 | 1.05 |
| VISUAL | | method | limit/base | current | history1 | history2 |
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | LIGHT | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |

Odor

Emulsified Water

scalar *Visual

scalar *Visual

*Visual

scalar

NORML

>0.2

NORML

NEG

NEG

NORML

NEG


NORML

NEG

ocatine BRAD ELLISIES DITER



OIL ANALYSIS REPORT

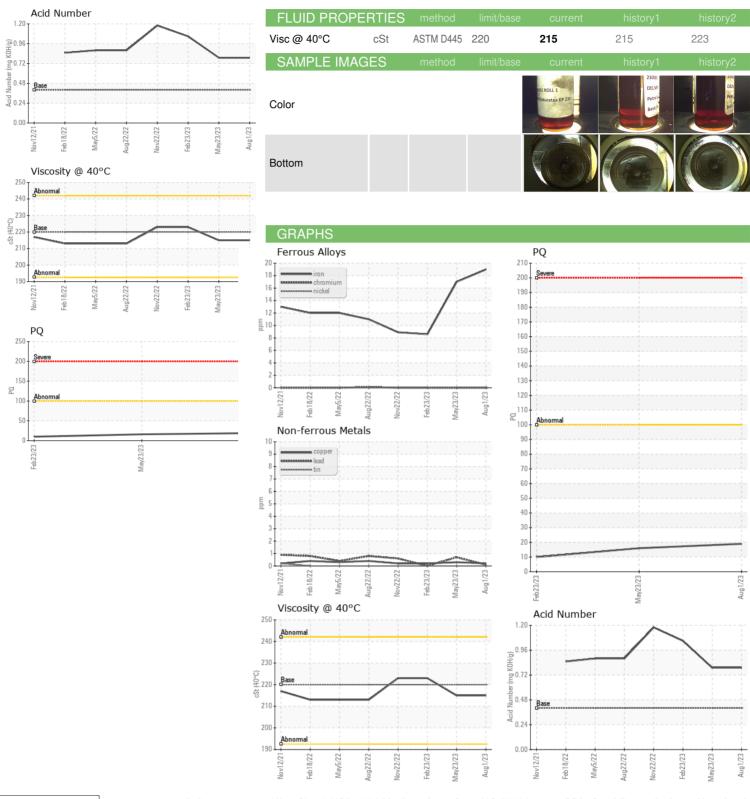



Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: PCA0101480 : 05924421 : 10604368 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 14 Aug 2023 : 15 Aug 2023 Diagnosed : Wes Davis Diagnostician

SDI - Steel DynamicsInc. - Heartland 455 West Industrial Drive

Terre Haute, IN US 47802

Contact: BRAD ELLIS brad.ellis@steeldynamics.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: SDITER [WUSCAR] 05924421 (Generated: 08/15/2023 15:32:26) Rev: 1

Contact/Location: BRAD ELLIS - SDITER

T:

F: