

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**LOADOUT**  
 Machine Id  
**FL02 L LO SOUTH BINS TRANSFER BLOWER #2**  
 Component  
**Left Blower**  
 Fluid  
**PETRO CANADA SYNDURO SHB ISO 220 (3 QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0102143</b>	---	---
Sample Date	Client Info	<b>09 Aug 2023</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184	<b>10</b>	---	---
Iron	ppm ASTM D5185m >20	<b>4</b>	---	---
Chromium	ppm ASTM D5185m >20	<b>0</b>	---	---
Nickel	ppm ASTM D5185m >20	<b>0</b>	---	---
Titanium	ppm ASTM D5185m	<b>0</b>	---	---
Silver	ppm ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm ASTM D5185m >20	<b>0</b>	---	---
Lead	ppm ASTM D5185m >20	<b>0</b>	---	---
Copper	ppm ASTM D5185m >20	<b>&lt;1</b>	---	---
Tin	ppm ASTM D5185m >20	<b>0</b>	---	---
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	---	---
Barium	ppm ASTM D5185m 5.0	<b>0</b>	---	---
Molybdenum	ppm ASTM D5185m	<b>0</b>	---	---
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm ASTM D5185m 5.0	<b>3</b>	---	---
Calcium	ppm ASTM D5185m 5.0	<b>0</b>	---	---
Phosphorus	ppm ASTM D5185m 100	<b>93</b>	---	---
Zinc	ppm ASTM D5185m 5.0	<b>0</b>	---	---
Sulfur	ppm ASTM D5185m 1900	<b>2587</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>&lt;1</b>	---	---
Sodium	ppm ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm ASTM D5185m >20	<b>1</b>	---	---



## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.3	<b>0.39</b>	---	---

## VISUAL

method	limit/base	current	history1	history2
White Metal	scalar *Visual NONE	<b>NONE</b>	---	---
Yellow Metal	scalar *Visual NONE	<b>NONE</b>	---	---
Precipitate	scalar *Visual NONE	<b>NONE</b>	---	---
Silt	scalar *Visual NONE	<b>LIGHT</b>	---	---
Debris	scalar *Visual NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar *Visual NONE	<b>NONE</b>	---	---
Appearance	scalar *Visual NORML	<b>NORML</b>	---	---
Odor	scalar *Visual NORML	<b>NORML</b>	---	---
Emulsified Water	scalar *Visual	<b>NEG</b>	---	---
Free Water	scalar *Visual	<b>NEG</b>	---	---

# OIL ANALYSIS REPORT

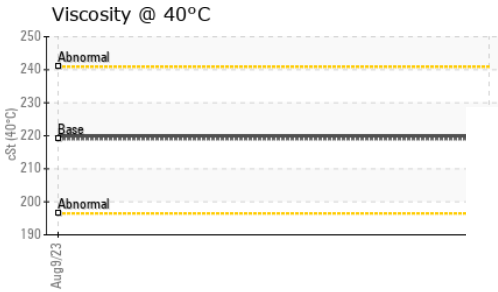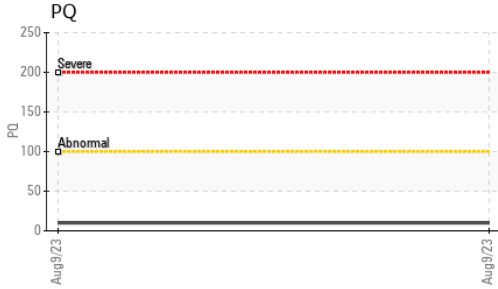





FLUID PROPERTIES	method	limit/base	current	history1	history2
------------------	--------	------------	---------	----------	----------

Visc @ 40°C	cSt	ASTM D445	219	<b>220</b>	---	---
-------------	-----	-----------	-----	------------	-----	-----

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS
--------

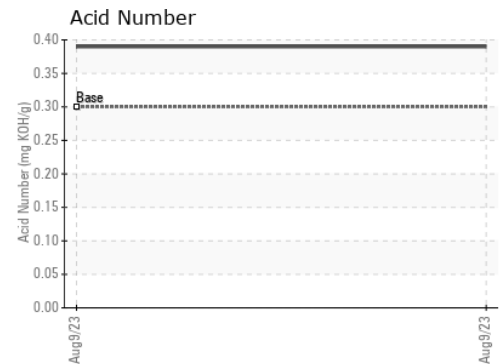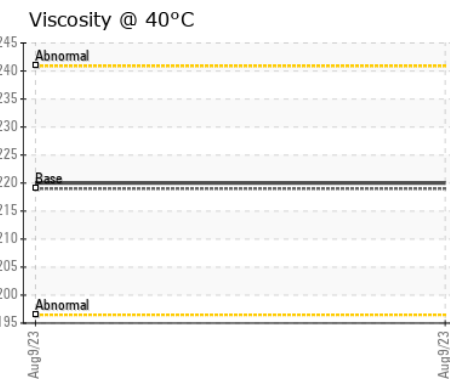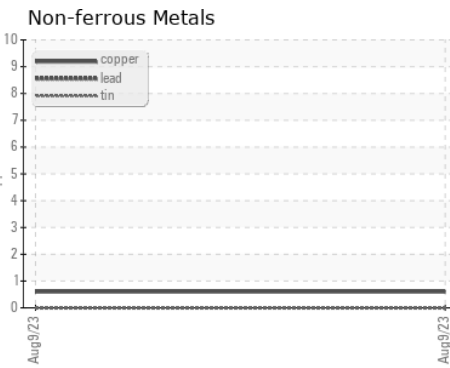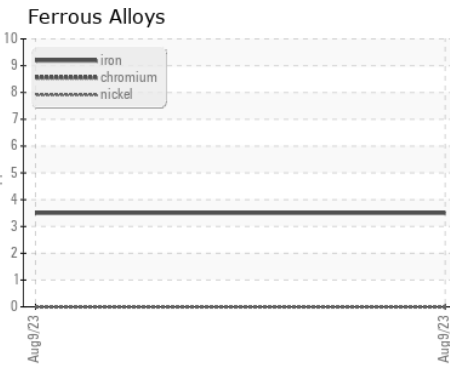

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0102143 **Received** : 15 Aug 2023  
**Lab Number** : **05925506** **Diagnosed** : 17 Aug 2023  
**Unique Number** : 10605453 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT

**Ardent Mills - Wichita**  
 715 E 13TH ST N  
 WICHITA, KS  
 US 67214-1301  
 Contact: DOUG SOMMERS  
 doug.sommers@ardentmills.com  
 T: (316)670-8006  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)