


# PROBLEM SUMMARY

Sample Rating Trend


**WEAR**

Area  
**LOADOUT**  
 Machine Id  
**FL01 R LO SOUTH BINS TRANSFER BLOWER #1**  
 Component  
**Right Blower**  
 Fluid  
**PETRO CANADA SYNDURO SHB ISO 220 (3 QTS)**

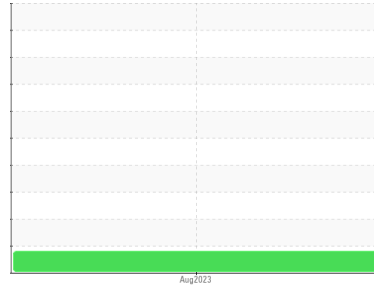

## COMPONENT CONDITION SUMMARY

### ▲ Ferrous Alloys

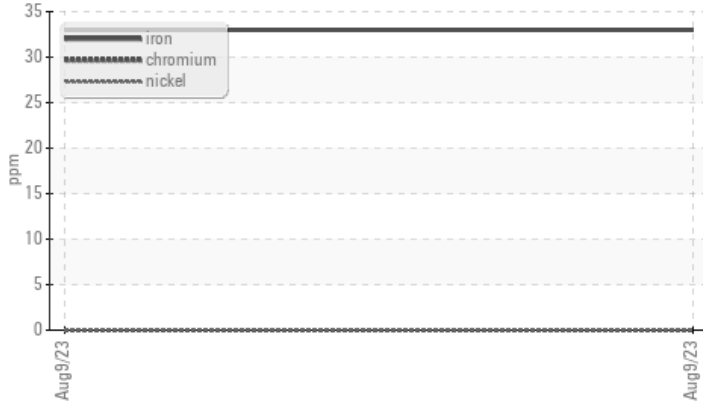

## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Iron	ppm	ASTM D5185m	>20	<b>▲ 33</b>	---	---

Customer Id: ARDWIC  
 Sample No.: PCA0102142  
 Lab Number: 05925507  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

# OIL ANALYSIS REPORT

Sample Rating Trend



**WEAR**



Area  
**LOADOUT**  
 Machine Id  
**FL01 R LO SOUTH BINS TRANSFER BLOWER #1**  
 Component  
**Right Blower**  
 Fluid  
**PETRO CANADA SYNDURO SHB ISO 220 (3 QTS)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### ▲ Wear

The iron level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0102142</b>	---	---
Sample Date	Client Info			<b>09 Aug 2023</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		<b>17</b>	---	---
Iron	ppm	ASTM D5185m	>20	<b>▲ 33</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m	5.0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	5.0	<b>6</b>	---	---
Calcium	ppm	ASTM D5185m	5.0	<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m	100	<b>99</b>	---	---
Zinc	ppm	ASTM D5185m	5.0	<b>11</b>	---	---
Sulfur	ppm	ASTM D5185m	1900	<b>2582</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.3	<b>0.32</b>	---	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>LIGHT</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual		<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

# OIL ANALYSIS REPORT


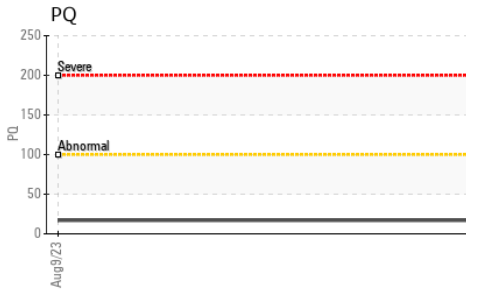
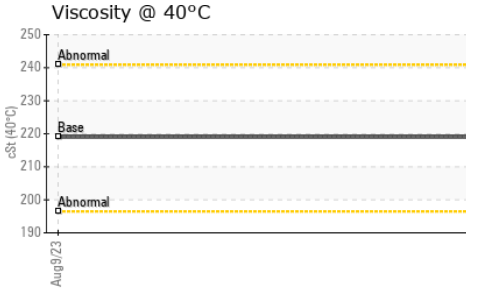
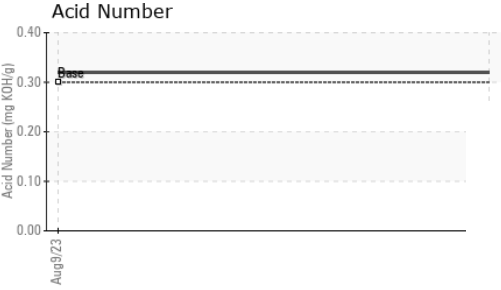


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 219	<b>219</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

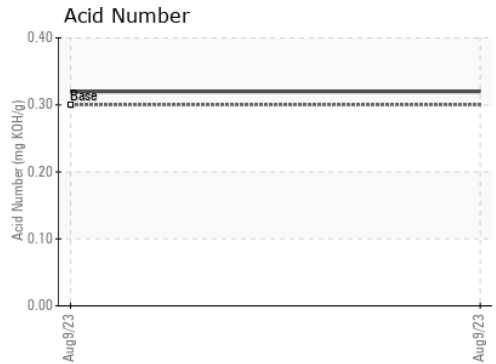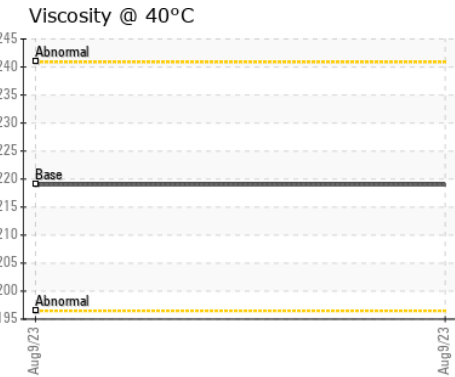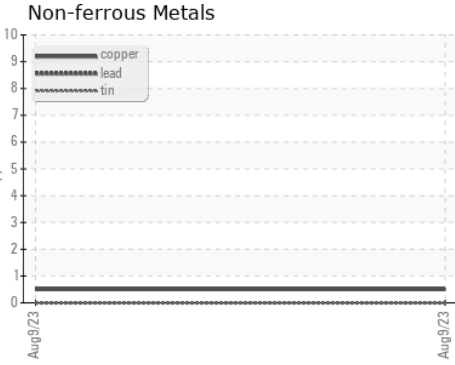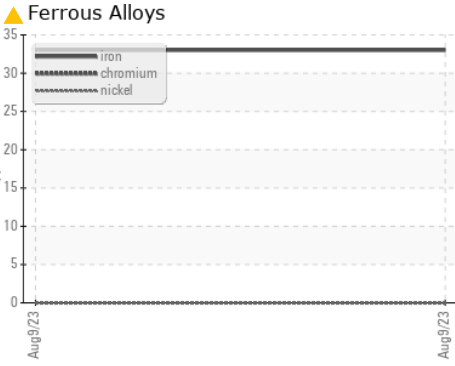

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0102142 **Received** : 15 Aug 2023  
**Lab Number** : 05925507 **Diagnosed** : 17 Aug 2023  
**Unique Number** : 10605454 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT

**Ardent Mills - Wichita**  
 715 E 13TH ST N  
 WICHITA, KS  
 US 67214-1301  
 Contact: DOUG SOMMERS  
 doug.sommers@ardentmills.com  
 T: (316)670-8006  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)