

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
LOADOUT
Machine Id
FL02 R LO SOUTH BINS TRANSFER BLOWER #2
Component
Right Blower
Fluid
PETRO CANADA SYNDURO SHB ISO 220 (3 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0102144	---	---
Sample Date	Client Info	09 Aug 2023	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	Not Chngd	---	---
Sample Status		NORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184	19	---	---
Iron	ppm ASTM D5185m >20	23	---	---
Chromium	ppm ASTM D5185m >20	0	---	---
Nickel	ppm ASTM D5185m >20	0	---	---
Titanium	ppm ASTM D5185m	0	---	---
Silver	ppm ASTM D5185m	0	---	---
Aluminum	ppm ASTM D5185m >20	0	---	---
Lead	ppm ASTM D5185m >20	0	---	---
Copper	ppm ASTM D5185m >20	<1	---	---
Tin	ppm ASTM D5185m >20	0	---	---
Vanadium	ppm ASTM D5185m	<1	---	---
Cadmium	ppm ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	---	---
Barium	ppm ASTM D5185m 5.0	0	---	---
Molybdenum	ppm ASTM D5185m	0	---	---
Manganese	ppm ASTM D5185m	<1	---	---
Magnesium	ppm ASTM D5185m 5.0	6	---	---
Calcium	ppm ASTM D5185m 5.0	2	---	---
Phosphorus	ppm ASTM D5185m 100	100	---	---
Zinc	ppm ASTM D5185m 5.0	9	---	---
Sulfur	ppm ASTM D5185m 1900	2602	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<1	---	---
Sodium	ppm ASTM D5185m	<1	---	---
Potassium	ppm ASTM D5185m >20	<1	---	---




FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.3	0.31	---	---

VISUAL

method	limit/base	current	history1	history2
White Metal	scalar *Visual NONE	NONE	---	---
Yellow Metal	scalar *Visual NONE	NONE	---	---
Precipitate	scalar *Visual NONE	NONE	---	---
Silt	scalar *Visual NONE	NONE	---	---
Debris	scalar *Visual NONE	LIGHT	---	---
Sand/Dirt	scalar *Visual NONE	NONE	---	---
Appearance	scalar *Visual NORML	NORML	---	---
Odor	scalar *Visual NORML	NORML	---	---
Emulsified Water	scalar *Visual	NEG	---	---
Free Water	scalar *Visual	NEG	---	---

OIL ANALYSIS REPORT

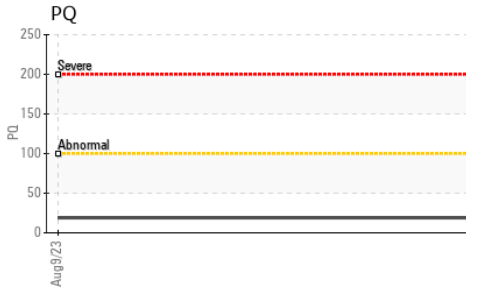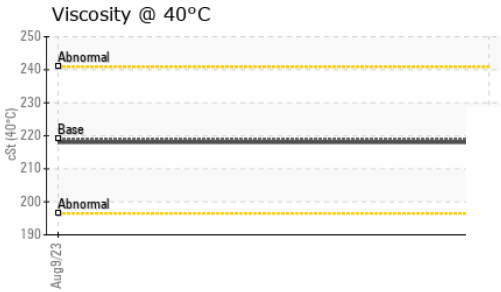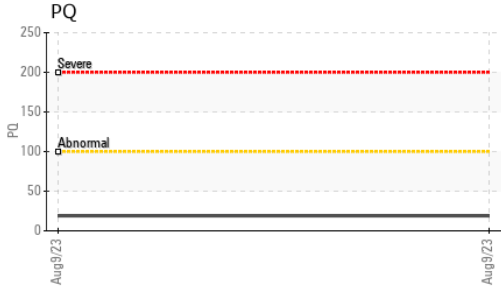





FLUID PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	219	218	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

GRAPHS

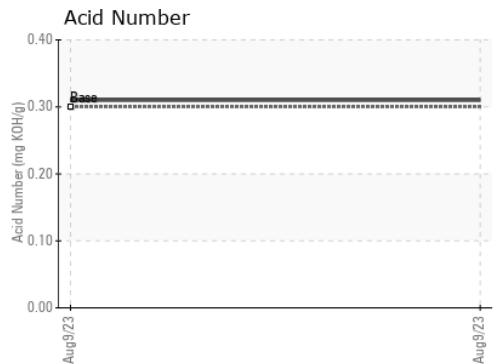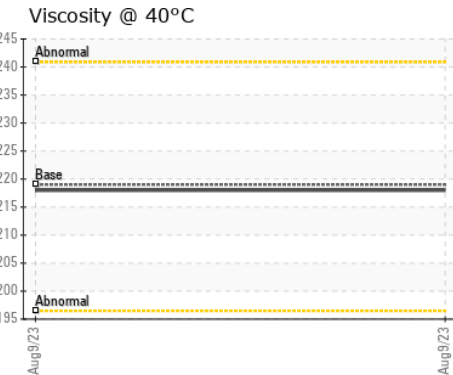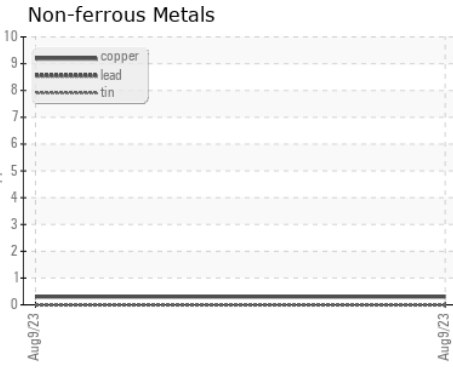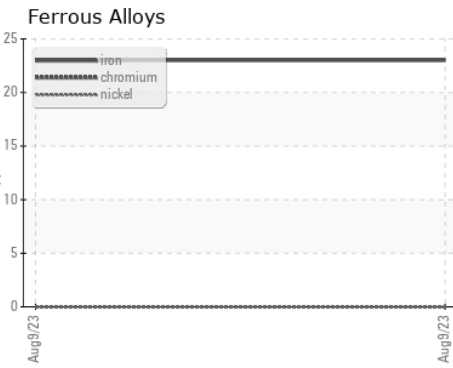

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0102144 **Received** : 15 Aug 2023
Lab Number : 05925509 **Diagnosed** : 17 Aug 2023
Unique Number : 10605456 **Diagnostician** : Jonathan Hester
Test Package : PLANT

Ardent Mills - Wichita
 715 E 13TH ST N
 WICHITA, KS
 US 67214-1301
 Contact: DOUG SOMMERS
 doug.sommers@ardentmills.com
 T: (316)670-8006
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)