


# PROBLEM SUMMARY

Area  
**[98391076]**  
 Machine Id  
**KR-GR-003071 - DUMPER 3A (S/N GRIND A - 11513012)**  
 Component  
**Hydraulic System**  
 Fluid  
**AW HYDRAULIC OIL ISO 68 (--- GAL)**

Sample Rating Trend

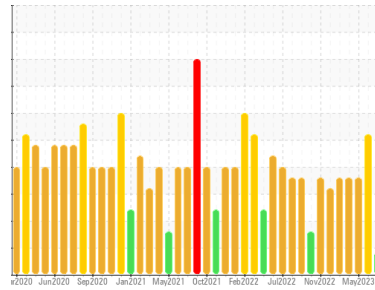

## CONTAMINANT



## COMPONENT CONDITION SUMMARY

No relevant graphs to display


## RECOMMENDATION

Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ATTENTION	ABNORMAL	ABNORMAL		
Appearance	scalar *Visual	NORML	▲ HAZY	▲ HAZY	▲ HAZY

**Customer Id:** KRAKIR  
**Sample No.:** PCA0102554  
**Lab Number:** 05926086  
**Test Package:** IND 2



*To manage this report scan the QR code*

*To discuss the diagnosis or test data:*  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

*To change component or sample information:*  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

There are no recommended actions for this sample.

## HISTORICAL DIAGNOSIS

### 16 Jun 2023 Diag: Don Baldrige

WATER



We advise that you check for the source of water entry. We advise that you follow the water drain-off procedure for this component, and use off-line filtration to improve the cleanliness of the system fluid. We recommend an early resample to monitor this condition. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a moderate amount of visible silt present in the sample. There is a light concentration of water present in the oil. Free water present. The condition of the oil is acceptable for the time in service.

view report



### 11 May 2023 Diag: Don Baldrige

WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. Appearance is hazy. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. There is a moderate amount of visible silt present in the sample. The condition of the oil is acceptable for the time in service.

view report



### 17 Apr 2023 Diag: Don Baldrige

WATER




We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. Appearance is hazy. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. There is a moderate amount of visible silt present in the sample. The condition of the oil is acceptable for the time in service.

view report



# OIL ANALYSIS REPORT

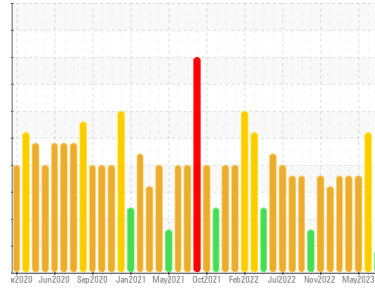**Sample Rating Trend**

**CONTAMINANT**


Area  
**[98391076]**  
 Machine Id  
**KR-GR-003071 - DUMPER 3A (S/N GRIND A - 11513012)**  
 Component  
**Hydraulic System**  
 Fluid  
**AW HYDRAULIC OIL ISO 68 (--- GAL)**

**DIAGNOSIS**
**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

Appearance is hazy. The water content is negligible. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0102554</b>	PCA0099344	PCA0097174
Sample Date	Client Info		<b>31 Jul 2023</b>	16 Jun 2023	11 May 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL

**WEAR METALS**

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 5	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m 5	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 25	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m 200	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 300	<b>429</b>	394	388
Zinc	ppm	ASTM D5185m 370	<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m 2500	<b>514</b>	551	560

**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	1	1
Sodium	ppm	ASTM D5185m	<b>0</b>	1	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0





**FLUID CLEANLINESS**

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>9013</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>1768</b>	---	---
Particles >14µm	ASTM D7647	>640	<b>93</b>	---	---
Particles >21µm	ASTM D7647	>160	<b>25</b>	---	---
Particles >38µm	ASTM D7647	>40	<b>1</b>	---	---
Particles >71µm	ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/16	<b>20/18/14</b>	---	---

**FLUID DEGRADATION**

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	<b>0.23</b>	---	---


# OIL ANALYSIS REPORT

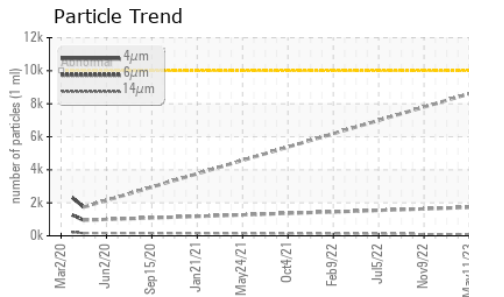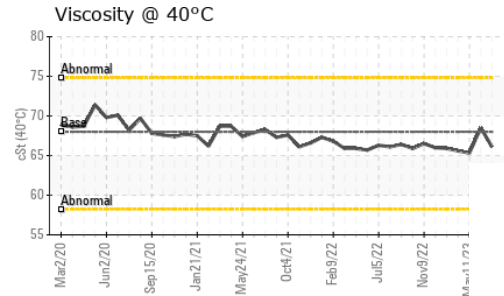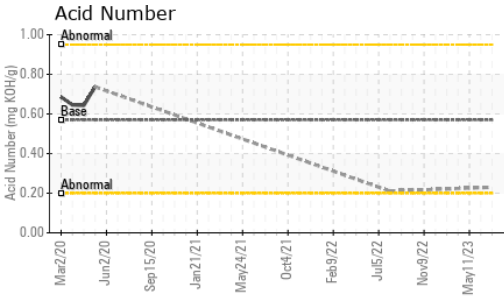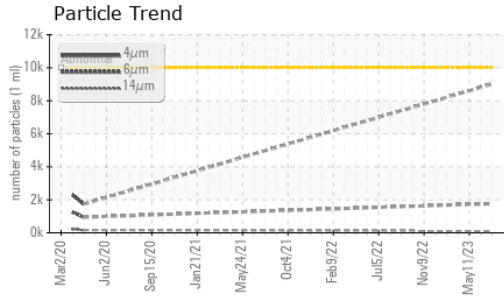






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	▲ MODER
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	▲ HAZY	▲ HAZY	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	0.2%
Free Water	scalar	*Visual	NEG	▲ 1.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	66.1	68.5	65.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

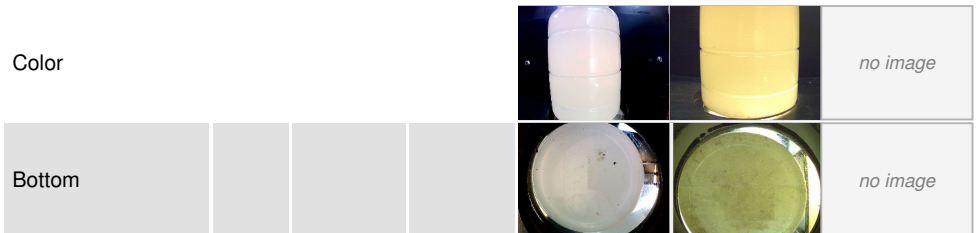

## GRAPHS

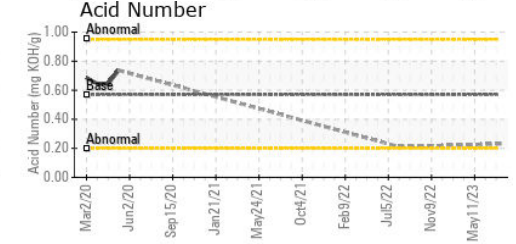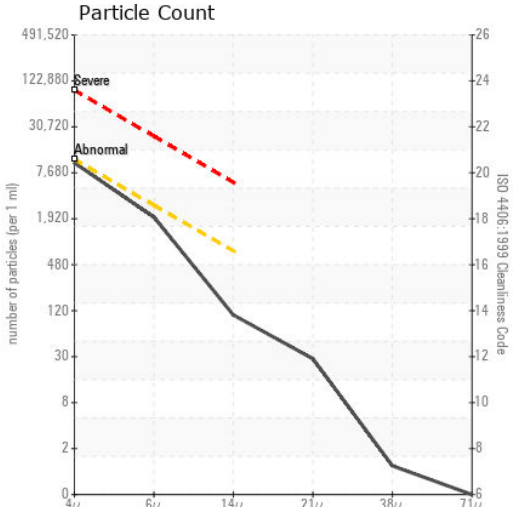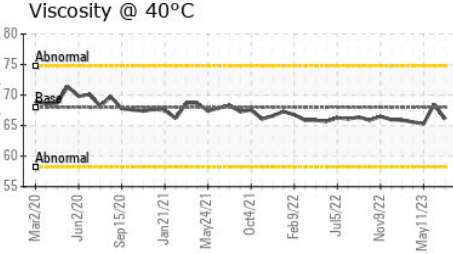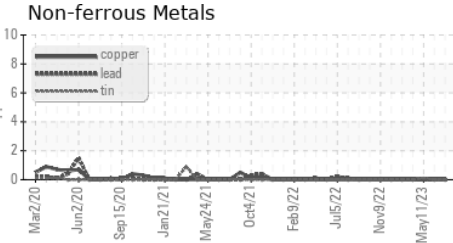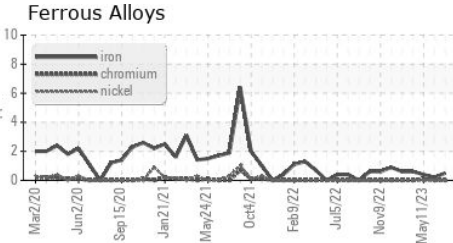

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0102554 **Received** : 16 Aug 2023  
**Lab Number** : 05926086 **Diagnosed** : 17 Aug 2023  
**Unique Number** : 10606033 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**KraftHeinz - Kirksville - Plant 8333 PCA**  
 2504 INDUSTRIAL DR  
 KIRKSVILLE, MO  
 US 63501  
 Contact: WALLACE WARD  
 wallace.ward@kraftheinzcompany.com  
 T: (660)627-1031  
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)