


PROBLEM SUMMARY

Area
LOADOUT
 Machine Id
FL31 R LO TOWER RAIL BLOWER #2
 Component
Right Blower
 Fluid
PETRO CANADA SYNDURO SHB ISO 220 (5 QTS)

Sample Rating Trend

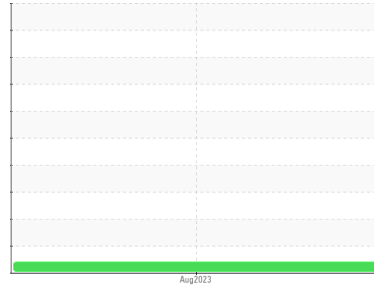

VIS DEBRIS



COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL		---	---
Debris	scalar *Visual	NONE	▲ MODER	---	---

Customer Id: ARDWIC
 Sample No.: PCA0102102
 Lab Number: 05926253
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.


HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend

VIS DEBRIS

Area
LOADOUT
 Machine Id
FL31 R LO TOWER RAIL BLOWER #2
 Component
Right Blower
 Fluid
PETRO CANADA SYNDURO SHB ISO 220 (5 QTS)

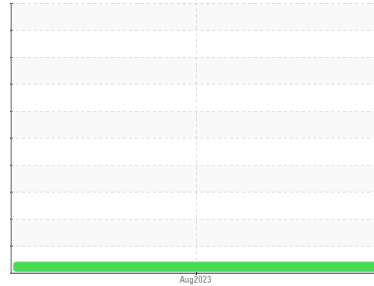

DIAGNOSIS

Recommendation
 We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0102102	---	---
Sample Date	Client Info	09 Aug 2023	---	---
Machine Age	hrs	0	---	---
Oil Age	hrs	0	---	---
Oil Changed	Client Info	Not Chngd	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184	15	---	---
Iron	ppm	ASTM D5185m >20	0	---
Chromium	ppm	ASTM D5185m >20	0	---
Nickel	ppm	ASTM D5185m >20	0	---
Titanium	ppm	ASTM D5185m	0	---
Silver	ppm	ASTM D5185m	<1	---
Aluminum	ppm	ASTM D5185m >20	0	---
Lead	ppm	ASTM D5185m >20	0	---
Copper	ppm	ASTM D5185m >20	<1	---
Tin	ppm	ASTM D5185m >20	0	---
Vanadium	ppm	ASTM D5185m	<1	---
Cadmium	ppm	ASTM D5185m	<1	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---
Barium	ppm	ASTM D5185m 5.0	0	---
Molybdenum	ppm	ASTM D5185m	0	---
Manganese	ppm	ASTM D5185m	0	---
Magnesium	ppm	ASTM D5185m 5.0	11	---
Calcium	ppm	ASTM D5185m 5.0	12	---
Phosphorus	ppm	ASTM D5185m 100	134	---
Zinc	ppm	ASTM D5185m 5.0	115	---
Sulfur	ppm	ASTM D5185m 1900	3625	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	---
Sodium	ppm	ASTM D5185m	2	---
Potassium	ppm	ASTM D5185m >20	1	---




FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.3	0.32	---

VISUAL

method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	---
Yellow Metal	scalar	*Visual NONE	NONE	---
Precipitate	scalar	*Visual NONE	NONE	---
Silt	scalar	*Visual NONE	NONE	---
Debris	scalar	*Visual NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual NONE	NONE	---
Appearance	scalar	*Visual NORML	NORML	---
Odor	scalar	*Visual NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	---
Free Water	scalar	*Visual	NEG	---

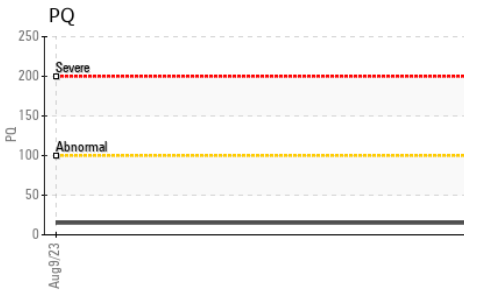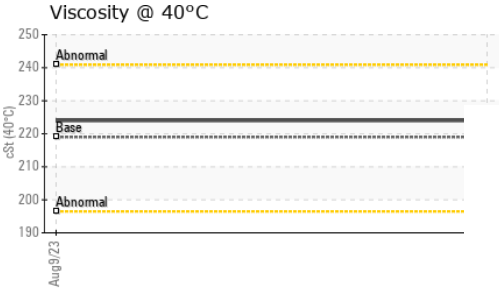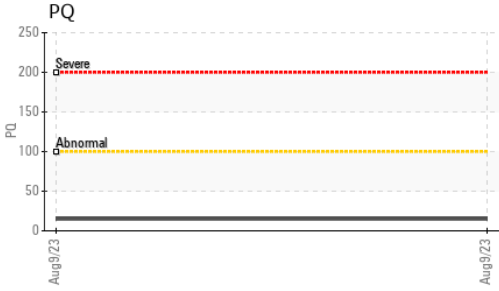

OIL ANALYSIS REPORT







FLUID PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445 219	224	---	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

GRAPHS

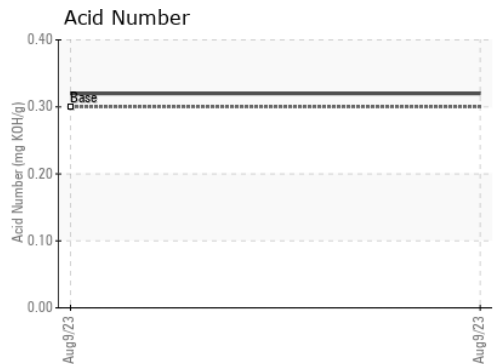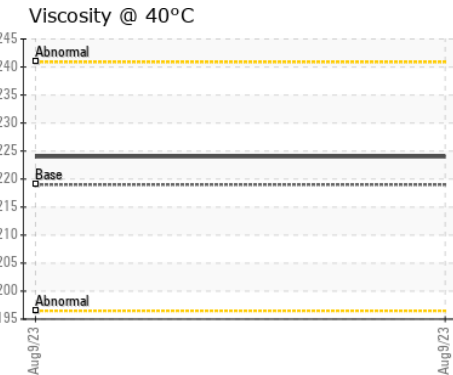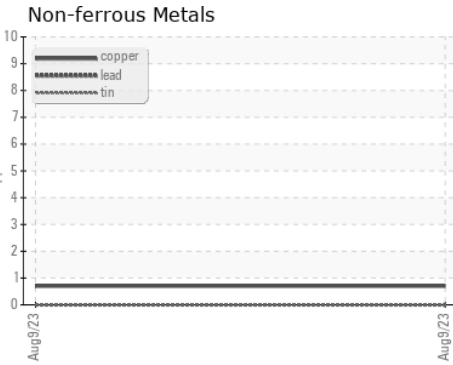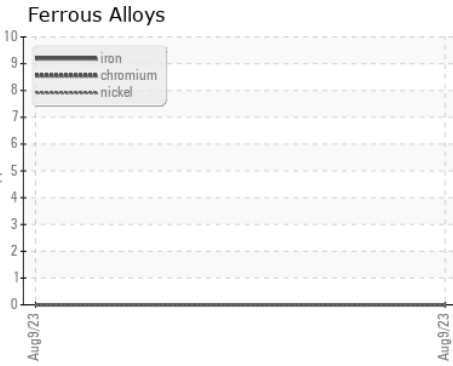

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0102102 **Received** : 16 Aug 2023
Lab Number : 05926253 **Diagnosed** : 17 Aug 2023
Unique Number : 10606200 **Diagnostician** : Jonathan Hester
Test Package : PLANT

Ardent Mills - Wichita
 715 E 13TH ST N
 WICHITA, KS
 US 67214-1301
 Contact: DOUG SOMMERS
 doug.sommers@ardentmills.com
 T: (316)670-8006
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)