

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 810014

Component Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0083127	GFL0083102	GFL0083152
Sample Date		Client Info		16 Aug 2023	31 Jul 2023	10 Jul 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	ATTENTION
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	10	7	4 7
Chromium	ppm	ASTM D5185m	>4	<1	<1	3
Nickel	ppm	ASTM D5185m	>2	0	<1	2
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	3	2	8
Lead	ppm	ASTM D5185m	>30	0	<1	<1
Copper	ppm	ASTM D5185m	>35	0	<1	5
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	11	14	15
Barium	ppm	ASTM D5185m	5	0	0	2
Molybdenum	ppm	ASTM D5185m	50	76	58	57
worybacham	ppin	NOTIVI DOTOOIII	00		00	01
Manganese	ppm	ASTM D5185m		0	<1	<1
3				0 692		
Manganese	ppm	ASTM D5185m	0		<1	<1
Manganese Magnesium	ppm ppm	ASTM D5185m ASTM D5185m	0 560	692	<1 521	<1 750
Manganese Magnesium Calcium	ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510	692 1963	<1 521 1521	<1 750 1298
Manganese Magnesium Calcium Phosphorus	ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780	692 1963 786	<1 521 1521 673	<1 750 1298 893
Manganese Magnesium Calcium Phosphorus Zinc	ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780 870	692 1963 786 1224	<1 521 1521 673 910	<1 750 1298 893 1102
Manganese Magnesium Calcium Phosphorus Zinc Sulfur	ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780 870 2040	692 1963 786 1224 3858	<1 521 1521 673 910 2518	<1 750 1298 893 1102 2853
Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN	ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780 870 2040 limit/base	692 1963 786 1224 3858 current	<1 521 1521 673 910 2518 history1	<1 750 1298 893 1102 2853 history2
Maganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon	ppm ppm ppm ppm ppm ppm TS	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m method ASTM D5185m	0 560 1510 780 870 2040 limit/base	692 1963 786 1224 3858 current 3	<1 521 1521 673 910 2518 history1 4	<1 750 1298 893 1102 2853 history2 13
Maganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium	ppm ppm ppm ppm ppm ppm TS ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780 870 2040 <i>limit/base</i> >+100	692 1963 786 1224 3858 current 3 4	<1 521 1521 673 910 2518 history1 4 2	<1 750 1298 893 1102 2853 history2 13 19
Maganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium	ppm ppm ppm ppm ppm ppm TS ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780 870 2040 limit/base >+100	692 1963 786 1224 3858 current 3 4 0	<1 521 1521 673 910 2518 history1 4 2 2 <1	<1 750 1298 893 1102 2853 history2 13 19 2
Maganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED	ppm ppm ppm ppm ppm ppm TS ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780 870 2040 limit/base >+100	692 1963 786 1224 3858 current 3 4 0 current	<1 521 1521 673 910 2518 history1 4 2 2 <1 kistory1	<1 750 1298 893 1102 2853 history2 13 19 2 kistory2
Maganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot %	ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 560 1510 780 870 2040 limit/base >20 limit/base	692 1963 786 1224 3858 current 3 4 0 current 0	<1 521 1521 673 910 2518 history1 4 2 <1 2 <1 history1 0	<1 750 1298 893 1102 2853 history2 13 19 2 history2 1.7
Maganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m	0 560 1510 780 870 2040 limit/base >+100 >20 limit/base	692 1963 786 1224 3858 current 3 4 0 current 0 0 10.8	<1 521 1521 673 910 2518 history1 4 2 <1 history1 0 10.1	<1 750 1298 893 1102 2853 history2 13 19 2 history2 1.7 1.7 10.1
Maganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D7844 *ASTM D7844 *ASTM D7844	0 560 1510 780 870 2040 imit/base >20 imit/base >20 :	692 1963 786 1224 3858 <u>current</u> 3 4 0 <u>current</u> 0 10.8 21.0	<1 521 1521 673 910 2518 history1 4 2 <1 4 2 <1 history1 0 10.1 19.6	<1 750 1298 893 1102 2853 history2 13 19 2 history2 1.7 1.7 10.1 23.3




OIL ANALYSIS REPORT





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	ERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.1	14.2	14.5
GRAPHS						

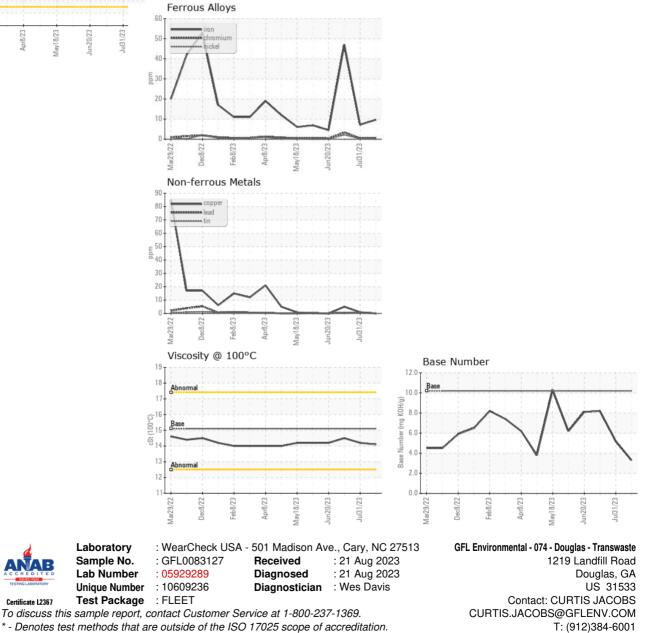

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Submitted By: CURTIS JACOBS

F: