


PROBLEM SUMMARY


Area
NAT CUTS [AFTER]
 Machine Id
LINE 1 CUBER
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 460 (--- GAL)

Sample Rating Trend

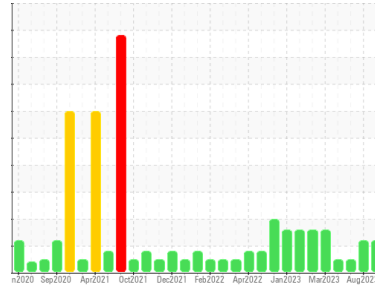

COMPONENT CONDITION SUMMARY

▲ Particle Trend

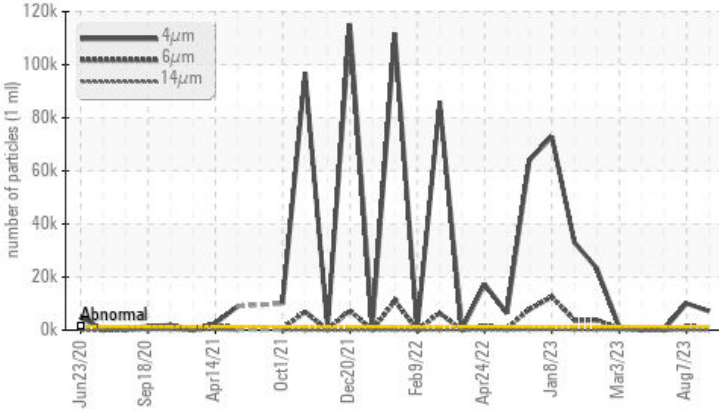

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >4µm	ASTM D7647	>1300	▲ 7140	▲ 10068	321
Particles >6µm	ASTM D7647	>320	▲ 988	▲ 1279	137
Oil Cleanliness	ISO 4406 (c)	>17/15/13	▲ 20/17/13	▲ 21/17/12	16/14/11

Customer Id: KRASPRMO
 Sample No.: PCA0101632
 Lab Number: 05929566
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

07 Aug 2023 Diag: Angela Borella

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



05 May 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. AFTER All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Apr 2023 Diag: Doug Bogart

NORMAL




Resample at the next service interval to monitor. BEFORE All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area
NAT CUTS [AFTER]
 Machine Id
LINE 1 CUBER
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 460 (--- GAL)

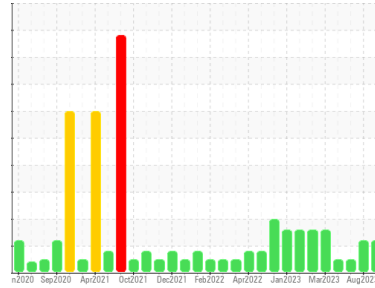

DIAGNOSIS

Recommendation
 The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0101632	PCA0101631	PCA0096818
Sample Date	Client Info	09 Aug 2023	07 Aug 2023	05 May 2023
Machine Age	days	0	0	5
Oil Age	days	0	0	5
Oil Changed	Client Info	N/A	N/A	Filtered
Sample Status		ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	6	7	6
Chromium	ppm	ASTM D5185m >20	1	1	1
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	0	0	3
Lead	ppm	ASTM D5185m >20	<1	<1	<1
Copper	ppm	ASTM D5185m >20	7	8	6
Tin	ppm	ASTM D5185m >20	<1	0	<1
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 5	0	0	0
Barium	ppm	ASTM D5185m 5	0	0	0
Molybdenum	ppm	ASTM D5185m 5	0	0	<1
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 25	0	0	9
Calcium	ppm	ASTM D5185m 200	0	0	4
Phosphorus	ppm	ASTM D5185m 300	358	369	357
Zinc	ppm	ASTM D5185m 370	18	23	36
Sulfur	ppm	ASTM D5185m 2500	915	950	781

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	3	3	3
Sodium	ppm	ASTM D5185m	<1	<1	<1
Potassium	ppm	ASTM D5185m >20	0	0	0

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	▲ 7140	▲ 10068	321
Particles >6µm	ASTM D7647 >320	▲ 988	▲ 1279	137
Particles >14µm	ASTM D7647 >80	47	25	19
Particles >21µm	ASTM D7647 >20	13	6	3
Particles >38µm	ASTM D7647 >4	0	1	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >17/15/13	▲ 20/17/13	▲ 21/17/12	16/14/11

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.57	0.19	0.19	0.19

OIL ANALYSIS REPORT


▲ Particle Trend

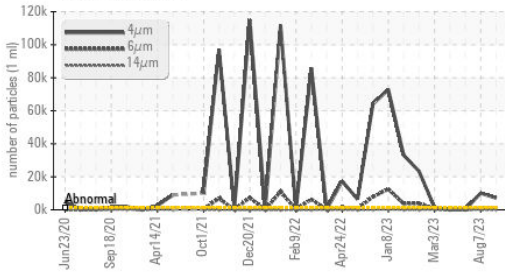


▲ Particle Trend

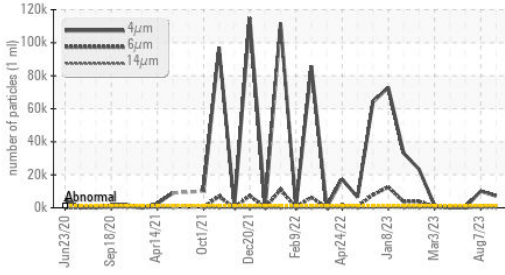

Acid Number

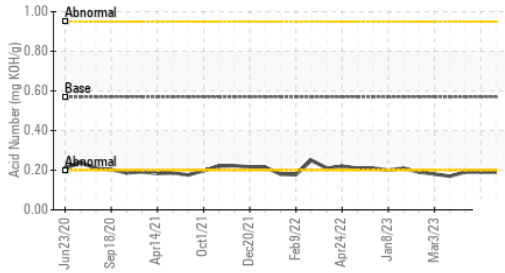


Viscosity @ 40°C

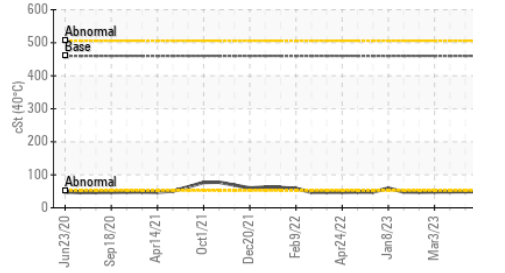

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 460	48.9	49.1	48.8

SAMPLE IMAGES

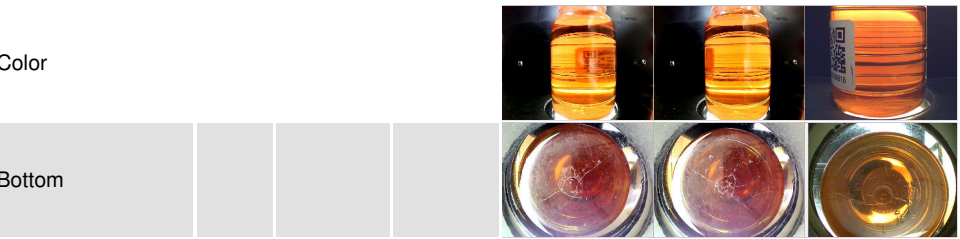


GRAPHS


Ferrous Alloys

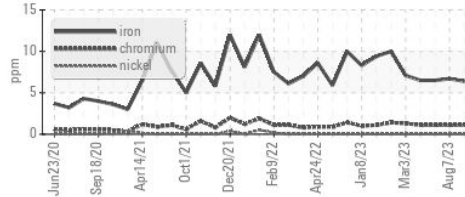


Non-ferrous Metals

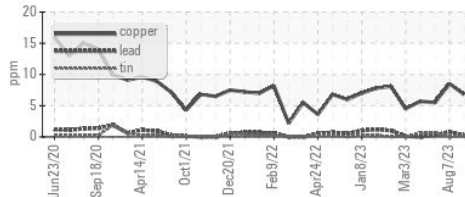


Viscosity @ 40°C

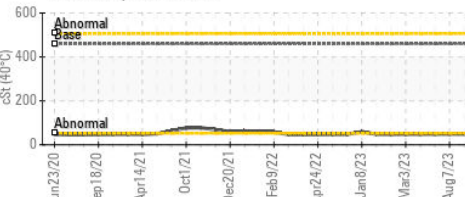

▲ Particle Count

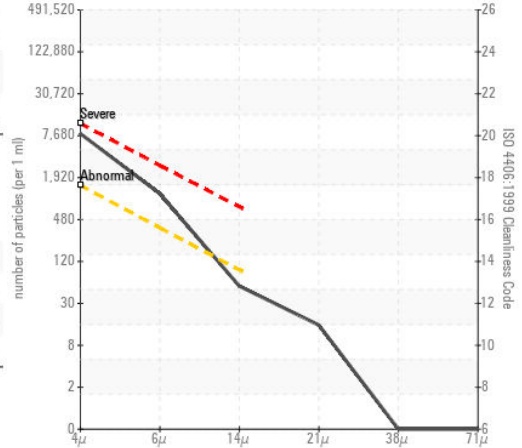

Acid Number

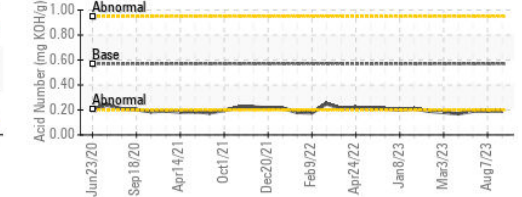

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0101632
Lab Number : 05929566
Unique Number : 10609513
Test Package : IND 2

KraftHeinz - Springfield - Plant 8311 PCA
 2035 E BENNETT
 SPRINGFIELD, MO
 US 65804
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: