

OIL ANALYSIS REPORT


Sample Rating Trend

NORMAL

FRICK FRICK 705 (S/N 200640)

Compressor

PETRO CANADA REFLO SYNTHETIC 68A LOW TEMP FLUID (--- GAL)



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORM | NOITAN | method | limit/base | current | history1 | history2 |
|-------------------------|---------------|-------------|------------|-------------|-------------|-------------|
| Sample Number | | Client Info | | PCA0102073 | PCA0092593 | PCA0067425 |
| Sample Date | | Client Info | | 16 Aug 2023 | 09 Mar 2023 | 10 Aug 2022 |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | | Client Info | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| WEAR METALS | 3 | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | <1 | 0 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | 0 | <1 | 0 |
| Lead | ppm | ASTM D5185m | >25 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | <1 | 0 | 0 |
| Tin | ppm | ASTM D5185m | >15 | <1 | 0 | 0 |
| Antimony | ppm | ASTM D5185m | | | | |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 | <1 |
| Barium | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | 0 | <1 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | 0 | 3 | 0 | 4 |
| Zinc | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Sulfur | ppm | ASTM D5185m | 0 | 56 | 95 | 49 |
| CONTAMINAN [*] | TS | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 2 | 2 | 2 |
| Sodium | ppm | ASTM D5185m | | 2 | 0 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | <1 | 0 |
| Water | % | ASTM D6304 | >0.1 | 0.001 | 0.003 | |
| ppm Water | ppm | ASTM D6304 | >1000 | 11.8 | 32.4 | |
| | ATION | | | | | |
| FLUID DEGRAD | PATION | method | | | | history2 |



OIL ANALYSIS REPORT

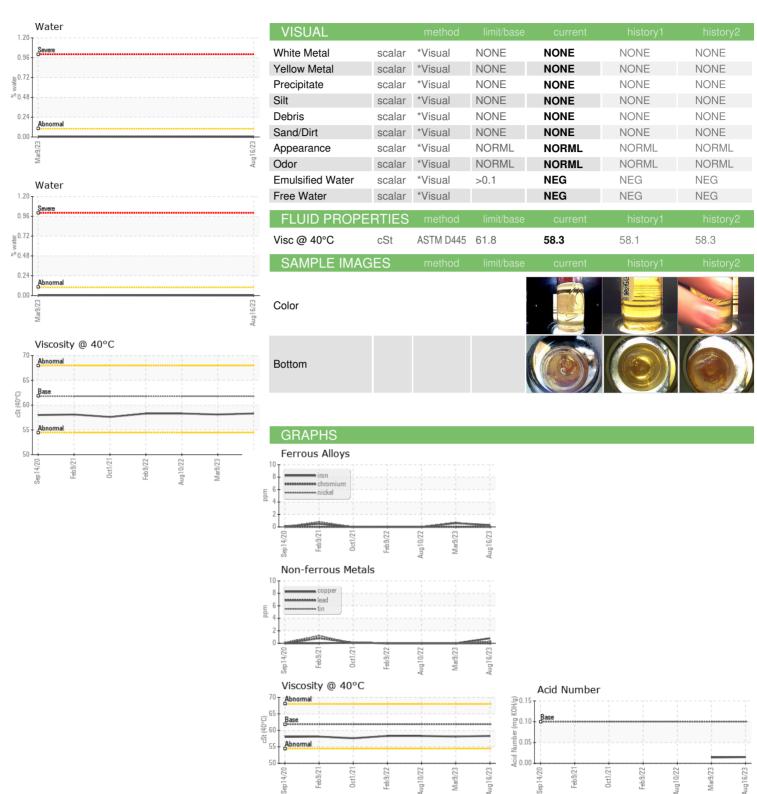





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : PCA0102073 : 05931622

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: 10616893

Received Diagnosed

Diagnostician : Angela Borella Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 22 Aug 2023 : 24 Aug 2023

SMITHFIELD FOODS ONE SWEET APPLEWOOD LANE CUDAHY, WI

US 53110 Contact: PETE LERAY pleray@smithfield.com T: (414)918-3258

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: PETE LERAY - SMICUD

F: