


OIL ANALYSIS REPORT

Pickle Line [Pickle Line] 585130-STEERING UNITS 4- 4A- 5- 6

Hydraulic System

PETRO CANADA HYDREX AW 46 (--- GAL)





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

)		Aug2021 No	2021 Feb2022 May2022	Aug2022 Nov2022 Feb2023 May20	23 Aug ² 023	
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0101454	PCA0095470	PCA0089505
Sample Date		Client Info		22 Aug 2023	01 May 2023	01 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	2	0
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	<1	<1	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>20	0	4	0
Tin	ppm	ASTM D5185m	>20	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	2
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0	0
Magnesium	ppm	ASTM D5185m	0	<1	6	2
Calcium	ppm	ASTM D5185m	50	54	46	60
Phosphorus	ppm	ASTM D5185m	330	337	296	329
Zinc	ppm	ASTM D5185m	430	437	364	432
Sulfur	ppm	ASTM D5185m	760	955	1732	870
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	<1
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
FLUID CLEANI	INESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	2611	△ 36188	3481
Particles >6µm		ASTM D7647	>1300	677	△ 9744	930
Particles >14µm		ASTM D7647	>160	38	▲ 487	27
Particles >21µm		ASTM D7647	>40	8	▲ 84	2
Particles >38µm		ASTM D7647	>10	0	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	19/17/12	<u>22/20/16</u>	19/17/12
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
	1/011/	4 O T 1 4 D O O 4 F				

mg KOH/g ASTM D8045 0.70

Acid Number (AN)


0.23

0.41

0.43



OIL ANALYSIS REPORT

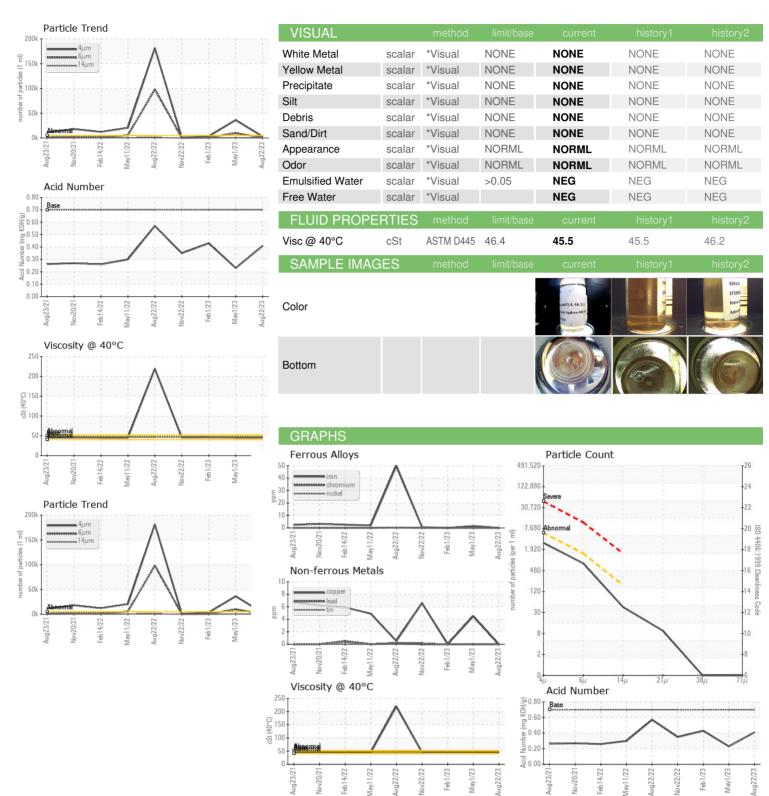





Certificate L2367

Laboratory

Sample No. Lab Number **Unique Number**

: 05932745 : 10618016 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : PCA0101454 Received : 23 Aug 2023

: 25 Aug 2023 Diagnosed : Angela Borella Diagnostician

SDI - Steel DynamicsInc. - Heartland

455 West Industrial Drive Terre Haute, IN US 47802

Contact: BRAD ELLIS brad.ellis@steeldynamics.com

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: SDITER [WUSCAR] 05932745 (Generated: 08/25/2023 17:35:36) Rev: 1

Contact/Location: BRAD ELLIS - SDITER

T:

F: