


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



FRICK FRICK 5 (S/N 202745)

Compressor

PETRO CANADA REFLO SYNTHETIC 68A LOW TEMP FLUID (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		3692020	Feb 2021 Oct 2021	Feb 2022 Aug 2022 Mar 2023	Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0102098	PCA0092587	PCA0067417
Sample Date		Client Info		18 Aug 2023	01 Mar 2023	10 Aug 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	<1	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	0	0	0
Tin	ppm	ASTM D5185m	>15	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	<1	0	0
Calcium	ppm	ASTM D5185m	0	2	0	0
Phosphorus	ppm	ASTM D5185m	0	2	0	4
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	8	15	<1
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	2	1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.1	0.002	0.042	
ppm Water	ppm	ASTM D6304	>1000	16.8	420	
FLUID DEGRAD	OATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.1	0.015	0.015	



OIL ANALYSIS REPORT

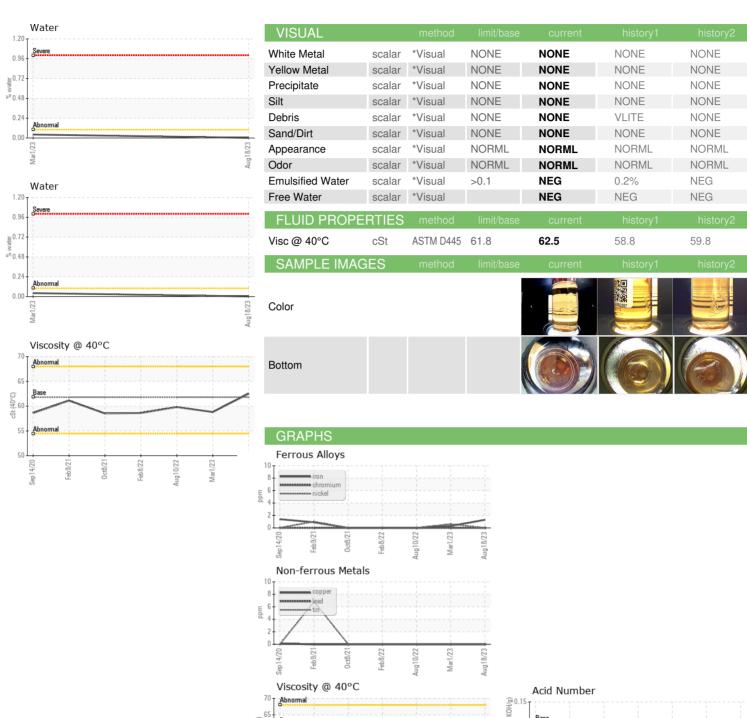





Certificate L2367

Laboratory Sample No.

Lab Number **Unique Number**

: PCA0102098 : 05933744 : 10619015

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

0ct8/21

eb8/22

: 24 Aug 2023 Diagnosed

: 28 Aug 2023

Aug18/23

P 0.1 0.09 0.00 G

Diagnostician : Doug Bogart

Mar1/23

Test Package : IND 2 (Additional Tests: KF) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)



ONE SWEET APPLEWOOD LANE CUDAHY, WI

US 53110 Contact: PETE LERAY

pleray@smithfield.com T: (414)918-3258

F:

Contact/Location: PETE LERAY - SMICUD