

# **OIL ANALYSIS REPORT**

#### Sample Rating Trend


# **NORMAL**

FRICK FRICK 4 (S/N 201366)

Component

Compressor

PETRO CANADA REFLO SYNTHETIC 68A LOW TEMP FLUID (--- GAL)





### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the


#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

`	,	Sep2020	Feb2021 Oct2021	Feb 2022 Aug 2022 Mar 2023	Aug2023	
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0102095	PCA0092586	PCA0067420
Sample Date		Client Info		18 Aug 2023	01 Mar 2023	10 Aug 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	<1	<1
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	0	<1	0
Tin	ppm	ASTM D5185m	>15	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	1
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	<1	0	0
Calcium	ppm	ASTM D5185m	0	2	0	0
Phosphorus	ppm	ASTM D5185m	0	7	<1	3
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	60	38	106
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	2	3
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.1	0.001	0.003	
ppm Water	ppm	ASTM D6304	>1000	6.8	27.8	
FLUID DEGRA	NOITAC	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.1	0.015	0.014	



## **OIL ANALYSIS REPORT**

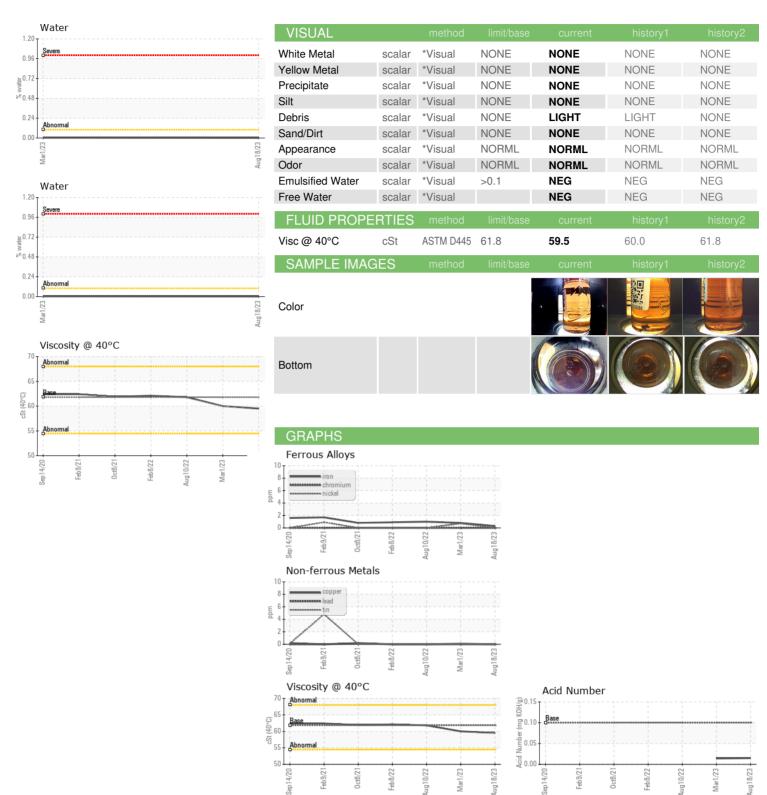





Certificate L2367

Laboratory Sample No. **Unique Number** 

Lab Number

: PCA0102095 : 05933745 : 10619016 Test Package : IND 2 (Additional Tests: KF)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received Diagnosed

: 24 Aug 2023 Diagnostician : Doug Bogart

: 28 Aug 2023

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) **SMITHFIELD FOODS** 

ONE SWEET APPLEWOOD LANE CUDAHY, WI

Contact/Location: PETE LERAY - SMICUD

US 53110 Contact: PETE LERAY

pleray@smithfield.com T: (414)918-3258

F: