


# OIL ANALYSIS REPORT

## Sample Rating Trend

**NORMAL**

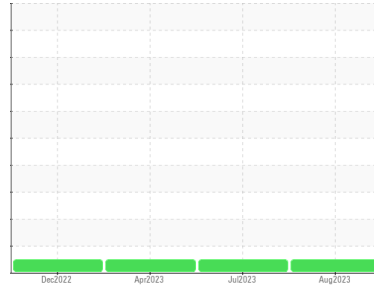

Area  
**(89672X) Walgreens**  
Machine Id  
**[Walgreens] 136A69093**  
Component  
**Diesel Engine**  
Fluid  
**PETRO CANADA DURON SHP 10W30 (11 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0103843</b>	PCA0100187	PCA0094693
Sample Date	Client Info		<b>18 Aug 2023</b>	25 Jul 2023	13 Apr 2023
Machine Age	mls	Client Info	<b>579964</b>	577506	551513
Oil Age	mls	Client Info	<b>51874</b>	49416	23423
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Not Changd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >80	<b>24</b>	21	13
Chromium	ppm	ASTM D5185m >5	<b>1</b>	1	1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >30	<b>12</b>	9	4
Lead	ppm	ASTM D5185m >30	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >150	<b>4</b>	4	3
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 2	<b>1</b>	<1	<1
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 50	<b>67</b>	62	59
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 950	<b>1047</b>	1023	930
Calcium	ppm	ASTM D5185m 1050	<b>1172</b>	1137	1028
Phosphorus	ppm	ASTM D5185m 995	<b>1068</b>	999	1009
Zinc	ppm	ASTM D5185m 1180	<b>1362</b>	1263	1220
Sulfur	ppm	ASTM D5185m 2600	<b>3284</b>	2983	2670

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >20	<b>5</b>	4	3
Sodium	ppm	ASTM D5185m	<b>2</b>	2	2
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	1



### INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0.8</b>	0.8	0.4
Nitration	Abs/cm	*ASTM D7624 >20	<b>10.5</b>	10.2	7.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>24.2</b>	23.3	18.0

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>20.7</b>	19.9	15.4
Base Number (BN)	mg KOH/g	ASTM D2896	<b>5.0</b>	5.7	7.1





# OIL ANALYSIS REPORT

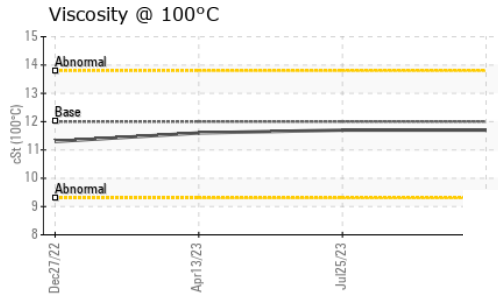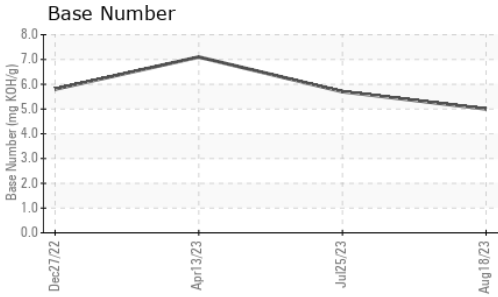

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.00	<b>11.7</b>	11.7

## GRAPHS

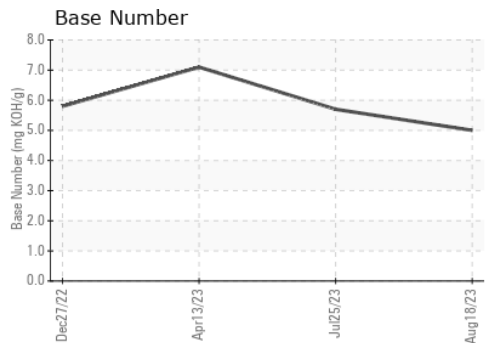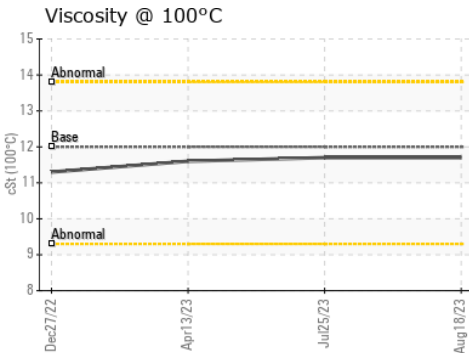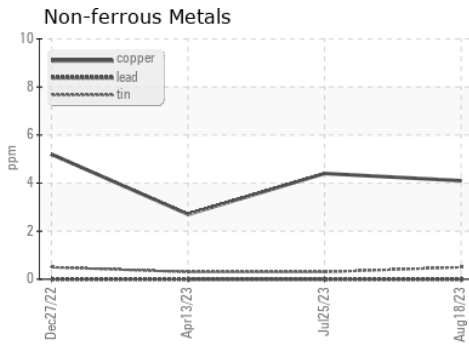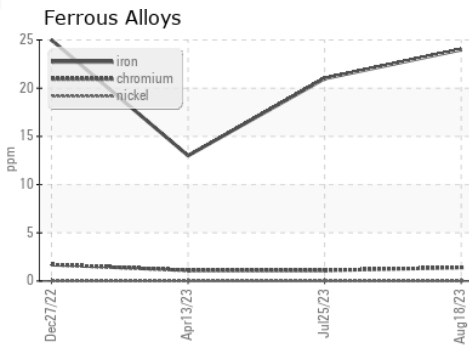

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0103843 **Received** : 24 Aug 2023  
**Lab Number** : **05934046** **Diagnosed** : 25 Aug 2023  
**Unique Number** : 10619317 **Diagnostician** : Wes Davis  
**Test Package** : FLEET

**Transervice - Shop 1364 - Berkeley-Mt. Vernon**  
 5100 Lake Terrace NE  
 Mt. Vernon, IL  
 US 62864  
 Contact: Erien White  
 ewhite@transervice.com  
 T: (618)244-8726  
 F: (618)244-8791

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)