

## **OIL ANALYSIS REPORT**

Sample Rating Trend



ف ف ف د

## Machine Id 3842C

Component Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (46 GAL)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.


## Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| SAMPLE INFORM    | <b>/</b> ATION | method      | limit/base | current     | history1    | history2    |
|------------------|----------------|-------------|------------|-------------|-------------|-------------|
| Sample Number    |                | Client Info |            | GFL0080566  | GFL0066849  | GFL0066858  |
| Sample Date      |                | Client Info |            | 23 Aug 2023 | 21 Jun 2023 | 02 Jun 2023 |
| Machine Age      | hrs            | Client Info |            | 4996        | 4996        | 4996        |
| Oil Age          | hrs            | Client Info |            | 4996        | 4996        | 4996        |
| Oil Changed      |                | Client Info |            | Changed     | Changed     | Changed     |
| Sample Status    |                |             |            | NORMAL      | NORMAL      | NORMAL      |
| WEAR METALS      | S              | method      | limit/base | current     | history1    | history2    |
| Iron             | ppm            | ASTM D5185m | >50        | 11          | 7           | 7           |
| Chromium         | ppm            | ASTM D5185m | >4         | 1           | <1          | <1          |
| Nickel           | ppm            | ASTM D5185m | >2         | 0           | <1          | <1          |
| Titanium         | ppm            | ASTM D5185m |            | 0           | <1          | 0           |
| Silver           | ppm            | ASTM D5185m | >3         | 0           | 0           | 0           |
| Aluminum         | ppm            | ASTM D5185m | >9         | 6           | 2           | 1           |
| Lead             | ppm            | ASTM D5185m | >30        | 15          | <1          | 2           |
| Copper           | ppm            | ASTM D5185m | >35        | 2           | 1           | 1           |
| Tin              | ppm            | ASTM D5185m | >4         | <1          | <1          | 0           |
| Vanadium         | ppm            | ASTM D5185m |            | 0           | 0           | 0           |
| Cadmium          | ppm            | ASTM D5185m |            | 0           | 0           | 0           |
| ADDITIVES        |                | method      | limit/base | current     | history1    | history2    |
| Boron            | ppm            | ASTM D5185m | 50         | 11          | 12          | 7           |
| Barium           | ppm            | ASTM D5185m | 5          | 0           | 0           | 0           |
| Molybdenum       | ppm            | ASTM D5185m | 50         | 59          | 70          | 52          |
| Manganese        | ppm            | ASTM D5185m | 0          | <1          | <1          | <1          |
| Magnesium        | ppm            | ASTM D5185m | 560        | 700         | 695         | 540         |
| Calcium          | ppm            | ASTM D5185m | 1510       | 1784        | 1954        | 1681        |
| Phosphorus       | ppm            | ASTM D5185m | 780        | 857         | 903         | 712         |
| Zinc             | ppm            | ASTM D5185m | 870        | 1102        | 1211        | 1030        |
| Sulfur           | ppm            | ASTM D5185m | 2040       | 3082        | 3408        | 3072        |
| CONTAMINAN       | TS             | method      | limit/base | current     | history1    | history2    |
| Silicon          | ppm            | ASTM D5185m | >+100      | 8           | 9           | 4           |
| Sodium           | ppm            | ASTM D5185m |            | 10          | 7           | 3           |
| Potassium        | ppm            | ASTM D5185m | >20        | <1          | 2           | <1          |
| INFRA-RED        |                | method      | limit/base | current     | history1    | history2    |
| Soot %           | %              | *ASTM D7844 |            | 0           | 0.1         | 0.1         |
| Nitration        | Abs/cm         | *ASTM D7624 | >20        | 11.5        | 11.3        | 11.8        |
| Sulfation        | Abs/.1mm       | *ASTM D7415 | >30        | 26.1        | 22.8        | 23.0        |
| FLUID DEGRAD     | ATION          | method      | limit/base | current     | history1    | history2    |
| Oxidation        | Abs/.1mm       | *ASTM D7414 | >25        | 21.8        | 18.6        | 19.1        |
| Base Number (BN) | mg KOH/g       | ASTM D2896  | 10.2       | 4.1         | 5.0         | 3.4         |
|                  |                |             |            |             |             |             |




# **OIL ANALYSIS REPORT**





| VISUAL           |        | method    | limit/base | current | history1 | history2 |
|------------------|--------|-----------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual   | NONE       | LIGHT   | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual   | NORML      | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual   | NORML      | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual   | >0.1       | NEG     | NEG      | NEG      |
| Free Water       | scalar | *Visual   |            | NEG     | NEG      | NEG      |
| FLUID PROPE      | RTIES  | method    | limit/base | current | history1 | history2 |
| Visc @ 100°C     | cSt    | ASTM D445 | 15.1       | 14.2    | 14.3     | 14.4     |
| GRAPHS           |        |           |            |         |          |          |

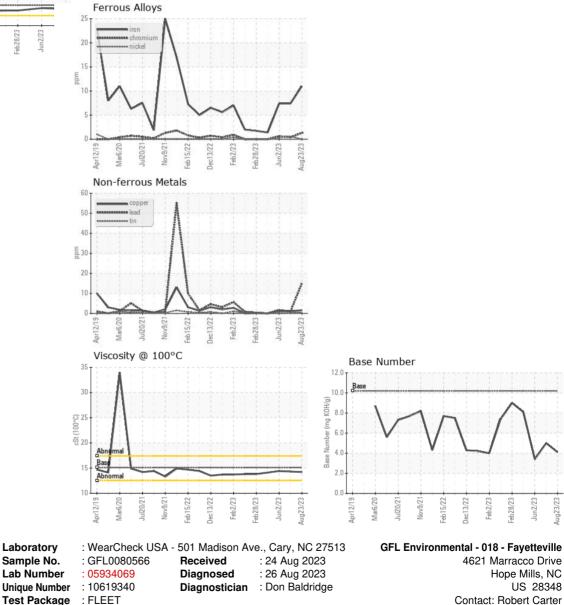



\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

robert.carter@gflenv.com

T: (910)596-1170

ug23/23

F: