

OIL ANALYSIS REPORT



.........

NORMAL



Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (36 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0095834	PCA0095830	PCA0077356
Sample Date		Client Info		28 Aug 2023	27 Jun 2023	03 Nov 2022
Machine Age	hrs	Client Info		16063	15545	13786
Oil Age	hrs	Client Info		518	1759	856
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6	5	4
Chromium	ppm	ASTM D5185m	>4	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	2	2	1
Lead	ppm	ASTM D5185m	>30	7	<1	<1
Copper	ppm	ASTM D5185m	>35	0	1	<1
Tin	ppm	ASTM D5185m	>4	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	8	13	15
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	50	51	55	47
Manganese	ppm	ASTM D5185m	0	<1	<1	<1
Magnesium	ppm	ASTM D5185m	560	599	640	465
Calcium	ppm	ASTM D5185m	1510	1704	1491	1446
Phosphorus	ppm	ASTM D5185m	780	781	782	674
Zinc	ppm	ASTM D5185m	870	1018	1031	801
Sulfur	ppm	ASTM D5185m	2040	3166	3235	2924
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	5	4	6
Sodium	ppm	ASTM D5185m		14	7	7
Potassium	ppm	ASTM D5185m	>20	1	<1	0
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	11.4	9.3	9.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	26.3	21.8	22.0
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	23.7	18.6	17.7
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	2.6	5.2	6.4
	0 0					





OIL ANALYSIS REPORT






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.1	14.0	14.3
GRAPHS						





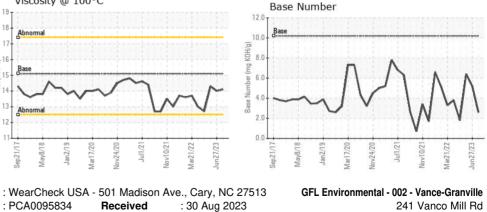

241 Vanco Mill Rd Henderson, NC US 27537 Contact: Cameron King cameron.king@gflenv.com T: (252)438-5333 F: (252)431-1635



Mar17/20 Vov24/20

Received

Diagnosed

Diagnostician

Jov10/21 Mar21/22 Jun27/23

: 30 Aug 2023

: Wes Davis

Abnorm

Mav8/18 lan 2/19

: PCA0095834

: 05938142

: 10628754

12 11

Laboratory

Sample No.

Lab Number

Unique Number

Sep21/17

Submitted By: Cameron King

Page 2 of 2