


# OIL ANALYSIS REPORT

Sample Rating Trend

FUEL

Area  
**Irvington**  
Machine Id  
**Unit 03 DB060103E**  
Component  
**Natural Gas Engine**  
Fluid  
**PETRO CANADA DURON MONOGRADE HD 40W (250 GAL)**

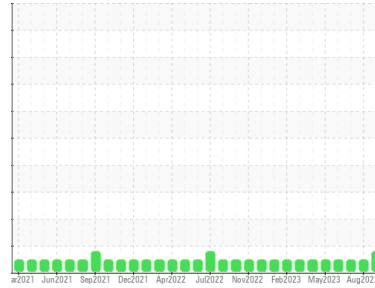

## DIAGNOSIS

**Recommendation**  
We advise that you check the fuel injection system. Resample at the next service interval to monitor. ( Customer Sample Comment: Top Up Amount: 0 GAL )

**Wear**  
All component wear rates are normal.

**Contamination**  
There is a moderate amount of fuel present in the oil.

**Fluid Condition**  
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

| method        | limit/base  | current            | history1    | history2    |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | <b>PCA0105171</b>  | PCA0082299  | PCA0082301  |
| Sample Date   | Client Info | <b>05 Sep 2023</b> | 14 Aug 2023 | 11 Jul 2023 |
| Machine Age   | hrs         | <b>23249</b>       | 23249       | 23037       |
| Oil Age       | hrs         | <b>23249</b>       | 23249       | 23037       |
| Oil Changed   | Client Info | <b>Oil Added</b>   | Oil Added   | Oil Added   |
| Sample Status |             | <b>ABNORMAL</b>    | NORMAL      | NORMAL      |

## WEAR METALS

| method   | limit/base          | current      | history1 | history2 |
|----------|---------------------|--------------|----------|----------|
| Iron     | ppm ASTM D5185m >50 | <b>5</b>     | 4        | 4        |
| Chromium | ppm ASTM D5185m >4  | <b>0</b>     | 0        | <1       |
| Nickel   | ppm ASTM D5185m >2  | <b>0</b>     | 0        | 0        |
| Titanium | ppm ASTM D5185m     | <b>&lt;1</b> | 0        | 0        |
| Silver   | ppm ASTM D5185m >3  | <b>&lt;1</b> | 0        | 0        |
| Aluminum | ppm ASTM D5185m >9  | <b>&lt;1</b> | 0        | 2        |
| Lead     | ppm ASTM D5185m >30 | <b>&lt;1</b> | 0        | <1       |
| Copper   | ppm ASTM D5185m >35 | <b>1</b>     | 0        | 1        |
| Tin      | ppm ASTM D5185m >4  | <b>&lt;1</b> | 0        | <1       |
| Vanadium | ppm ASTM D5185m     | <b>&lt;1</b> | 0        | 0        |
| Cadmium  | ppm ASTM D5185m     | <b>&lt;1</b> | 0        | 0        |

## ADDITIVES

| method     | limit/base      | current      | history1 | history2 |
|------------|-----------------|--------------|----------|----------|
| Boron      | ppm ASTM D5185m | <b>1</b>     | 1        | <1       |
| Barium     | ppm ASTM D5185m | <b>0</b>     | 0        | 0        |
| Molybdenum | ppm ASTM D5185m | <b>3</b>     | <1       | 3        |
| Manganese  | ppm ASTM D5185m | <b>&lt;1</b> | 0        | 0        |
| Magnesium  | ppm ASTM D5185m | <b>924</b>   | 888      | 934      |
| Calcium    | ppm ASTM D5185m | <b>1106</b>  | 1046     | 1095     |
| Phosphorus | ppm ASTM D5185m | <b>1066</b>  | 1067     | 1130     |
| Zinc       | ppm ASTM D5185m | <b>1295</b>  | 1220     | 1332     |
| Sulfur     | ppm ASTM D5185m | <b>3554</b>  | 3368     | 3467     |

## CONTAMINANTS

| method    | limit/base            | current      | history1 | history2 |
|-----------|-----------------------|--------------|----------|----------|
| Silicon   | ppm ASTM D5185m >+100 | <b>8</b>     | 1        | 3        |
| Sodium    | ppm ASTM D5185m       | <b>&lt;1</b> | <1       | 0        |
| Potassium | ppm ASTM D5185m >20   | <b>0</b>     | 0        | 1        |
| Fuel      | % ASTM D3524 >4.0     | <b>▲ 7.7</b> | 1.9      | 1.4      |

## INFRA-RED


| method    | limit/base               | current     | history1 | history2 |
|-----------|--------------------------|-------------|----------|----------|
| Soot %    | % *ASTM D7844            | <b>0.1</b>  | 0.1      | 0.1      |
| Nitration | Abs/cm *ASTM D7624 >20   | <b>4.2</b>  | 4.0      | 4.4      |
| Sulfation | Abs/.1mm *ASTM D7415 >30 | <b>13.4</b> | 12.9     | 13.6     |

## FLUID DEGRADATION


| method           | limit/base               | current     | history1 | history2 |
|------------------|--------------------------|-------------|----------|----------|
| Oxidation        | Abs/.1mm *ASTM D7414 >25 | <b>7.0</b>  | 6.8      | 7.3      |
| Acid Number (AN) | mg KOH/g ASTM D8045      | <b>1.52</b> | 1.52     | 1.54     |
| Base Number (BN) | mg KOH/g ASTM D2896 8.5  | <b>7.95</b> | 9.06     | 9.45     |

# OIL ANALYSIS REPORT


### ▲ Fuel Dilution

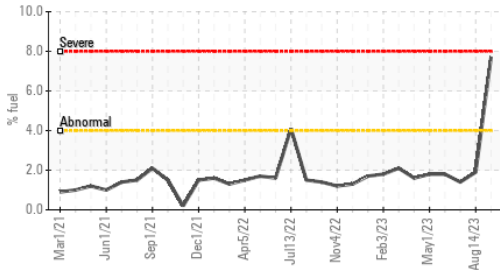


### Acid Number

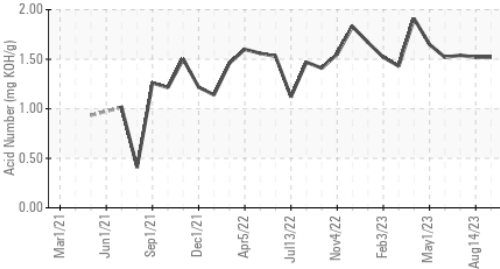

### Base Number

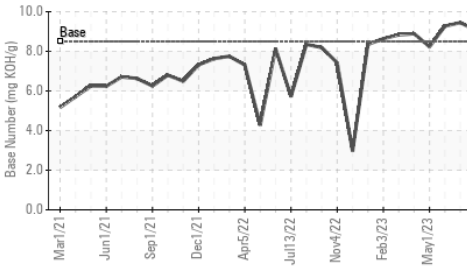

### Viscosity @ 100°C

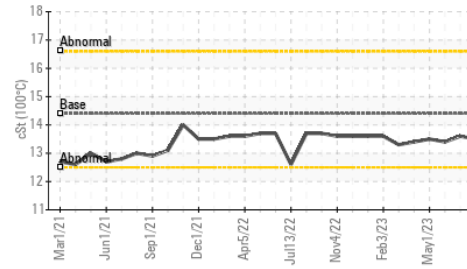


| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C     | cSt    | ASTM D445  | 14.4    | 13.5     | 13.6     |

### GRAPHS


#### Iron (ppm)

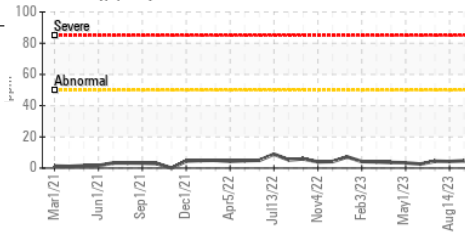


#### Lead (ppm)

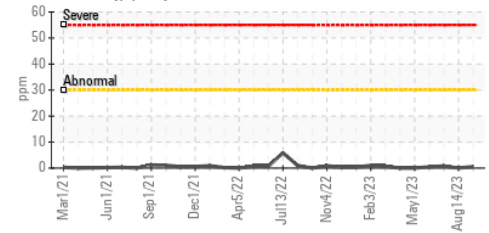


#### Aluminum (ppm)

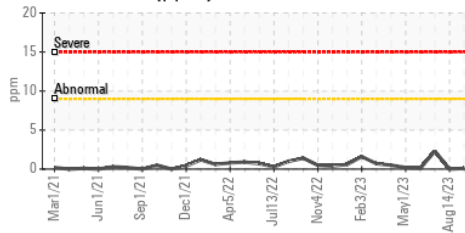


#### Chromium (ppm)

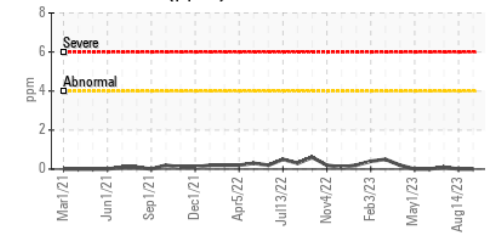


#### Copper (ppm)

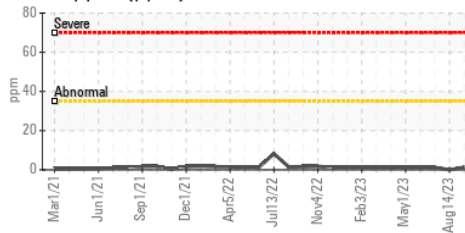


#### Silicon (ppm)

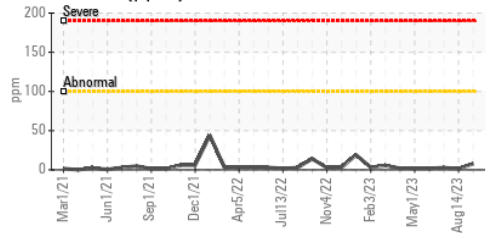

#### Viscosity @ 100°C

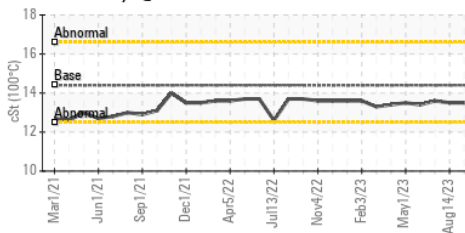

#### Base Number

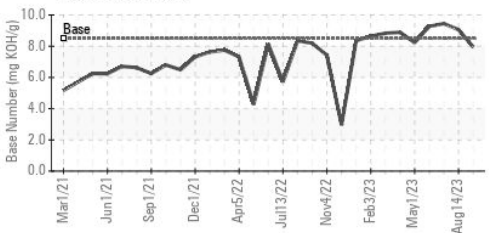

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0105171 **Received** : 08 Sep 2023  
**Lab Number** : 05946648 **Diagnosed** : 12 Sep 2023  
**Unique Number** : 10642607 **Diagnostician** : Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**Magellan Midstream LP - Omaha**  
 9405 Bennington Road  
 Omaha, NE  
 US 68122  
 Contact: Zach Jones  
 zach.jones@magellanlp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: