


Area  
**INDEPENDENCE**  
Machine Id  
**Unit 04 DB200104E**

Component  
**Natural Gas Engine**  
Fluid  
**PETRO CANADA DURON MONOGRADE HD 40W (250 GAL)**

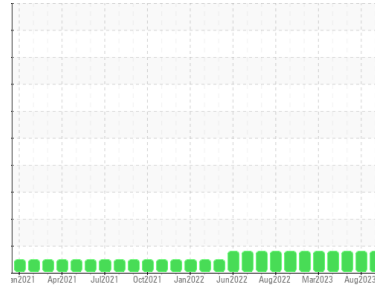

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of fuel present in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0097026</b>	PCA0097020	PCA0097018
Sample Date	Client Info		<b>07 Sep 2023</b>	02 Aug 2023	03 Jul 2023
Machine Age	hrs	Client Info	<b>12990</b>	12889	12841
Oil Age	hrs	Client Info	<b>12990</b>	12889	12841
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Oil Added
Sample Status			<b>ABNORMAL</b>	ABNORMAL	MARGINAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>16</b>	11	15
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >9	<b>&lt;1</b>	1	2
Lead	ppm	ASTM D5185m >30	<b>1</b>	2	2
Copper	ppm	ASTM D5185m >35	<b>2</b>	3	2
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>5</b>	5	6
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>4</b>	4	4
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>975</b>	945	937
Calcium	ppm	ASTM D5185m	<b>1166</b>	1153	1061
Phosphorus	ppm	ASTM D5185m	<b>1065</b>	1119	1035
Zinc	ppm	ASTM D5185m	<b>1376</b>	1355	1276
Sulfur	ppm	ASTM D5185m	<b>3437</b>	3134	3465

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	<b>3</b>	2	2
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	3
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	3
Fuel	%	ASTM D3524 >4.0	<b>▲ 4.0</b>	▲ 4.2	▲ 3.5

## INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>4.9</b>	5.0	5.1
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>14.0</b>	14.3	15.1

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>8.0</b>	8.2	9.6
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.25</b>	1.48	1.56
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>8.45</b>	7.93	9.66

# OIL ANALYSIS REPORT


**▲ Fuel Dilution**

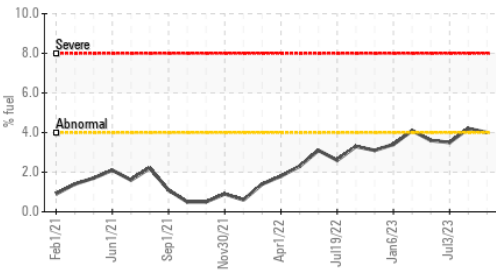


**Acid Number**

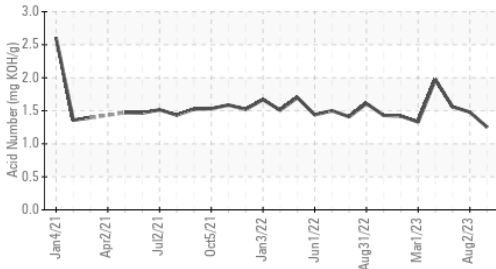

**Base Number**

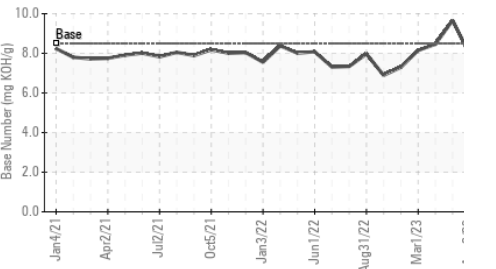

**Viscosity @ 100°C**

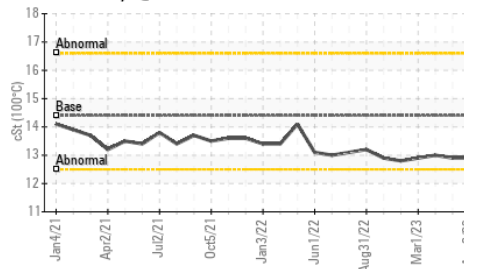


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.9</b>	12.9

**GRAPHS**


**Iron (ppm)**

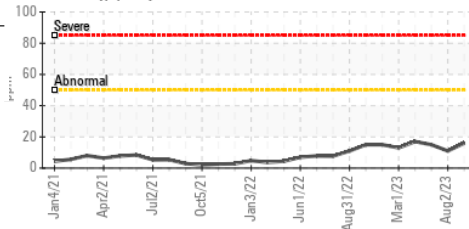


**Lead (ppm)**

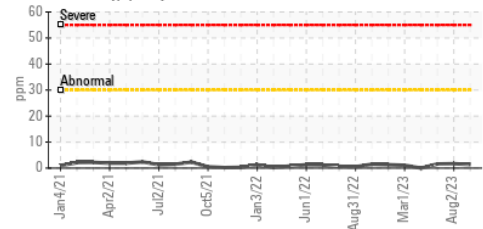


**Aluminum (ppm)**

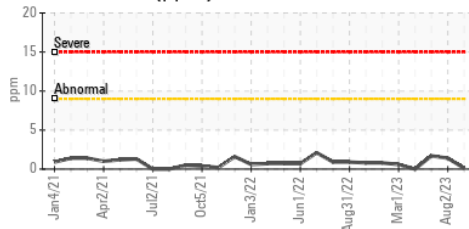


**Chromium (ppm)**

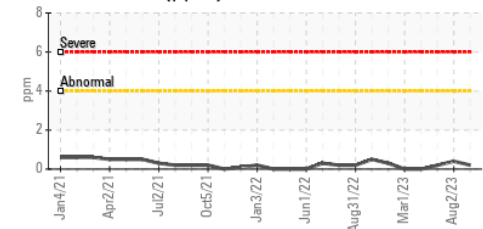


**Copper (ppm)**

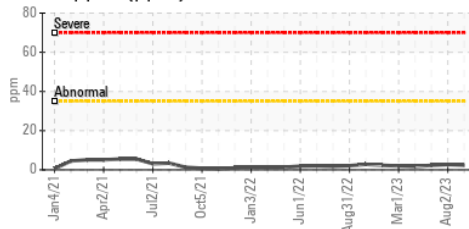


**Silicon (ppm)**

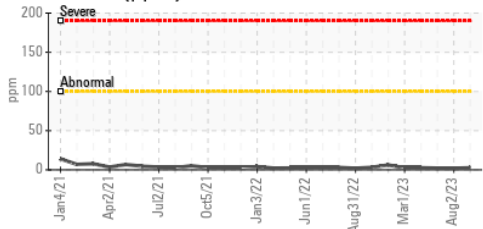

**Viscosity @ 100°C**

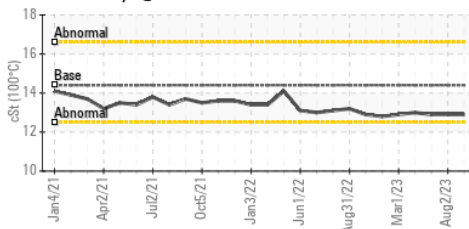

**Base Number**

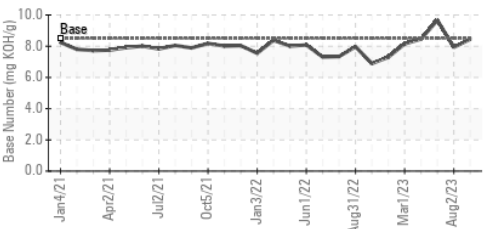

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0097026 **Received** : 12 Sep 2023  
**Lab Number** : 05948196 **Diagnosed** : 18 Sep 2023  
**Unique Number** : 10644155 **Diagnostician** : Jonathan Hester  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**Magellan Midstream LP - Independence**  
 836 South Rosser Road  
 Independence, KS  
 US 67301  
 Contact: Heath James  
 heath.james@magellanlp.com  
 T: (620)779-2040  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)