

OIL ANALYSIS REPORT

TPO - Top Extruder Screen Changer [T3286] SCREEN CHANGER T3286

Hydraulic System

PETRO CANADA HYDREX AW 46 (200 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





NORMAL

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0106220		
Sample Date		Client Info		13 Sep 2023		
Machine Age	yrs	Client Info		3		
Oil Age	yrs	Client Info		3		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	<1		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	2		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0	<1		
Magnesium	ppm	ASTM D5185m	0	<1		
Calcium	ppm	ASTM D5185m	50	37		
Phosphorus	ppm	ASTM D5185m	330	131		
Zinc	ppm	ASTM D5185m	430	64		
Sulfur	ppm	ASTM D5185m	760	11207		
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID CLEANL	INESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	4100		
Particles >6µm		ASTM D7647	>1300	456		
Particles >14µm		ASTM D7647	>160	10		
Particles >21µm		ASTM D7647		2		
Particles >38µm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	19/16/10		
FLUID DEGRAD	DATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.70	0.12		



OIL ANALYSIS REPORT

scalar

Received

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

Diagnostician


: 15 Sep 2023


: 20 Sep 2023

: Jonathan Hester

VISUAL

White Metal





Viscosity @ 40°C

54

-*3 44

47

6

Ê 5k

harticles (1 n 85


21 21

> n. Sep13/23

Ab 40 38

Sep 1

Particle Trend

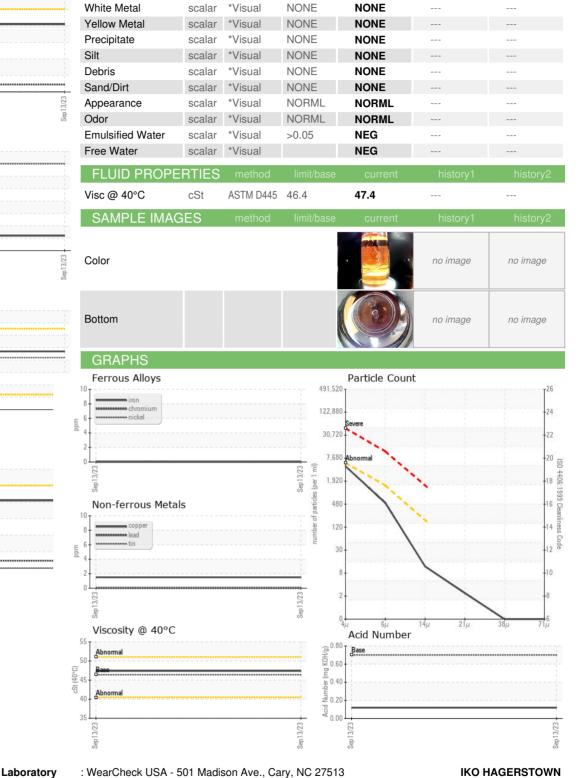

NONE

NONE

Certificate L2367

Sample No.

Lab Number

Unique Number

Test Package : PLANT

: PCA0106220

: 05952732

: 10648691

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Submitted By: LUIS FERNANDEZ

Page 2 of 2

160 IKO WAY

US 21740

F:

HAGERSTOWN, MD

Contact: LUIS FERNANDEZ

luis.fernandez@iko.com

T: (240)267-4100