


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

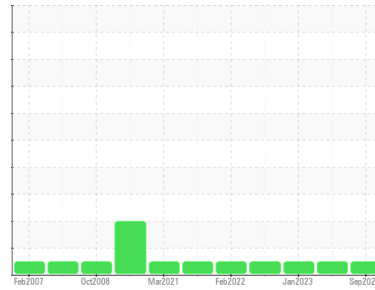

Area  
**Grinding Room**  
 Machine Id  
**PUMPS 6 & 7 BARRELLIFT**  
 Component  
**Hydraulic System**  
 Fluid  
**MOBIL DTE 25 (60 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0099632</b>	PCA0092045	PCA0080241
Sample Date	Client Info	<b>08 Sep 2023</b>	08 May 2023	17 Jan 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>20	<b>8</b>	10	15
Chromium ppm ASTM D5185m	>20	<b>0</b>	0	0
Nickel ppm ASTM D5185m	>20	<b>0</b>	0	0
Titanium ppm ASTM D5185m		<b>0</b>	0	0
Silver ppm ASTM D5185m		<b>0</b>	0	0
Aluminum ppm ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Lead ppm ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Copper ppm ASTM D5185m	>20	<b>6</b>	7	10
Tin ppm ASTM D5185m	>20	<b>0</b>	<1	0
Vanadium ppm ASTM D5185m		<b>0</b>	0	0
Cadmium ppm ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	0	0
Barium ppm ASTM D5185m		<b>0</b>	2	1
Molybdenum ppm ASTM D5185m		<b>2</b>	3	5
Manganese ppm ASTM D5185m		<b>0</b>	0	<1
Magnesium ppm ASTM D5185m		<b>1</b>	1	1
Calcium ppm ASTM D5185m		<b>79</b>	91	101
Phosphorus ppm ASTM D5185m		<b>345</b>	376	422
Zinc ppm ASTM D5185m		<b>531</b>	570	614
Sulfur ppm ASTM D5185m		<b>1844</b>	2348	2847

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	<b>&lt;1</b>	<1	2
Sodium ppm ASTM D5185m		<b>3</b>	4	6
Potassium ppm ASTM D5185m	>20	<b>2</b>	4	3





## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>10000	<b>792</b>	335	342
Particles >6µm ASTM D7647	>2500	<b>187</b>	59	98
Particles >14µm ASTM D7647	>640	<b>19</b>	5	8
Particles >21µm ASTM D7647	>160	<b>6</b>	0	2
Particles >38µm ASTM D7647	>40	<b>0</b>	0	0
Particles >71µm ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness ISO 4406 (c)	>20/18/16	<b>17/15/11</b>	16/13/10	16/14/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.75</b>	0.71	1.00


# OIL ANALYSIS REPORT

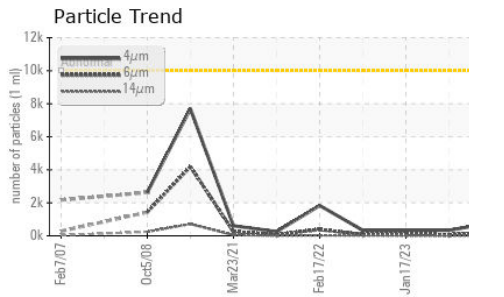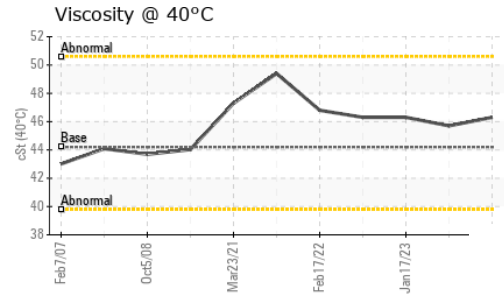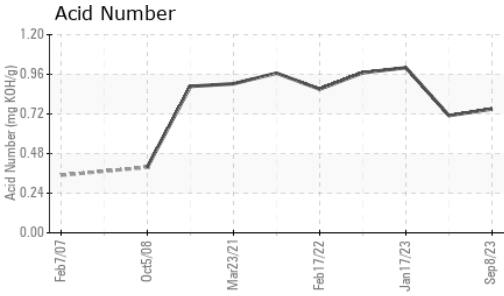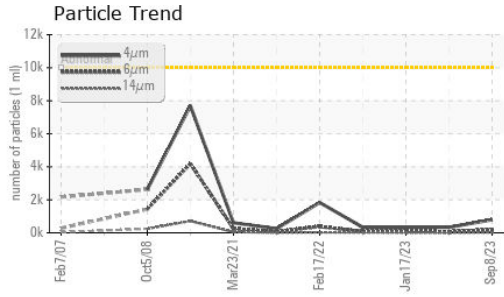






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	46.3	45.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

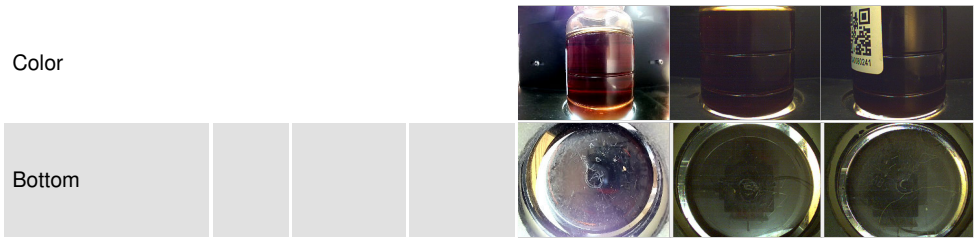

## GRAPHS

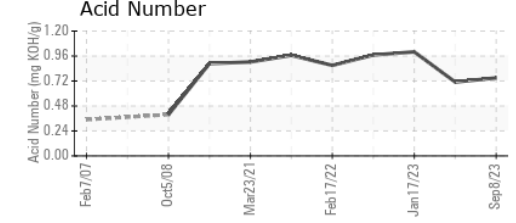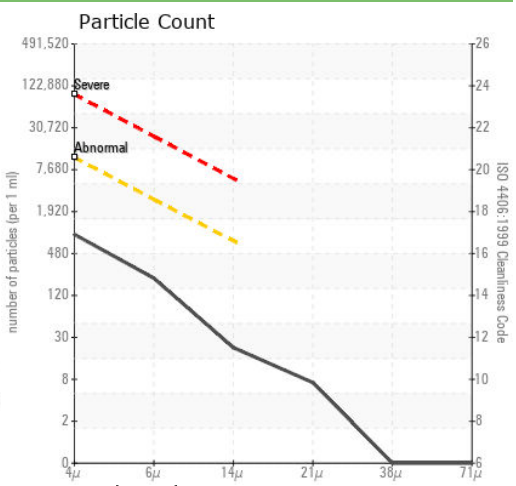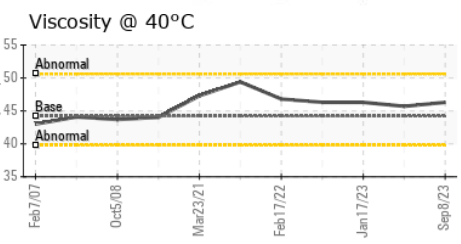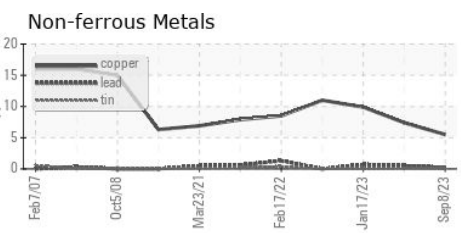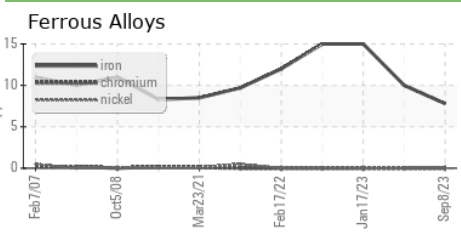

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0099632  
**Lab Number** : 05957582  
**Unique Number** : 10658795  
**Test Package** : IND 2

**KraftHeinz - New Ulm - Plant 8302**  
 2525 S BRIDGE STREET  
 NEW ULM, MN  
 US 56073  
 Contact: RYAN SCHMID  
 ryan.schmid@kraftheinz.com  
 T: (507)568-0338  
 F: (507)354-7927

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)