

Machine Id  
**M7 (S/N 1457487)**

Component  
**Biogas Engine**

Fluid  
**PETRO CANADA SENTRON LD 8000 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

Fuel content negligible. There is no indication of any contamination in the oil.

**Fluid Condition**

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0106177</b>	PCA0096512	PCA0096509
Sample Date	Client Info			<b>03 Oct 2023</b>	12 Sep 2023	19 Aug 2023
Machine Age	hrs	Client Info		<b>7088</b>	6588	6088
Oil Age	hrs	Client Info		<b>4279</b>	3779	3279
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	<b>13</b>	12	12
Chromium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	<1	2
Lead	ppm	ASTM D5185m	>5	<b>2</b>	1	<1
Copper	ppm	ASTM D5185m	>14	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m	>13	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>1</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>11</b>	14	13
Calcium	ppm	ASTM D5185m	1351	<b>1841</b>	1970	1996
Phosphorus	ppm	ASTM D5185m	302	<b>339</b>	357	369
Zinc	ppm	ASTM D5185m	358	<b>459</b>	448	485
Sulfur	ppm	ASTM D5185m	2758	<b>3385</b>	3765	4189


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	<b>4</b>	4	4
Sodium	ppm	ASTM D5185m		<b>17</b>	20	21
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	<1
Fuel	%	ASTM D3524	>4.0	<b>0.2</b>	0.5	0.4

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.1</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.3</b>	7.6	6.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>21.8</b>	25.9	21.1


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.0</b>	18.6	14.9
Acid Number (AN)	mg KOH/g	ASTM D8045	0.86	<b>1.52</b>	1.48	1.46
Base Number (BN)	mg KOH/g	ASTM D2896	4.64	<b>4.12</b>	2.18	4.25

# OIL ANALYSIS REPORT


## Fuel Dilution

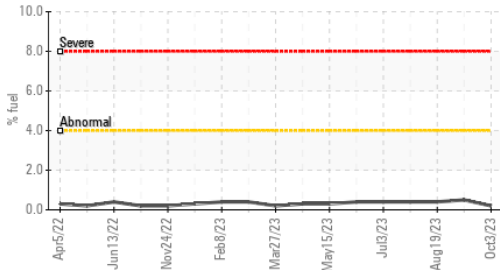


## Acid Number

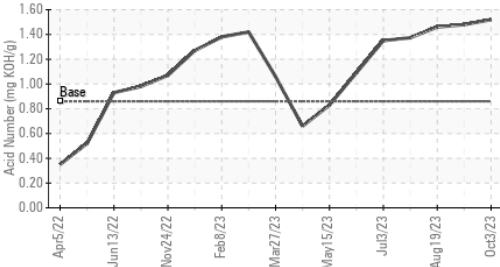

## Base Number

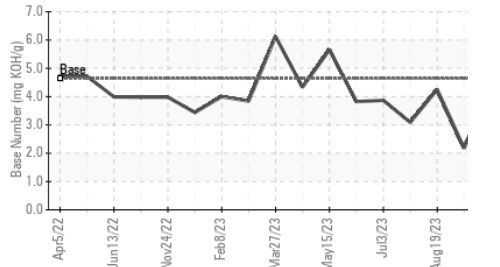

## Viscosity @ 100°C

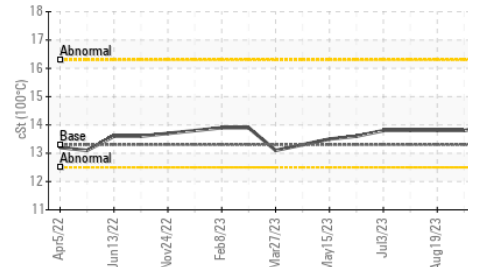


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


PARAMETER	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.3	14.0	13.8

## GRAPHS


### Iron (ppm)

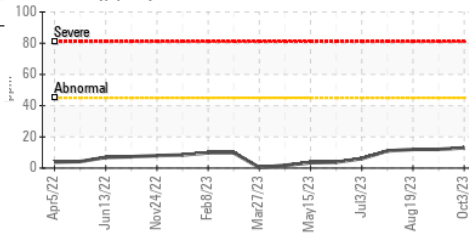


### Lead (ppm)

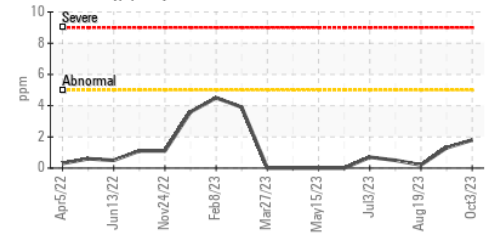


### Aluminum (ppm)

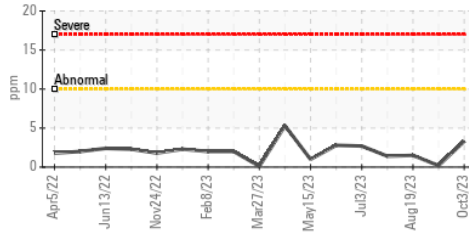


### Chromium (ppm)

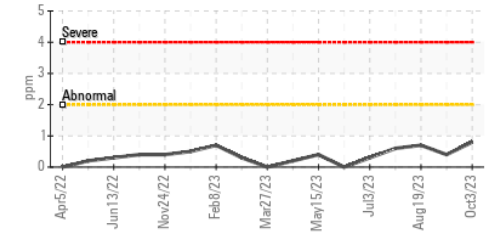


### Copper (ppm)

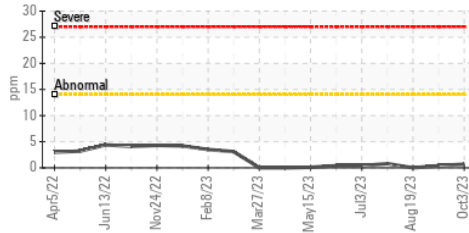


### Silicon (ppm)

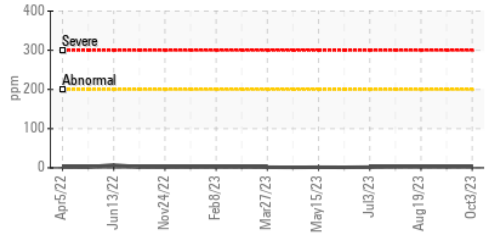

### Viscosity @ 100°C

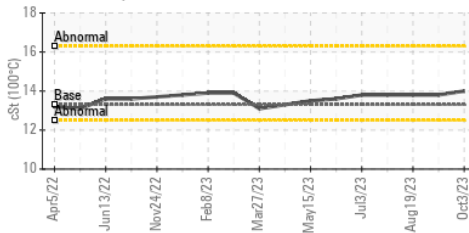

### Base Number

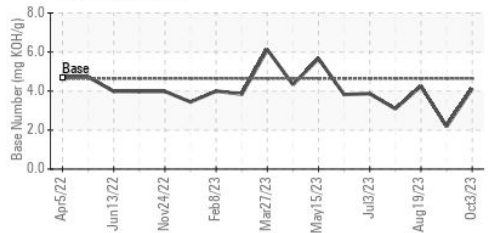

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0106177  
**Lab Number** : 05969786  
**Unique Number** : 10681736  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**AMERICAN PETROLEUM**  
 CARR 865 KM 0.2 CAMPANILA  
 TOA BAJA, PR  
 US 00949  
 Contact: NEFTALI ORTIZ  
 nortiz@americanpetroleumpr.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (787)794-1985

F: