


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL





	SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
	Sample Number		Client Info		GFL0090103	GFL0090117	GFL0074974
val to monitor.	Sample Date		Client Info		18 Oct 2023	12 Oct 2023	21 Sep 2023
	Machine Age	hrs	Client Info		14812	14680	14619
nal.	Oil Age	hrs	Client Info		132	600	600
	Oil Changed		Client Info		Not Changd	Changed	Changed
mination in the	Sample Status				NORMAL	NORMAL	ABNORMAL
	WEAR METAL	S	method	limit/base	current	history1	history2
is suitable	Iron	ppm	ASTM D5185m	>50	3	4	14
condition of the	Chromium	ppm	ASTM D5185m	>4	<1	<1	2
	Nickel	ppm	ASTM D5185m	>2	0	<1	1
	Titanium	ppm	ASTM D5185m		<1	<1	<1
	Silver	ppm	ASTM D5185m	>3	0	0	0
	Aluminum	ppm	ASTM D5185m	>9	<1	2	4
	Lead	ppm	ASTM D5185m	>30	0	0	2
	Copper	ppm	ASTM D5185m	>35	<1	<1	<1
	Tin	ppm	ASTM D5185m	>4	0	<1	<1
	Vanadium	ppm	ASTM D5185m		<1	<1	0
	Cadmium	ppm	ASTM D5185m		0	<1	0
	ADDITIVES		method	limit/base	current	history1	history2
	Boron	ppm	ASTM D5185m	50	47	39	29
	Barium	ppm	ASTM D5185m	5	0	10	0
	Molybdenum	ppm	ASTM D5185m	50	46	46	51
	Manganese	ppm	ASTM D5185m	0	<1	<1	<1
	Magnesium	ppm	ASTM D5185m	560	507	499	549
	Calcium	ppm	ASTM D5185m	1510	1440	1393	1565
	Phosphorus	ppm	ASTM D5185m	780	661	739	789
	Zinc	ppm	ASTM D5185m	870	843	841	970
	Sulfur	ppm	ASTM D5185m	2040	2246	2355	2775
	CONTAMINAN	ITS	method	limit/base	current	history1	history2
	Silicon	ppm	ASTM D5185m	>+100	11	4	8
	Sodium	ppm	ASTM D5185m		5	2	12
	Potassium	ppm	ASTM D5185m	>20	0	1	▲ 127
	INFRA-RED		method	limit/base	current	history1	history2
	Soot %	%	*ASTM D7844		0	0	0
	Nitration	Abs/cm	*ASTM D7624	>20	6.2	6.4	7.5
	Sulfation	Abs/.1mm	*ASTM D7415		18.7	18.4	18.9
	FLUID DEGRA	DATION	method	limit/base	current	history1	history2
	Oxidation	Abs/.1mm	*ASTM D7414	>25	15.6	15.3	16.1
	Base Number (BN)	mg KOH/g	ASTM D2896	10.2	9.0	8.1	7.7
	()	0 - "0					

Machine Id 3760C

Component **Natural Gas Engine**

PETRO CANADA DURON GEO LD 15W40 (40 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interv

Wear

All component wear rates are norma

Contamination


There is no indication of any contar oil.


Fluid Condition

The BN result indicates that there is alkalinity remaining in the oil. The co oil is suitable for further service.




OIL ANALYSIS REPORT





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.3	14.7	14.8
GRAPHS						

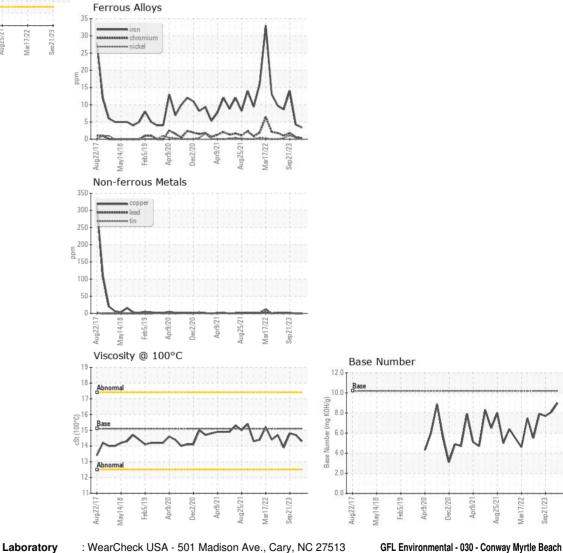

: 03 Nov 2023

: 06 Nov 2023

: Wes Davis



Test Package : FLEET Contact: CHET STROSCHINE Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

Diagnostician

: GFL0090103

: 05997766

Sample No.

Lab Number

Unique Number : 10726126

Submitted By: CHET STROSCHINE

Sep21/23

Mar17/22

3010 HWY 378

cstroschine@gflenv.com

Conway, SC

US 29527

Т:

F: