


# OIL ANALYSIS REPORT

Sample Rating Trend



**FUEL**

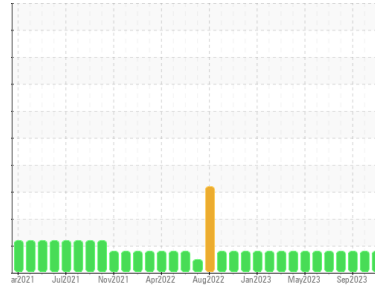

Area  
**Irvington**  
Machine Id  
**Unit 02 DB060102E**  
Component  
**Natural Gas Engine**  
Fluid  
**PETRO CANADA DURON MONOGRADE HD 40W (250 GAL)**

## DIAGNOSIS

### Recommendation

We advise that you check the fuel injection system. Resample at the next service interval to monitor. ( Customer Sample Comment: Top Up Amount: 19 GAL )

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of fuel present in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0105168</b>	PCA0105170	PCA0105172
Sample Date	Client Info	<b>01 Nov 2023</b>	03 Oct 2023	05 Sep 2023
Machine Age	hrs	<b>26033</b>	25292	24941
Oil Age	hrs	<b>17605</b>	16864	16513
Oil Changed	Client Info	<b>Oil Added</b>	Oil Added	Oil Added
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>12</b>	13	13
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >9	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m >30	<b>11</b>	12	12
Copper	ppm	ASTM D5185m >35	<b>11</b>	12	11
Tin	ppm	ASTM D5185m >4	<b>2</b>	2	2
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>16</b>	15	16
Barium	ppm	ASTM D5185m	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>5</b>	5	4
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>743</b>	712	754
Calcium	ppm	ASTM D5185m	<b>1107</b>	1093	1162
Phosphorus	ppm	ASTM D5185m	<b>826</b>	869	828
Zinc	ppm	ASTM D5185m	<b>1117</b>	1125	1106
Sulfur	ppm	ASTM D5185m	<b>2051</b>	2249	2360

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >+100	<b>4</b>	2	2
Sodium	ppm	ASTM D5185m	<b>7</b>	2	6
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	<1
Fuel	%	ASTM D3524 >4.0	<b>▲ 6.2</b>	▲ 5.3	▲ 7.2





## INFRA-RED

method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>6.9</b>	6.8	7.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>17.0</b>	16.7	16.9

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>11.0</b>	10.7	10.8
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.03</b>	1.08	1.08
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>6.91</b>	8.52	7.15






# OIL ANALYSIS REPORT

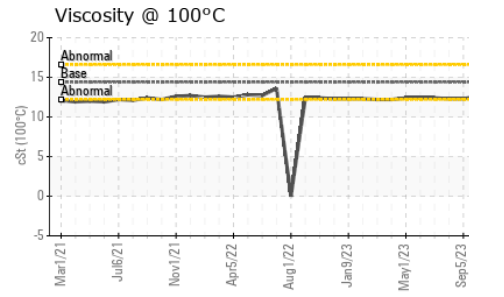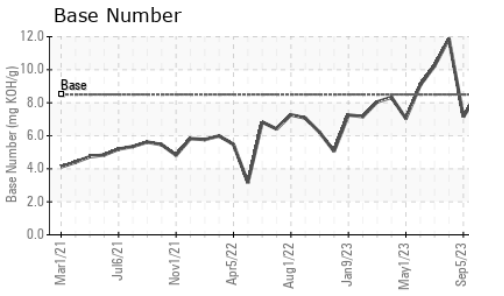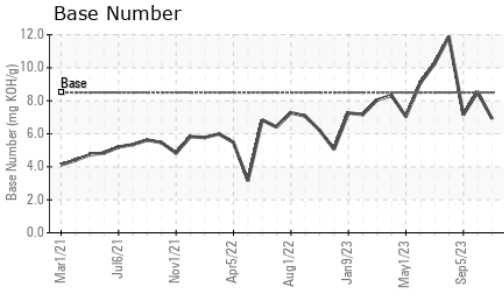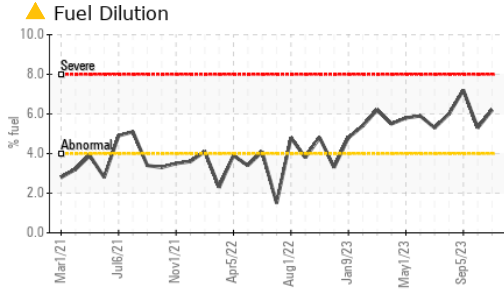

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	12.5	12.6	12.3

### GRAPHS

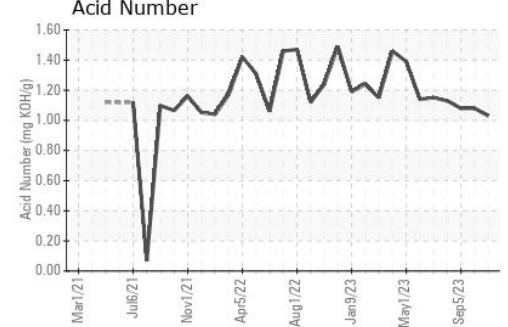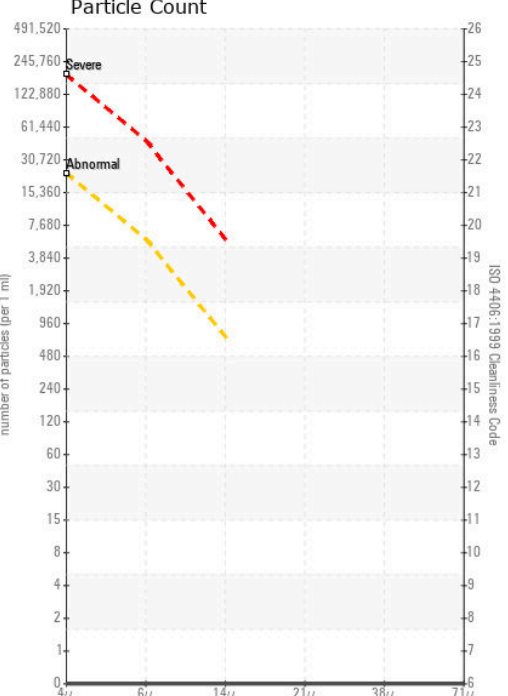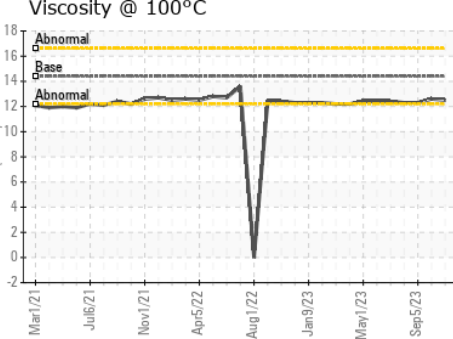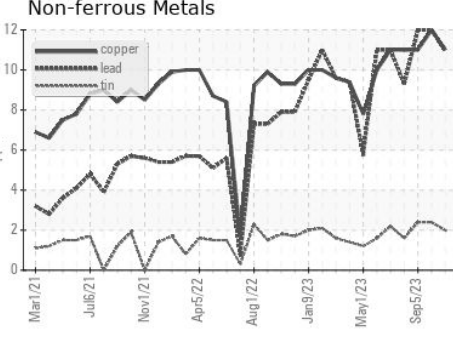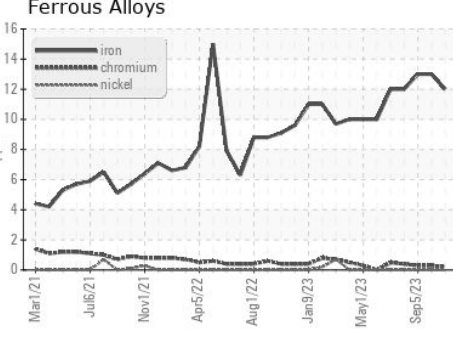

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0105168 **Received** : 06 Nov 2023  
**Lab Number** : 06000008 **Diagnosed** : 08 Nov 2023  
**Unique Number** : 10728368 **Diagnostician** : Sean Felton  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel, PrtCount )

**Magellan Midstream LP - Omaha**  
 9405 Bennington Road  
 Omaha, NE  
 US 68122  
 Contact: Zach Jones  
 zach.jones@magellanlp.com  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)