




# PROBLEM SUMMARY


Sample Rating Trend

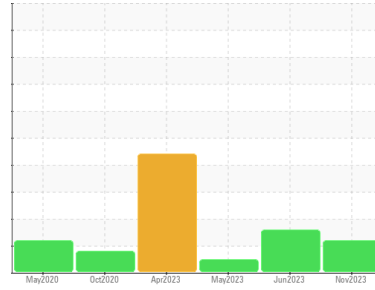

Area  
**PASTA [98543551]**  
 Machine Id  
**B PRESS MAIN MIXER ROTOMISSION**  
 Component  
**Gearbox**  
 Fluid  
**GEAR OIL ISO 150 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

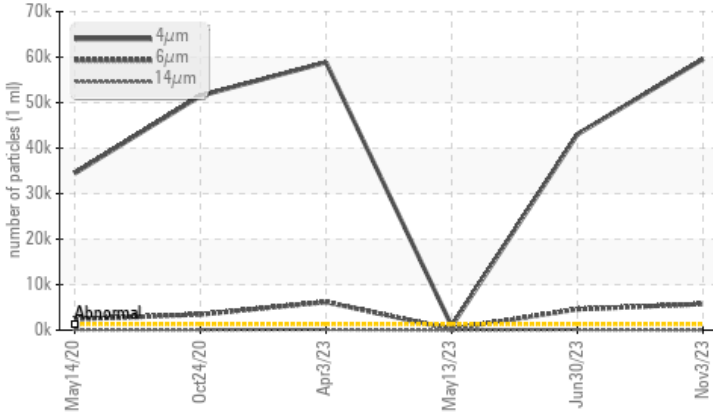

## RECOMMENDATION

The oil change at the time of sampling has been noted. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	NORMAL
Particles >4µm	ASTM D7647 >1300	▲ 59563	▲ 43029	888
Particles >6µm	ASTM D7647 >320	▲ 5754	▲ 4600	210
Oil Cleanliness	ISO 4406 (c) >17/15/13	▲ 23/20/12	▲ 23/19/14	17/15/12

Customer Id: KRASPRMO  
 Sample No.: PCA0111807  
 Lab Number: 06005545  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

## HISTORICAL DIAGNOSIS

### 30 Jun 2023 Diag: Don Baldrige

ISO



The oil change at the time of sampling has been noted. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 13 May 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 03 Apr 2023 Diag: Doug Bogart

ISO




The oil change at the time of sampling has been noted. We recommend an early resample to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



Area  
**PASTA [98543551]**  
 Machine Id  
**B PRESS MAIN MIXER ROTOMISSION**  
 Component  
**Gearbox**  
 Fluid  
**GEAR OIL ISO 150 (--- GAL)**

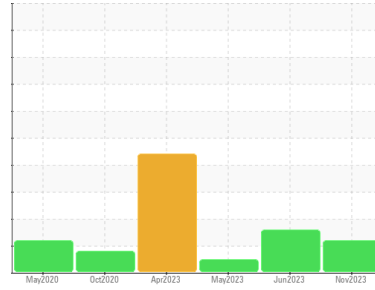

## DIAGNOSIS

**Recommendation**  
 The oil change at the time of sampling has been noted. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0111807</b>	PCA0099600	PCA0076161
Sample Date	Client Info	<b>03 Nov 2023</b>	30 Jun 2023	13 May 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>Changed</b>	Changed	Changed
Sample Status		<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >200	<b>5</b>	4	0
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	1	<1
Lead	ppm	ASTM D5185m >100	<b>67</b>	38	<1
Copper	ppm	ASTM D5185m >200	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >25	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 50	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 15	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 15	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 50	<b>0</b>	0	10
Calcium	ppm	ASTM D5185m 50	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 350	<b>56</b>	97	119
Zinc	ppm	ASTM D5185m 100	<b>0</b>	0	6
Sulfur	ppm	ASTM D5185m 12500	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	<b>3</b>	2	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	<1

## FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	<b>▲ 59563</b>	▲ 43029	888
Particles >6µm	ASTM D7647 >320	<b>▲ 5754</b>	▲ 4600	210
Particles >14µm	ASTM D7647 >80	<b>37</b>	▲ 113	23
Particles >21µm	ASTM D7647 >20	<b>9</b>	19	8
Particles >38µm	ASTM D7647 >4	<b>3</b>	0	0
Particles >71µm	ASTM D7647 >3	<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c) >17/15/13	<b>▲ 23/20/12</b>	▲ 23/19/14	17/15/12

## FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.85	<b>0.28</b>	0.34	0.37

# OIL ANALYSIS REPORT


▲ Particle Trend

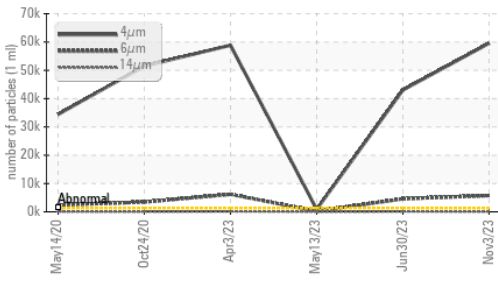


▲ Particle Trend

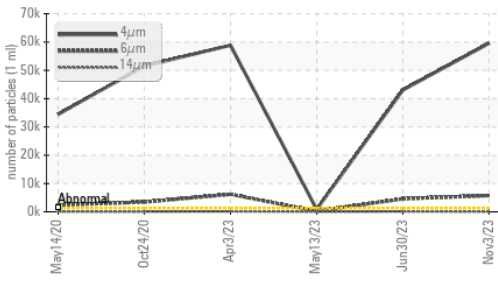

Acid Number

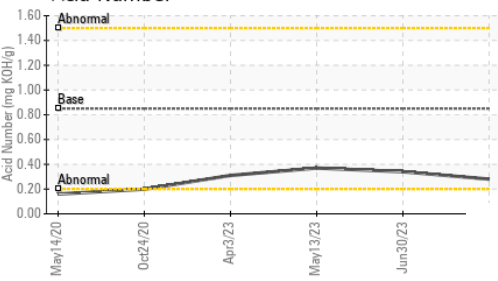


Viscosity @ 40°C

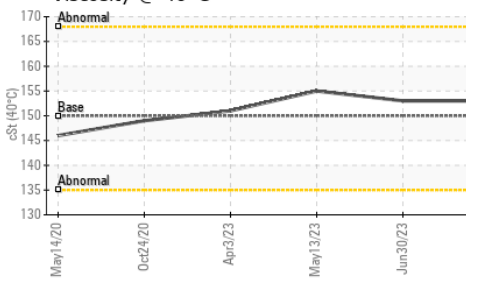






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	153	155

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

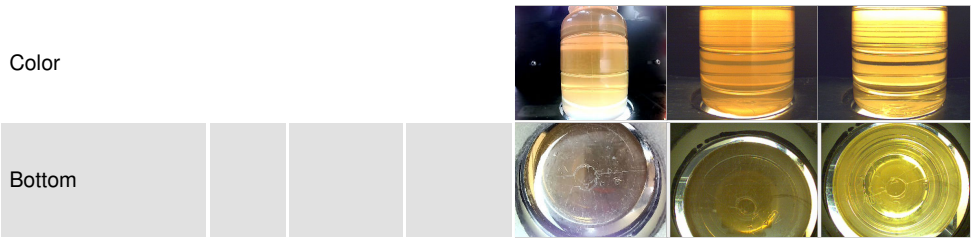

## GRAPHS

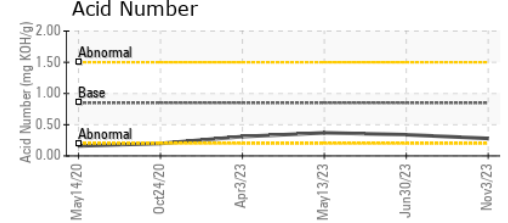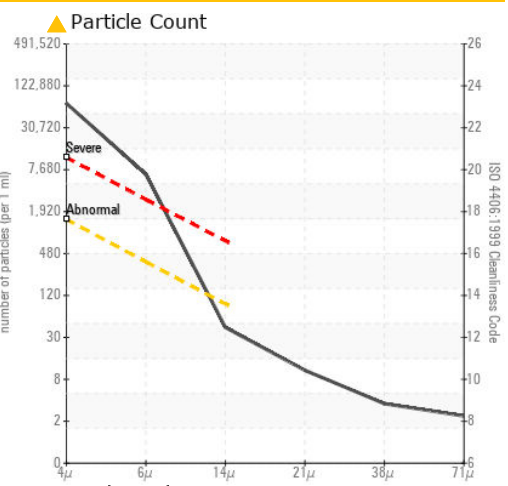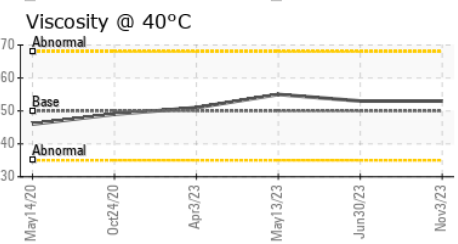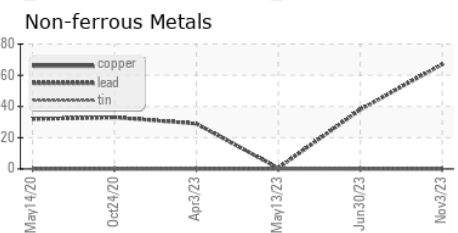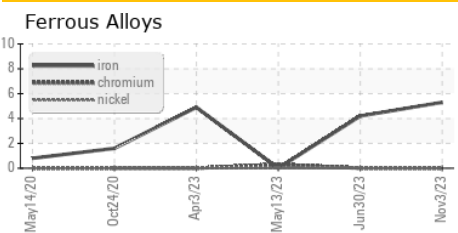

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0111807 **Received** : 13 Nov 2023  
**Lab Number** : 06005545 **Diagnosed** : 15 Nov 2023  
**Unique Number** : 10739307 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**KraftHeinz - Springfield - Plant 8311 PCA**  
 2035 E BENNETT  
 SPRINGFIELD, MO  
 US 65804  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)