


OIL ANALYSIS REPORT

Sample Rating Trend



WEAR

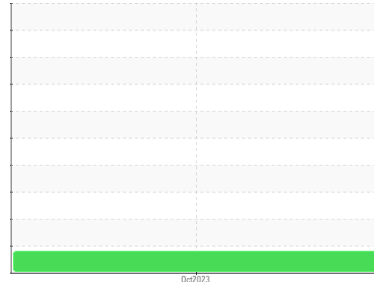

Machine Id
2423
Component
Biogas Engine
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

▲ Wear

Cylinder, crank, or cam shaft wear is indicated.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0099796	---	---
Sample Date	Client Info		25 Oct 2023	---	---
Machine Age	hrs	Client Info	46155	---	---
Oil Age	hrs	Client Info	836	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >45	▲ 74	---	---
Chromium	ppm	ASTM D5185m >2	0	---	---
Nickel	ppm	ASTM D5185m >2	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >5	0	---	---
Aluminum	ppm	ASTM D5185m >10	2	---	---
Lead	ppm	ASTM D5185m >5	<1	---	---
Copper	ppm	ASTM D5185m >14	8	---	---
Tin	ppm	ASTM D5185m >13	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	3	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	55	---	---
Calcium	ppm	ASTM D5185m	1197	---	---
Phosphorus	ppm	ASTM D5185m	328	---	---
Zinc	ppm	ASTM D5185m	418	---	---
Sulfur	ppm	ASTM D5185m	2537	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >200	4	---	---
Sodium	ppm	ASTM D5185m	4	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---
Fuel	%	ASTM D3524 >4.0	0.2	---	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	---	---
Nitration	Abs/cm	*ASTM D7624 >20	3.1	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	14.6	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	7.8	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.68	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	3.84	---	---


OIL ANALYSIS REPORT

▲ Ferrous Alloys



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---


Fuel Dilution

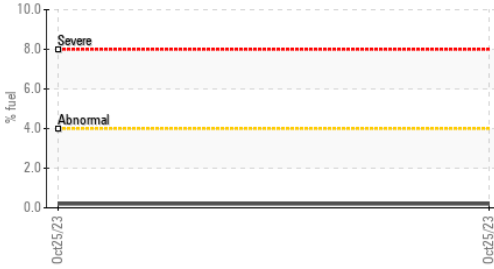


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.0	---	---

GRAPHS


▲ Iron (ppm)

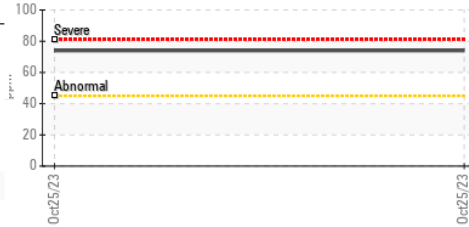

Lead (ppm)

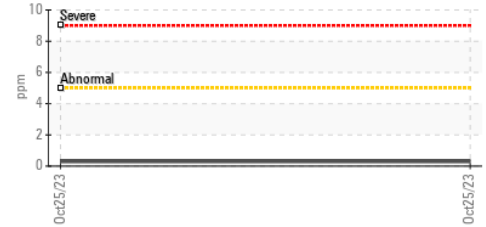

Acid Number

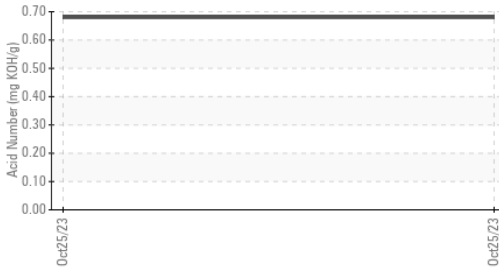


Aluminum (ppm)




Chromium (ppm)




Base Number

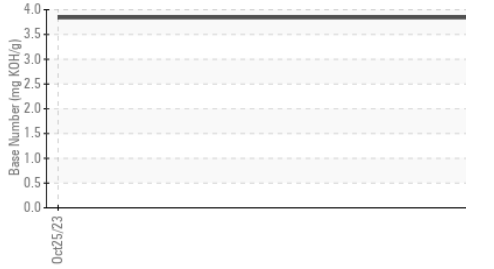


Copper (ppm)

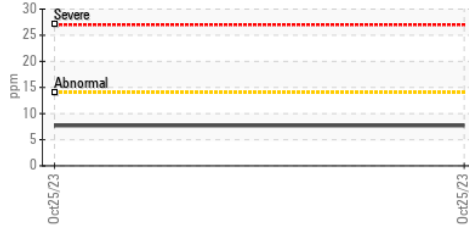

Silicon (ppm)

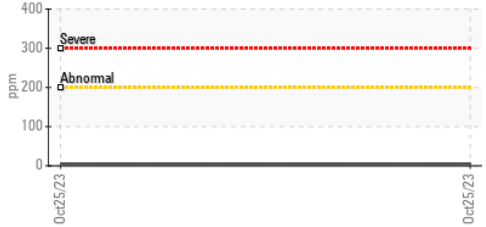


Viscosity @ 100°C

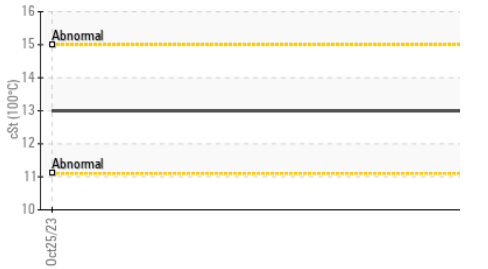

Viscosity @ 100°C



Base Number

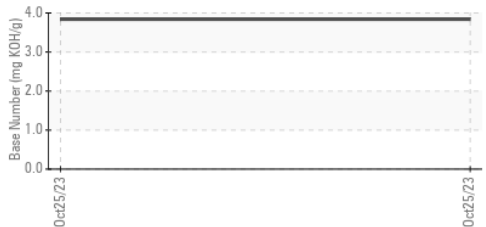

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0099796 **Received** : 14 Nov 2023
Lab Number : 06007122 **Diagnosed** : 16 Nov 2023
Unique Number : 10740884 **Diagnostician** : Sean Felton
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

USA COMPRESSION
 375 S MAIN STREET
 MANSFIELD, PA
 US 16933

Contact: JASON KUZNESKI
 jkuzneski@usacompression.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: