


OIL ANALYSIS REPORT

SAMPLE INFORMATION method

Sample Rating Trend





NORMAL

| - D / / | | | |
|-----------|--------|-----------------|--|
| - 1 1 1 / | ٩GN | $() \subseteq$ | |
| | - UIII | | |

Machine Id 413024 Component **Diesel Engine**

Recommendation

Resample at the next service interval to monitor.

PETRO CANADA DURON SHP 15W40 (--- GAL)

Wear

Fluic

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| SAMPLE INFURIN | | methoa | iimivbase | current | riistory i | riistoryz |
|------------------------|--------------------|-------------|-------------------|-----------------|------------------|------------------|
| Sample Number | | Client Info | | GFL0098849 | GFL0098820 | GFL0090987 |
| Sample Date | | Client Info | | 09 Nov 2023 | 19 Oct 2023 | 04 Oct 2023 |
| Machine Age | hrs | Client Info | | 2737 | 2583 | 2477 |
| Oil Age | hrs | Client Info | | 154 | 106 | 145 |
| Oil Changed | | Client Info | | Changed | Changed | Changed |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| | | | 11 11 11 | - | | |
| CONTAMINATI | ON | method | limit/base | current | history1 | history2 |
| Fuel | | WC Method | >5 | <1.0 | <1.0 | <1.0 |
| Glycol | | WC Method | | NEG | NEG | NEG |
| WEAR METALS | 5 | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >100 | 3 | 10 | 6 |
| Chromium | ppm | ASTM D5185m | >20 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185m | >4 | 0 | 1 | 1 |
| Titanium | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Silver | ppm | ASTM D5185m | >3 | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m | >20 | 1 | 6 | 4 |
| Lead | ppm | ASTM D5185m | >40 | 0 | 0 | 1 |
| Copper | ppm | ASTM D5185m | >330 | 1 | 8 | 7 |
| Tin | ppm | ASTM D5185m | >15 | 0 | <1 | 1 |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 1 | 4 | 3 |
| Barium | ppm | ASTM D5185m | 0 | <1 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 60 | 57 | 63 | 63 |
| Manganese | ppm | ASTM D5185m | 0 | 0 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | 1010 | 897 | 917 | 940 |
| Calcium | ppm | ASTM D5185m | 1070 | 988 | 998 | 1012 |
| Phosphorus | ppm | ASTM D5185m | 1150 | 963 | 1059 | 1027 |
| Zinc | ppm | ASTM D5185m | 1270 | 1168 | 1212 | 1272 |
| Sulfur | ppm | ASTM D5185m | 2060 | 3429 | 3438 | 2896 |
| CONTAMINAN | ΓS | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 3 | 7 | 7 |
| Sodium | ppm | ASTM D5185m | | <1 | 4 | 4 |
| Potassium | ppm | ASTM D5185m | >20 | 4 | 12 | 9 |
| INFRA-RED | | method | limit/base | current | history1 | history2 |
| Soot % | % | *ASTM D7844 | >3 | 0.1 | 0.3 | 0.3 |
| | A I / | *ASTM D7624 | >20 | 5.8 | 8.2 | 7.7 |
| Nitration | Abs/cm | | | | | |
| Nitration Sulfation | Abs/cm Abs/.1mm | *ASTM D7415 | >30 | 18.3 | 19.3 | 19.4 |
| | Abs/.1mm | | >30 limit/base | 18.3 current | 19.3 history1 | 19.4 history2 |
| Sulfation | Abs/.1mm | *ASTM D7415 | | | | |




OIL ANALYSIS REPORT





| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|-----------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |
| FLUID PROPE | RTIES | method | limit/base | current | history1 | history2 |
| Visc @ 100°C | cSt | ASTM D445 | 15.4 | 14.1 | 13.6 | 13.6 |
| GRAPHS | | | | | | |

Ferrous Alloys

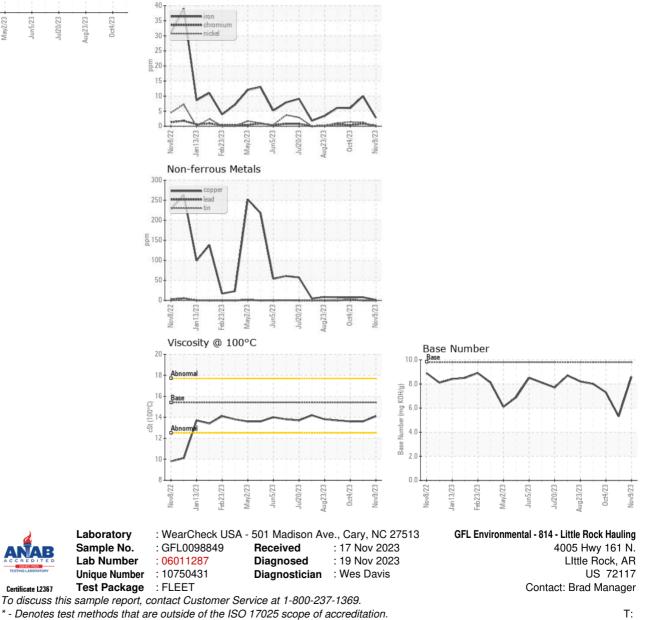

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)