

### **OIL ANALYSIS REPORT**

#### Sample Rating Trend



# 721033-310086

#### Component Diesel Engine

Fluid

PETRO CANADA DURON SHP 15W40 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.


			11 1. 11			
SAMPLE INFOR	VIATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0086397	GFL0086392	GFL0086382
Sample Date		Client Info		19 Nov 2023	29 Oct 2023	16 Oct 2023
Machine Age	hrs	Client Info		7567	7506	7363
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron		ASTM D5185m	>100	15	9	13
Chromium	ppm ppm	ASTM D5185m		15	<1	2
Nickel	ppm	ASTM D5185m	>20	، <1	0	<1
Titanium	ppm	ASTM D5185m	~7	<1	0	<1
Silver		ASTM D5185m	>3	<1	0	0
Aluminum	ppm ppm		>20	<1 8	5	7
Lead		ASTM D5185m	>20	o <1	0	<1
	ppm	ASTM D5185m		1	1	1
Copper Tin	ppm	ASTM D5185m		۱ <1	0	<1
Vanadium	ppm	ASTM D5185m	>10	< 1	0	<1
Cadmium	ppm	ASTM D5185m		۰ <1	0	<1
Gaumum	ppm	ASTIVI DOTODITI		<1	0	< 1
ADDITIVES		method	limit/base	current	history1	history2
ADDITIVES Boron	ppm	method ASTM D5185m	limit/base	current 7	history1 7	history2 10
	ppm ppm					
Boron		ASTM D5185m	0	7	7	10
Boron Barium	ppm	ASTM D5185m ASTM D5185m	0	7 9	7 0	10 10
Boron Barium Molybdenum	ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60	7 9 79	7 0 60	10 10 90
Boron Barium Molybdenum Manganese	ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0	7 9 79 <1	7 0 60 <1	10 10 90 <1
Boron Barium Molybdenum Manganese Magnesium	ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010	7 9 79 <1 1048	7 0 60 <1 838	10 10 90 <1 1204
Boron Barium Molybdenum Manganese Magnesium Calcium	ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070	7 9 79 <1 1048 1283	7 0 60 <1 838 1026	10 10 90 <1 1204 1485
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus	ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070 1150	7 9 79 <1 1048 1283 1188	7 0 60 <1 838 1026 980	10 10 90 <1 1204 1485 1333
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc	ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 0 1010 1070 1150 1270	7 9 79 <1 1048 1283 1188 1459	7 0 60 <1 838 1026 980 1169	10 10 90 <1 1204 1485 1333 1649
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur	ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 1010 1070 1150 1270 2060	7 9 79 <1 1048 1283 1188 1459 4147	7 0 60 <1 838 1026 980 1169 2823 history1 6	10 10 90 <1 1204 1485 1333 1649 4497
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN	ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 1010 1070 1150 1270 2060	7 9 79 <1 1048 1283 1188 1459 4147 current	7 0 60 <1 838 1026 980 1169 2823 history1	10 10 90 <1 1204 1485 1333 1649 4497 history2
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon	ppm ppm ppm ppm ppm ppm ppm ppm TS	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m <b>method</b>	0 0 60 1010 1070 1150 1270 2060 <b>limit/base</b>	7 9 79 <1 1048 1283 1188 1459 4147 <u>current</u> 9	7 0 60 <1 838 1026 980 1169 2823 history1 6	10 10 90 <1 1204 1485 1333 1649 4497 history2 6
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium	ppm ppm ppm ppm ppm ppm ppm ppm TS	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 60 1010 1070 1150 1270 2060 <b>limit/base</b>	7 9 79 <1 1048 1283 1188 1459 4147 current 9 8 8 12	7 0 60 <1 838 1026 980 1169 2823 history1 6 5	10 10 90 <1 1204 1485 1333 1649 4497 history2 6 5
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium	ppm ppm ppm ppm ppm ppm ppm ppm TS	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 <b>limit/base</b> >25	7 9 79 <1 1048 1283 1188 1459 4147 current 9 8 8 12	7 0 60 <1 838 1026 980 1169 2823 history1 6 5 7	10 10 90 <1 1204 1485 1333 1649 4497 history2 6 5 10
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED	ppm ppm ppm ppm ppm ppm ppm ppm TS ppm ppm	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 2060 225 >25	7 9 79 <1 1048 1283 1188 1459 4147 current 9 8 12 2 current	7 0 60 <1 838 1026 980 1169 2823 history1 6 5 7 7 history1	10 10 90 <1 1204 1485 1333 1649 4497 history2 6 5 10 10 history2
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot %	ppm ppm ppm ppm ppm ppm ppm ppm TS ppm ppm	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 limit/base >25 >20 limit/base	7 9 79 <1 1048 1283 1188 1459 4147 <u>current</u> 9 8 12 <u>current</u> 0.7	7 0 60 <1 838 1026 980 1169 2823 history1 6 5 7 7 history1 0.6	10 10 90 <1 1204 1485 1333 1649 4497 history2 6 5 10 history2 0.5
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 limit/base >25 >20 limit/base >3 >20	7 9 79 <1 1048 1283 1188 1459 4147 <i>current</i> 9 8 12 2 <i>current</i> 0.7 9.7	7 0 60 <1 838 1026 980 1169 2823 history1 6 5 7 7 history1 0.6 8.8	10 10 90 <1 1204 1485 1333 1649 4497 history2 6 5 10 5 10 history2 0.5 7.7
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation FLUID DEGRAC	ppm ppm ppm ppm ppm ppm ppm ppm TS ppm ppm ppm ppm	ASTM D5185m ASTM D7844 *ASTM D7844	0 0 0 1010 1070 1150 1270 2060 2060 225 20 220 220 20 3 20 3 20 3 3 20 3 3 20 3 3 20 3 3 3 20 3 3 3 20 3 3 3 3	7 9 79 <1 1048 1283 1188 1459 4147 <i>current</i> 9 8 12 <i>current</i> 0.7 9.7 19.9 <i>current</i>	7 0 60 <1 838 1026 980 1169 2823 history1 6 5 7 history1 0.6 8.8 19.6 history1	10 10 90 <1 1204 1485 1333 1649 4497 history2 6 5 10 history2 0.5 7.7 19.0 history2
Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m	0 0 0 1010 1070 1150 1270 2060 <b>imit/base</b> >25 <b>imit/base</b> >3 >20	7 9 79 <1 1048 1283 1188 1459 4147 <u>current</u> 9 8 12 0.7 0.7 9.7 19.9	7 0 60 <1 838 1026 980 1169 2823 history1 6 5 7 7 history1 0.6 8.8 19.6	10 10 90 <1 1204 1485 1333 1649 4497 <b>history2</b> 6 5 10 <b>history2</b> 0.5 7.7 19.0




13


12


## **OIL ANALYSIS REPORT**



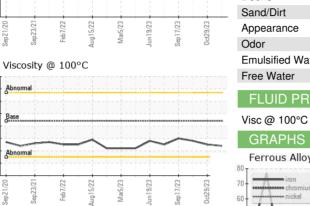

VISUAL		method			history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.4	13.4	13.5	13.8
GRAPHS						

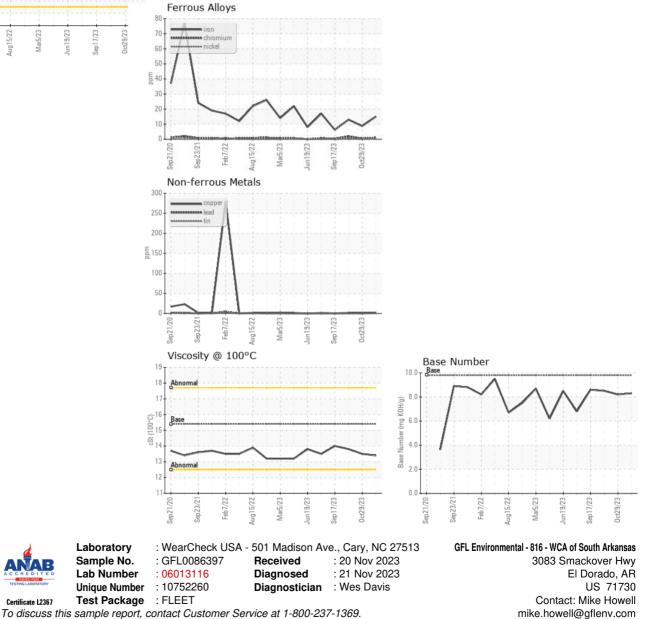



\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Т:

F: