




PROBLEM SUMMARY


Sample Rating Trend

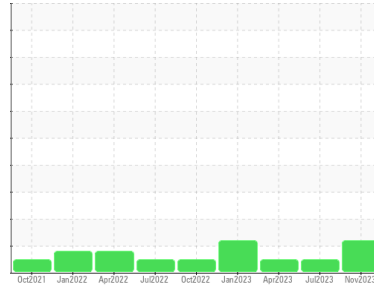

Area
Reversing Mill
 Machine Id
[Reversing Mill] 120125-STAND 1 MOTOR DRIVE END BEARING
 Component
Drive End Circulating System
 Fluid
SHELL TURBO T ISO 68 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

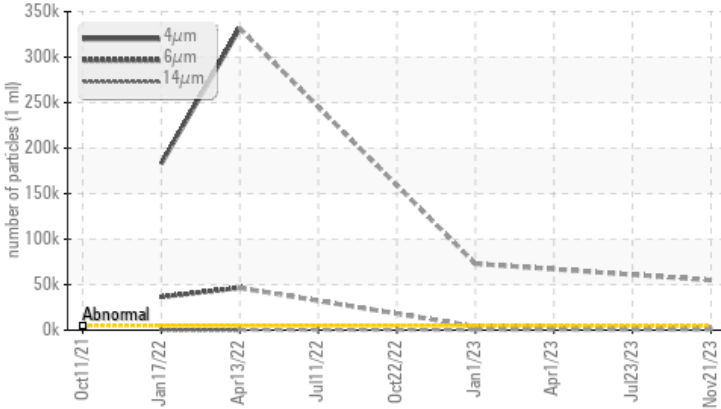

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	NORMAL
Particles >4µm	ASTM D7647	>5000	▲ 54943	---	---
Particles >6µm	ASTM D7647	>1300	▲ 2035	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 23/18/10	---	---

Customer Id: SDITER
 Sample No.: PCA0101538
 Lab Number: 06015040
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

23 Jul 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Apr 2023 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Jan 2023 Diag: Angela Borella

ISO




We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area
Reversing Mill
 Machine Id
[Reversing Mill] 120125-STAND 1 MOTOR DRIVE END BEARING
 Component
Drive End Circulating System
 Fluid
SHELL TURBO T ISO 68 (--- GAL)

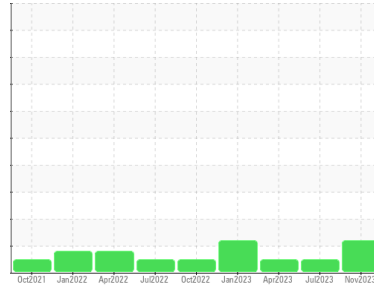

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0101538	PCA0101588	PCA0089438
Sample Date	Client Info	21 Nov 2023	23 Jul 2023	01 Apr 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	Not Changd
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	14	4	5
Chromium	ppm	ASTM D5185m	<1	0	0
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m	2	0	<1
Lead	ppm	ASTM D5185m	0	0	0
Copper	ppm	ASTM D5185m	<1	0	0
Tin	ppm	ASTM D5185m	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	0	0	<1
Calcium	ppm	ASTM D5185m	0	0	0
Phosphorus	ppm	ASTM D5185m	2	0	4
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	0	0	3

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	<1	0	0
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	0
Water	%	ASTM D6304	NEG	NEG	NEG

FLUID CLEANLINESS


method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	▲ 54943	---	---
Particles >6µm	ASTM D7647	>1300	▲ 2035	---	---
Particles >14µm	ASTM D7647	>160	10	---	---
Particles >21µm	ASTM D7647	>40	2	---	---
Particles >38µm	ASTM D7647	>10	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 23/18/10	---	---

FLUID DEGRADATION


method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	.05	0.05	0.043	0.152

OIL ANALYSIS REPORT


▲ Particle Trend

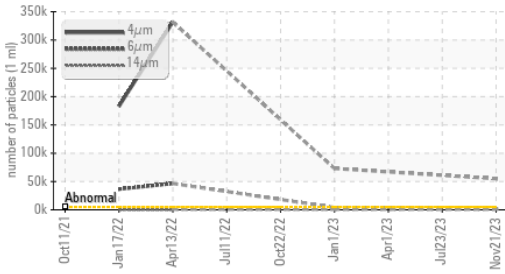


▲ Particle Trend

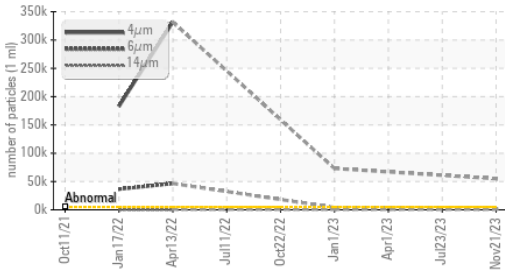

Acid Number

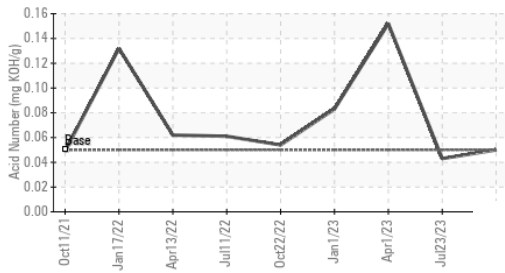

Viscosity @ 40°C

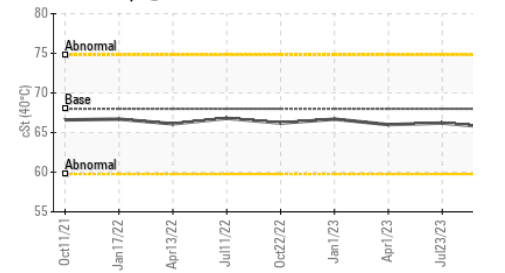

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG





FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	65.6	66.2	66.0

SAMPLE IMAGES

Color

Bottom

GRAPHS

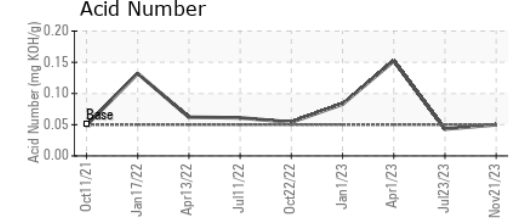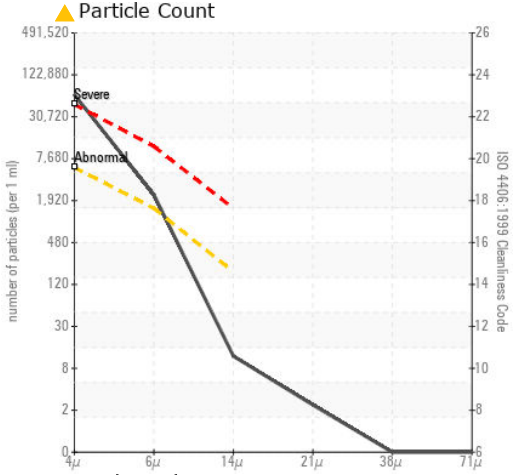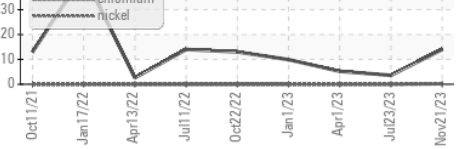

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0101538 **Received** : 22 Nov 2023
Lab Number : 06015040 **Diagnosed** : 26 Nov 2023
Unique Number : 10754184 **Diagnostician** : Don Baldrige
Test Package : PLANT

SDI - Steel Dynamics Inc. - Heartland
 455 West Industrial Drive
 Terre Haute, IN
 US 47802
 Contact: BRAD ELLIS
 brad.ellis@steeldynamics.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)