


Area
MARSHALL
Machine Id
[MARSHALL] DB100101E Unit 01
Component
Natural Gas Engine
Fluid
PETRO CANADA DURON MONOGRADE HD 40W (250 GAL)

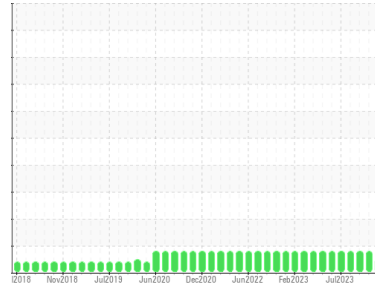

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0073214	PCA0073213	PCA0073212
Sample Date	Client Info		29 Nov 2023	31 Oct 2023	28 Sep 2023
Machine Age	hrs	Client Info	14547	14094	13854
Oil Age	hrs	Client Info	14547	14094	13854
Oil Changed	Client Info		Filtered	Filtered	Filtered
Sample Status			NORMAL	MARGINAL	MARGINAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	2	5
Chromium	ppm	ASTM D5185m >4	0	0	0
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >9	1	1	4
Lead	ppm	ASTM D5185m >30	1	0	1
Copper	ppm	ASTM D5185m >35	2	0	1
Tin	ppm	ASTM D5185m >4	0	0	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	3	3
Barium	ppm	ASTM D5185m	<1	0	0
Molybdenum	ppm	ASTM D5185m	2	1	3
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	916	861	893
Calcium	ppm	ASTM D5185m	1064	1025	1068
Phosphorus	ppm	ASTM D5185m	1076	1004	1095
Zinc	ppm	ASTM D5185m	1288	1241	1321
Sulfur	ppm	ASTM D5185m	2751	2859	3376

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	4	2	3
Sodium	ppm	ASTM D5185m	2	<1	0
Potassium	ppm	ASTM D5185m >20	0	0	2
Fuel	%	ASTM D3524 >4.0	0.0	▲ 2.4	▲ 2.6





INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624 >20	4.4	4.6	4.3
Sulfation	Abs/.1mm	*ASTM D7415 >30	13.7	13.8	13.2

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	7.6	7.8	7.2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.24	1.42	1.52
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	8.35	7.43	8.96









OIL ANALYSIS REPORT

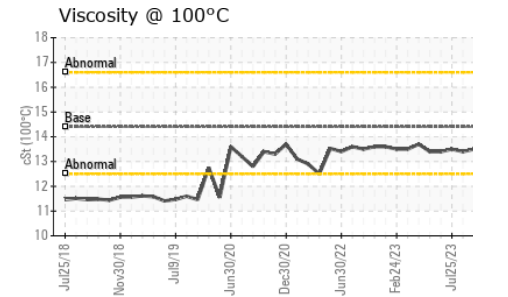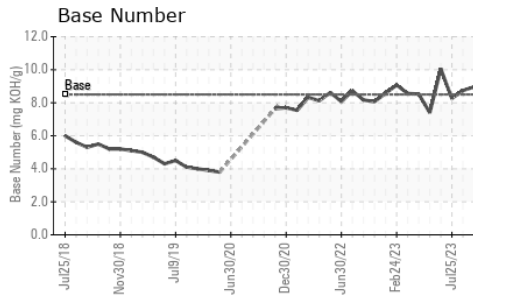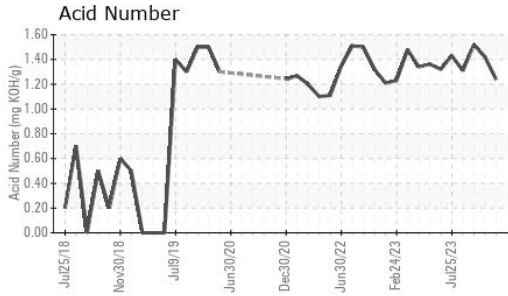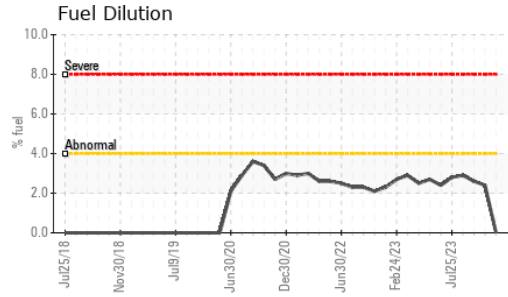

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	13.6	13.4	13.5

GRAPHS

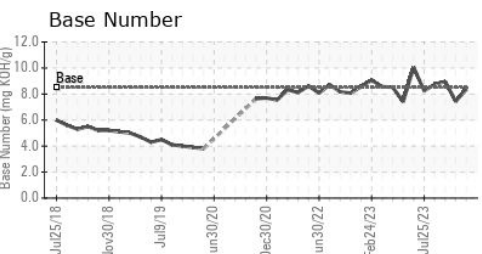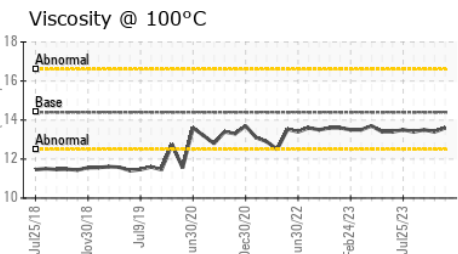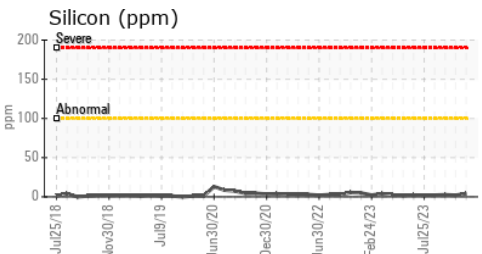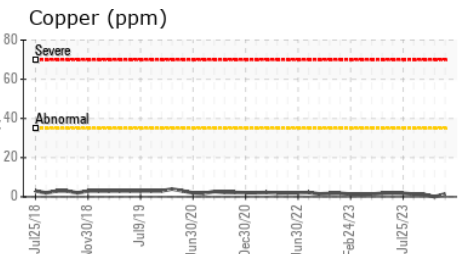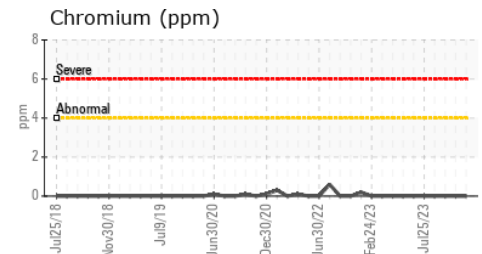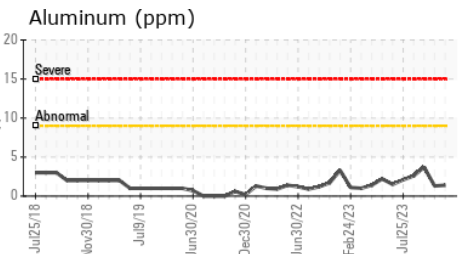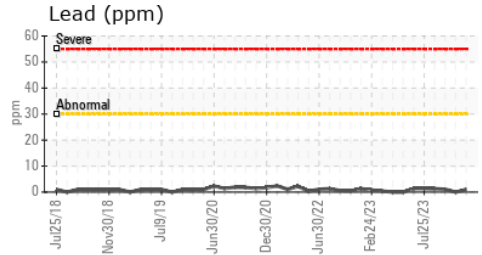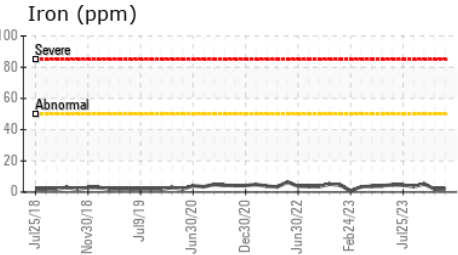

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0073214 **Received** : 06 Dec 2023
Lab Number : 06026650 **Diagnosed** : 14 Dec 2023
Unique Number : 10776441 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Magellan Midstream LP - Marshall
 1601 West College Drive
 Marshall, MN
 US 56258
 Contact: Brett Erickson
 brett.erickson@magellanlp.com
 T: (519)822-1260
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)